

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P224970

Luminaire Tested: **LSSQ2B10FL409035D010 2LBDL\*LI**

Issue Date: 3/3/2020


**Test Information**

Test Method: LM-41-14  
Report Number: P224970  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (152)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQ2B10FL409035D010 2LBDL\*LI  
Description: 1000 Lumen, 2inch Portfolio LED Cylinder  
FLOOD OPTIC  
LENSED SPUN ROUND TRIM WITH LI FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 809.9 lumens  
Efficiency: N/A  
Efficacy: 78.6 lumens/watt  
Spacing Criteria (0/90/45): 0.59 / 0.59 / 0.58  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 10.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

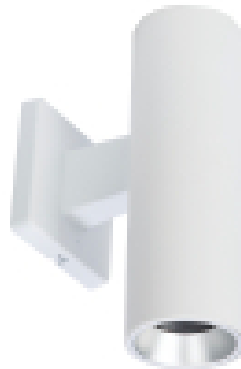

TEST NUMBER: P224970

CATALOG NUMBER: LSSQ2B10FL409035D010 2LBDL\*LI

### Luminous Intensity Polar Plot

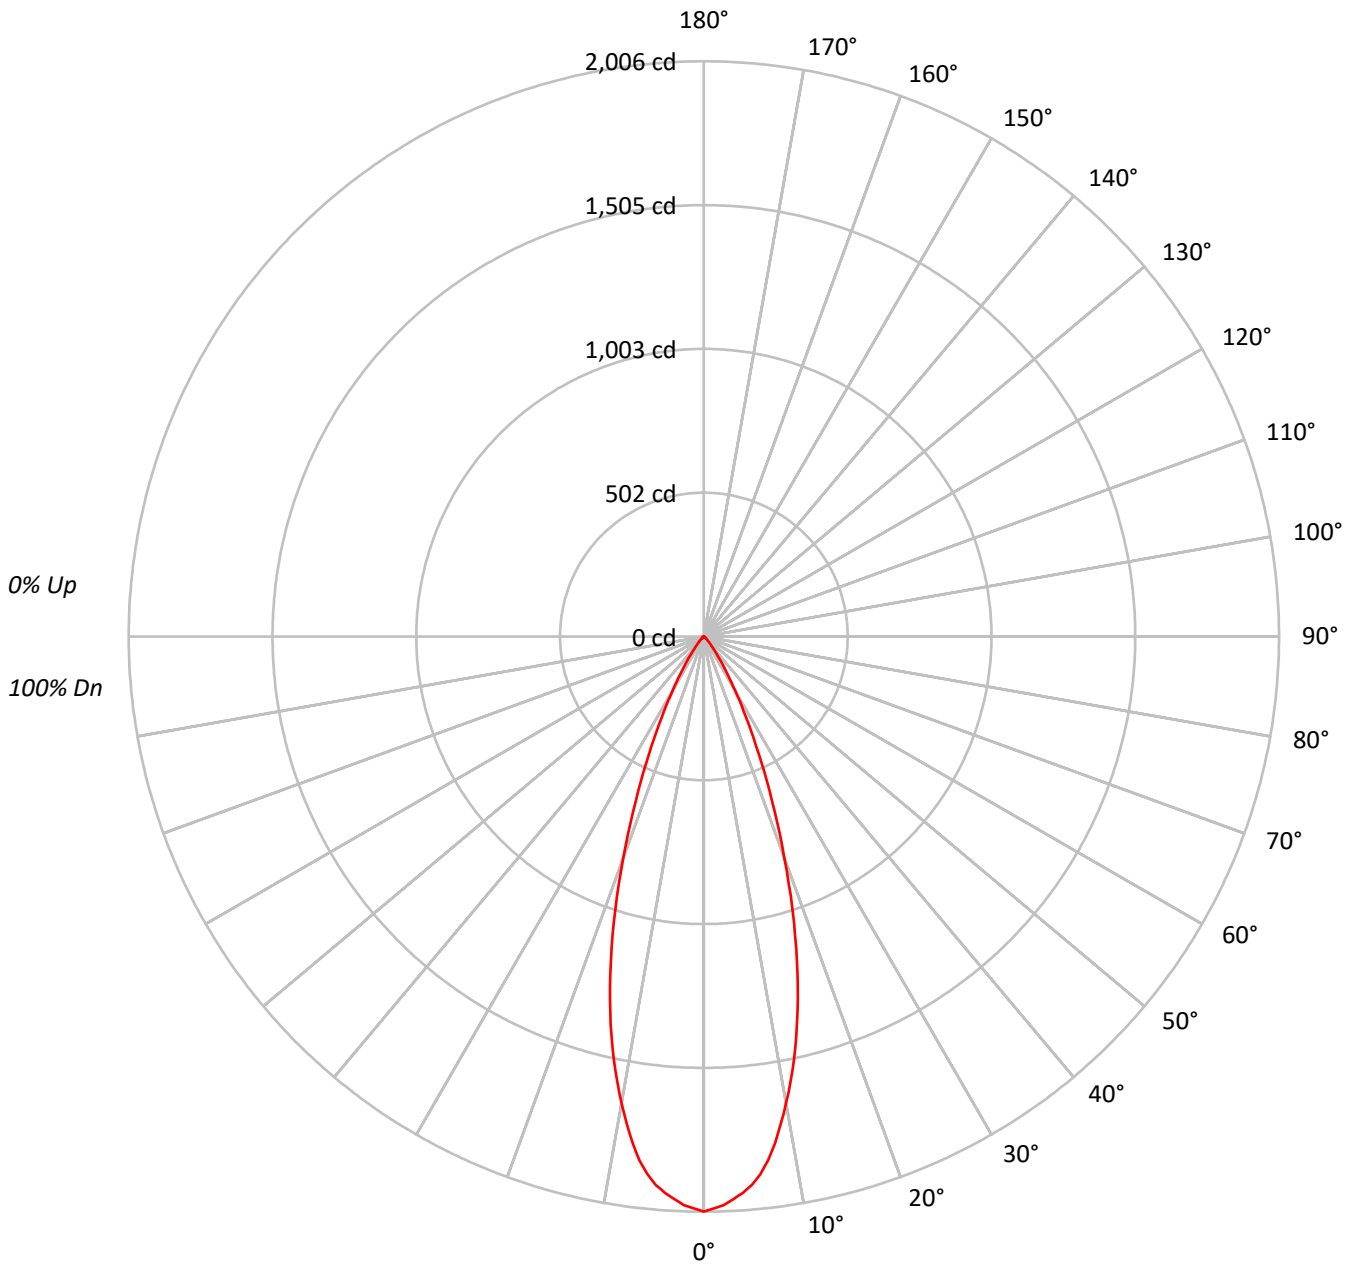



TEST NUMBER: P224970

CATALOG NUMBER: LSSQ2B10FL409035D010 2LBDL\*LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	110	108	112	110	108	106	106	105	103	102	101	100	99	98	97	96			
2	110	106	103	100	108	104	101	99	101	99	97	98	96	95	96	94	93	91			
3	106	101	96	93	104	99	95	92	97	94	91	94	92	90	92	90	88	87			
4	102	96	91	88	100	95	90	87	93	89	86	91	88	85	89	86	84	83			
5	98	91	86	83	97	90	86	83	89	85	82	87	84	81	86	83	81	79			
6	94	87	82	79	93	86	82	79	85	81	78	84	80	78	83	79	77	76			
7	91	83	79	75	90	83	78	75	82	78	75	81	77	74	80	76	74	73			
8	88	80	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	70			
9	85	77	72	69	84	76	72	69	76	71	69	75	71	68	74	71	68	67			
10	82	74	69	66	81	74	69	66	73	69	66	72	68	66	72	68	66	65			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	776900
5°	746584
10°	649924
15°	507478
20°	337513
25°	193265
30°	96073
35°	44165
40°	17698
45°	8107
50°	3736
55°	2093
60°	1240
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P224970

CATALOG NUMBER: LSSQ2B10FL409035D010 2LBDL\*LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	174.8	21.6
10°-20°	343.2	42.4
20°-30°	212.4	26.2
30°-40°	63.6	7.8
40°-50°	12.7	1.6
50°-60°	3.1	0.4
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	730.3	90.2
0°-40°	793.9	98.0
0°-60°	809.7	100.0
0°-90°	809.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	809.9	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2006	
5°	1920	175
15°	1266	343
25°	452	212
35°	93	64
45°	15	13
55°	3	3
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P224970

CATALOG NUMBER: LSSQ2B10FL409035D010 2LBDL\*LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2005.7
1°	1994.8
2°	1984.7
3°	1964.5
4°	1945.8
5°	1920.1
6°	1885.1
7°	1840.7
8°	1783.9
9°	1719.3
10°	1652.4
11°	1583.1
12°	1509.1
13°	1432.1
14°	1349.6
15°	1265.5
17.5°	1043.7
20°	818.8
22.5°	619.5
25°	452.2
27.5°	317.6
30°	214.8
32.5°	141.7
35°	93.4
37.5°	58.4
40°	35.0
42.5°	22.6
45°	14.8
47.5°	9.3
50°	6.2
52.5°	4.7
55°	3.1
57.5°	2.3
60°	1.6
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P224970

CATALOG NUMBER: LSSQ2B10FL409035D010 2LBDL\*LI

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)