

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LSR2B15WFL559024D010 2LBD\*WH**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14804)  
Test Lab: INNOVATION CENTER(G1)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR2B15WFL559024D010 2LBD\*WH  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
WIDE FLOOD OPTIC  
SPUN ROUND TRIM WITH WHEAT HAZE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 928.4 lumens  
Efficiency: N/A  
Efficacy: 64.9 lumens/watt  
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.81  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#  
CATALOG NUMBER: LSR2B15WFL559024D010 2LBD\*WH

### Luminous Intensity Polar Plot

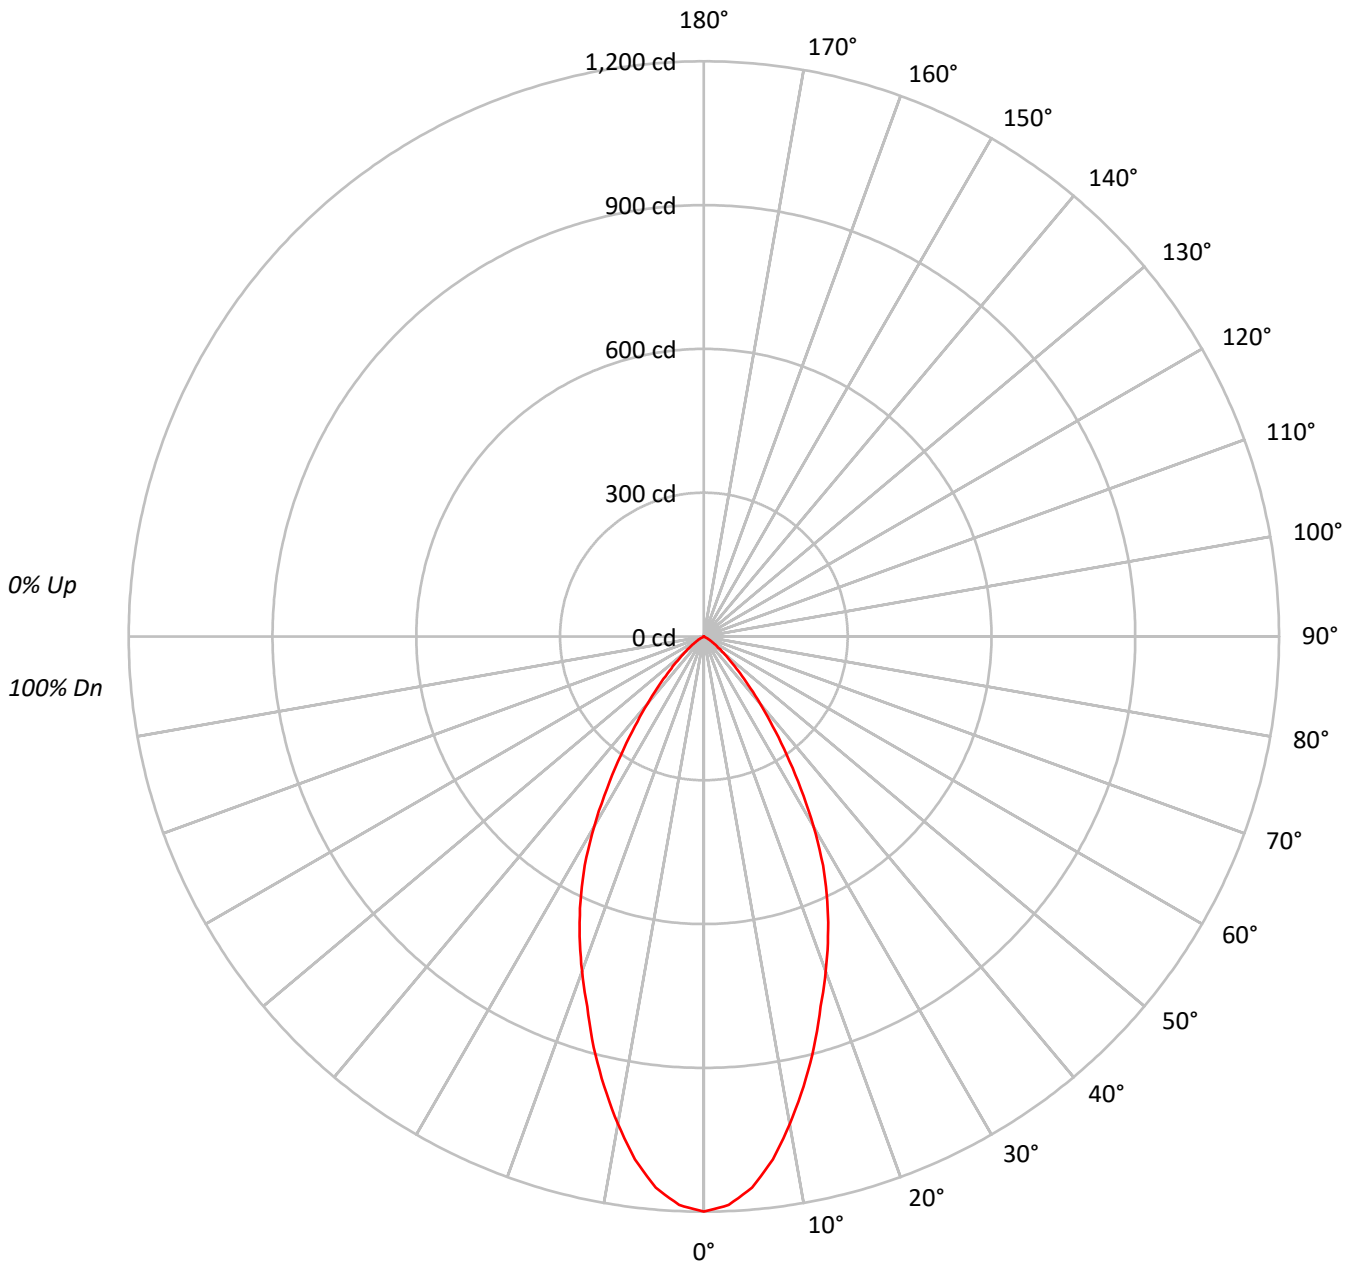



TEST NUMBER: P#

CATALOG NUMBER: LSR2B15WFL559024D010 2LBD\*WH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	95	105	101	97	94	98	95	92	95	92	90	92	90	88	87																			
3	102	96	90	86	100	94	90	86	92	88	84	89	86	83	87	84	82	80																			
4	97	89	83	79	95	88	83	79	86	81	78	84	80	77	82	79	76	74																			
5	92	83	77	73	90	82	77	73	80	76	72	79	75	71	77	74	71	69																			
6	87	78	72	68	86	77	71	67	76	71	67	74	70	66	73	69	66	64																			
7	83	73	67	63	81	73	67	63	71	66	62	70	65	62	69	65	62	60																			
8	79	69	63	59	77	68	63	59	67	62	58	66	61	58	65	61	58	56																			
9	75	65	59	55	74	64	59	55	64	58	55	63	58	54	62	57	54	53																			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	464738
5°	448666
10°	406222
15°	355856
20°	306392
25°	260494
30°	204715
35°	142284
40°	92179
45°	55162
50°	32300
55°	18098
60°	6895
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P#

CATALOG NUMBER: LSR2B15WFL559024D010 2LBD\*WH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	106.2	11.4
10°-20°	247.1	26.6
20°-30°	276.8	29.8
30°-40°	190.2	20.5
40°-50°	81.7	8.8
50°-60°	25.0	2.7
60°-70°	1.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	630.1	67.9
0°-40°	820.3	88.4
0°-60°	927.0	99.9
0°-90°	928.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	928.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1200	
5°	1154	106
15°	887	247
25°	610	277
35°	301	190
45°	101	82
55°	27	25
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P#

CATALOG NUMBER: LSR2B15WFL559024D010 2LBD\*WH

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1199.8
2.5°	1187.1
5°	1153.9
7.5°	1100.4
10°	1032.8
12.5°	961.4
15°	887.4
17.5°	809.6
20°	743.3
22.5°	677.0
25°	609.5
27.5°	538.1
30°	457.7
32.5°	376.1
35°	300.9
37.5°	235.9
40°	182.3
42.5°	136.4
45°	100.7
47.5°	74.0
50°	53.6
52.5°	37.0
55°	26.8
57.5°	17.9
60°	8.9
62.5°	1.3
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)