

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LSSQ2B15WFL558027D010 2LBDL\*LI**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P29153)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQ2B15WFL558027D010 2LBDL\*LI  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
WIDE FLOOD OPTIC  
LENSED SPUN ROUND TRIM WITH LI FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1188.8 lumens  
Efficiency: N/A  
Efficacy: 83.1 lumens/watt  
Spacing Criteria (0/90/45): 0.73 / 0.73 / 0.8  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#  
CATALOG NUMBER: LSSQ2B15WFL558027D010 2LBDL\*LI

### Luminous Intensity Polar Plot

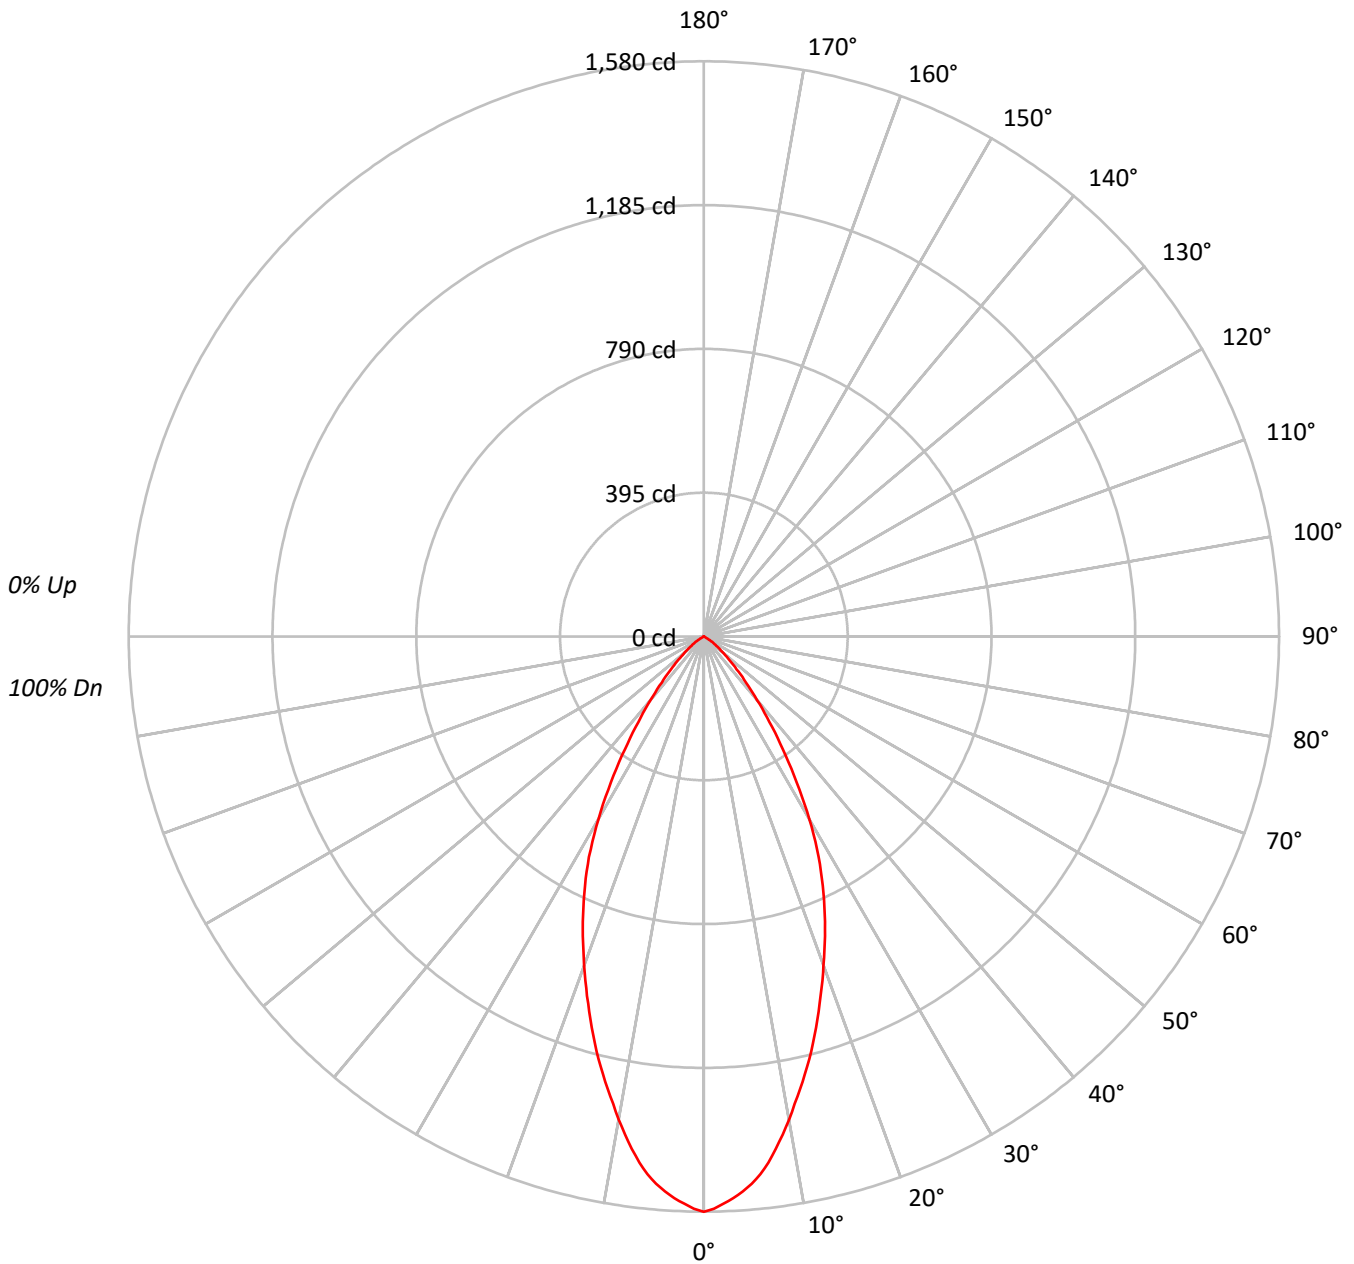



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B15WFL558027D010 2LBDL\*LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	81	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	82	73	67	63	72	66	63	70	66	62	69	65	62	61			
8	79	69	63	59	78	69	63	59	68	62	59	66	62	58	66	61	58	57			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	612162
5°	586816
10°	529961
15°	464289
20°	396129
25°	332295
30°	259192
35°	178695
40°	114781
45°	69460
50°	40736
55°	22826
60°	6585
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B15WFL558027D010 2LBDL\*LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	138.8	11.7
10°-20°	321.8	27.1
20°-30°	353.6	29.7
30°-40°	239.3	20.1
40°-50°	102.6	8.6
50°-60°	31.3	2.6
60°-70°	1.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	814.3	68.5
0°-40°	1053.6	88.6
0°-60°	1187.5	99.9
0°-90°	1188.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1188.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1580	
5°	1509	139
15°	1158	322
25°	778	354
35°	378	239
45°	127	103
55°	34	31
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B15WFL558027D010 2LBDL\*LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1580.4
1°	1571.9
2°	1558.7
3°	1545.4
4°	1528.5
5°	1509.2
6°	1485.0
7°	1456.0
8°	1421.0
9°	1384.8
10°	1347.4
11°	1307.5
12°	1271.3
13°	1233.9
14°	1196.5
15°	1157.8
17.5°	1057.6
20°	961.0
22.5°	869.3
25°	777.5
27.5°	683.3
30°	579.5
32.5°	474.5
35°	377.9
37.5°	295.8
40°	227.0
42.5°	171.4
45°	126.8
47.5°	93.0
50°	67.6
52.5°	48.3
55°	33.8
57.5°	21.7
60°	8.5
62.5°	1.2
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B15WFL558027D010 2LBDL\*LI

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)