

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LSSQWM2B15WFL558027D010 2LBD\*H**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P29157)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQWM2B15WFL558027D010 2LBD\*H  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
WIDE FLOOD OPTIC  
SPUN ROUND TRIM WITH HAZE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1278.6 lumens  
Efficiency: N/A  
Efficacy: 89.4 lumens/watt  
Spacing Criteria (0/90/45): 0.77 / 0.77 / 0.82  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#  
CATALOG NUMBER: LSSQWM2B15WFL558027D010 2LBD\*H

### Luminous Intensity Polar Plot

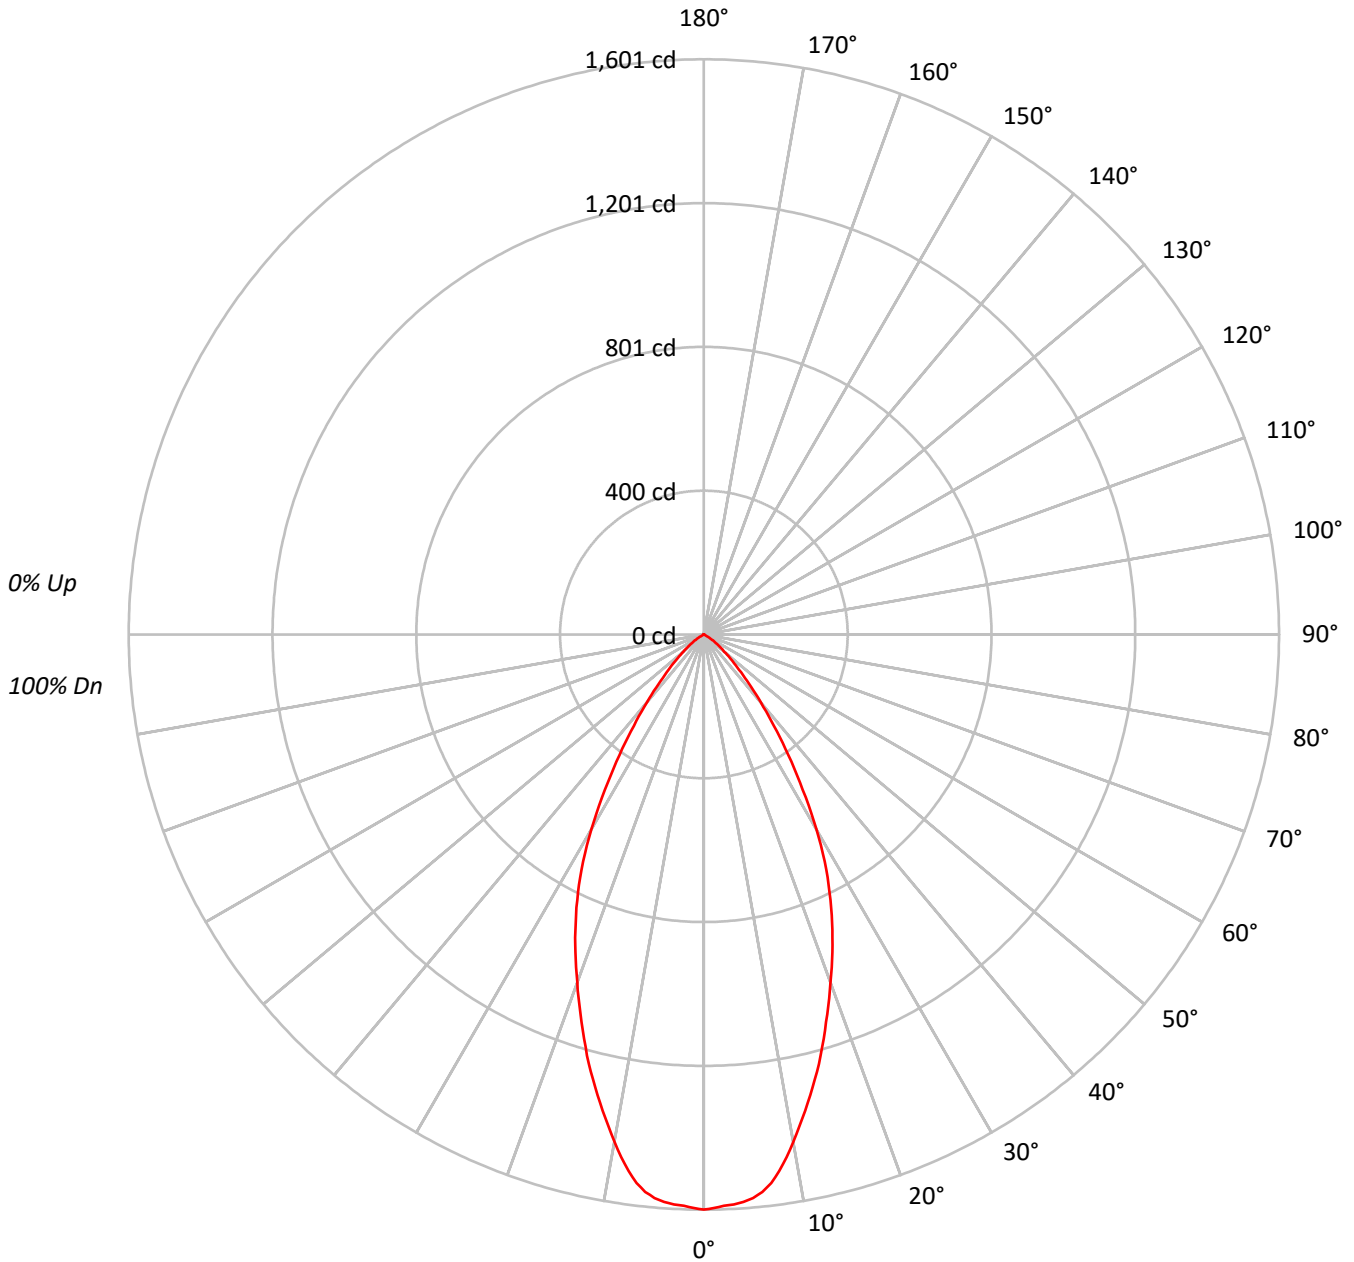



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558027D010 2LBD\*H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	105	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	86	100	94	90	86	92	88	84	89	86	83	87	84	82	80			
4	97	89	83	79	95	88	83	79	86	81	78	84	80	77	82	79	76	74			
5	92	83	77	73	90	82	77	73	81	76	72	79	75	71	77	74	71	69			
6	87	78	72	68	86	77	71	67	76	71	67	74	70	66	73	69	66	64			
7	83	73	67	63	81	73	67	63	71	66	62	70	65	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	56			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	62	56	52	70	61	55	52	60	55	52	59	55	51	59	54	51	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	620025
5°	612206
10°	563787
15°	496210
20°	424983
25°	358537
30°	279945
35°	193401
40°	124237
45°	75869
50°	44894
55°	25595
60°	8134
65°	1192
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558027D010 2LBD\*H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	145.9	11.4
10°-20°	343.8	26.9
20°-30°	381.2	29.8
30°-40°	258.7	20.2
40°-50°	111.7	8.7
50°-60°	35.1	2.7
60°-70°	2.2	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	870.9	68.1
0°-40°	1129.6	88.3
0°-60°	1276.4	99.8
0°-90°	1278.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1278.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1601	
5°	1574	146
15°	1237	344
25°	839	381
35°	409	259
45°	138	112
55°	38	35
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558027D010 2LBD\*H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1600.7
1°	1596.8
2°	1591.5
3°	1588.9
4°	1583.7
5°	1574.5
6°	1560.2
7°	1538.0
8°	1507.9
9°	1472.6
10°	1433.4
11°	1394.2
12°	1355.0
13°	1315.8
14°	1276.6
15°	1237.4
17.5°	1131.6
20°	1031.0
22.5°	935.6
25°	838.9
27.5°	738.3
30°	625.9
32.5°	512.2
35°	409.0
37.5°	320.1
40°	245.7
42.5°	185.5
45°	138.5
47.5°	101.9
50°	74.5
52.5°	53.6
55°	37.9
57.5°	24.8
60°	10.5
62.5°	2.6
65°	1.3
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558027D010 2LBD\*H

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)