

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P224603

Luminaire Tested: **LSSQWM2B15FL409030D010 2LBDLC\*MMS**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P224603  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14836)  
Test Lab: INNOVATION CENTER (G1)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQWM2B15FL409030D010 2LBDLC\*MMS  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
FLOOD OPTIC  
LENSED CAST ROUND TRIM WITH MATTE METALLIC SILVER  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1029.0 lumens  
Efficiency: N/A  
Efficacy: 72.0 lumens/watt  
Spacing Criteria (0/90/45): 0.61 / 0.61 / 0.59  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P224603

CATALOG NUMBER: LSSQWM2B15FL409030D010 2LBDLC\*MMS

### Luminous Intensity Polar Plot

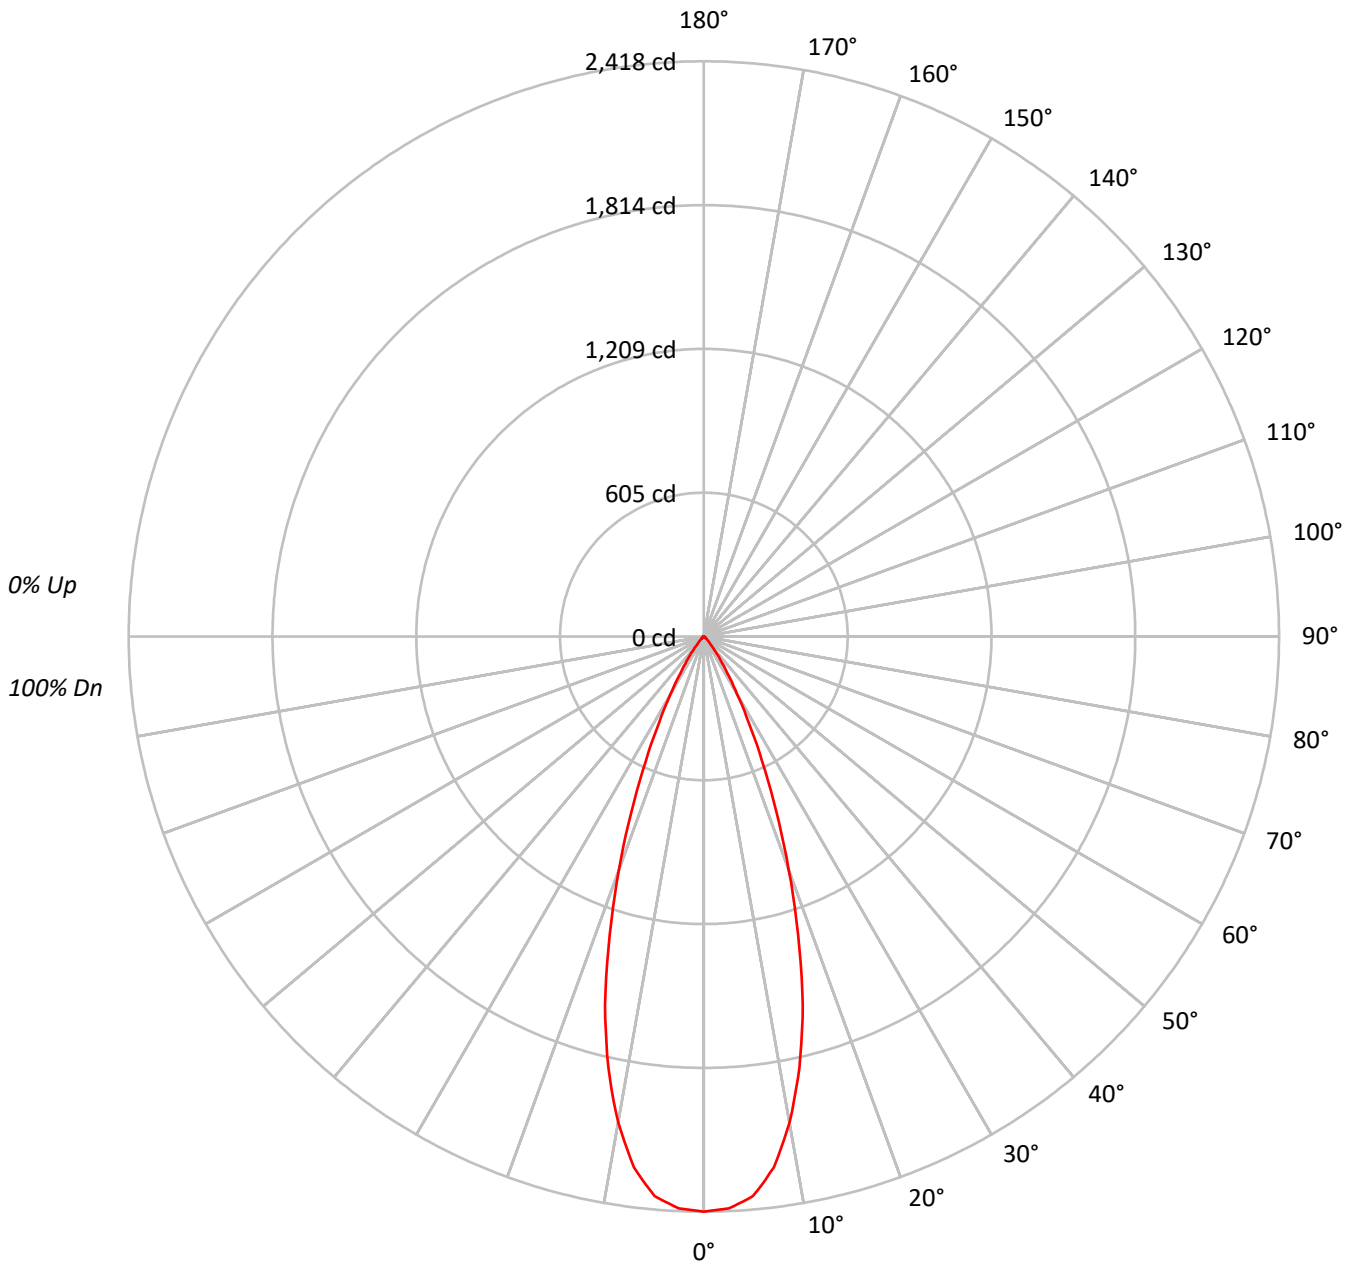



TEST NUMBER: P224603

CATALOG NUMBER: LSSQWM2B15FL409030D010 2LBDLC\*MMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95			95
2	110	106	102	100	108	104	101	99	101	99	96	98	96	94	95	94	92	91			91
3	106	100	96	93	104	99	95	92	97	93	91	94	92	89	92	90	88	87			87
4	102	95	91	87	100	94	90	87	92	89	86	90	87	85	89	86	84	83			83
5	98	91	86	83	96	90	86	82	88	85	82	87	83	81	85	83	80	79			79
6	94	87	82	78	93	86	82	78	85	81	78	83	80	77	82	79	77	76			76
7	91	83	78	75	89	82	78	75	81	77	74	80	77	74	79	76	73	72			72
8	87	80	75	71	86	79	75	71	78	74	71	77	73	71	76	73	70	69			69
9	84	76	72	68	83	76	71	68	75	71	68	74	71	68	74	70	68	67			67
10	81	74	69	66	81	73	69	66	72	68	65	72	68	65	71	68	65	64			64

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	936680
5°	918678
10°	816063
15°	643982
20°	429518
25°	247245
30°	125235
35°	58682
40°	24018
45°	10846
50°	5544
55°	3579
60°	2014
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P224603

CATALOG NUMBER: LSSQWM2B15FL409030D010 2LBDLC\*MMS

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	216.2	21.0
10°-20°	434.0	42.2
20°-30°	271.8	26.4
30°-40°	84.1	8.2
40°-50°	17.4	1.7
50°-60°	4.8	0.5
60°-70°	0.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	922.0	89.6
0°-40°	1006.1	97.8
0°-60°	1028.3	99.9
0°-90°	1029.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1029.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2418	
5°	2363	216
15°	1606	434
25°	578	272
35°	124	84
45°	20	17
55°	5	5
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P224603

CATALOG NUMBER: LSSQWM2B15FL409030D010 2LBDLC\*MMS

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2418.2
2.5°	2406.3
5°	2362.7
7.5°	2251.7
10°	2074.8
12.5°	1856.9
15°	1605.9
17.5°	1316.7
20°	1042.0
22.5°	792.4
25°	578.5
27.5°	406.8
30°	280.0
32.5°	187.5
35°	124.1
37.5°	77.9
40°	47.5
42.5°	30.4
45°	19.8
47.5°	13.2
50°	9.2
52.5°	6.6
55°	5.3
57.5°	4.0
60°	2.6
62.5°	1.3
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)