

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P225114

Luminaire Tested: **LSSQ2B15FL409730D010 2LBD\*GPH**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P225114  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14831)  
Test Lab: INNOVATION CENTER (G1)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQ2B15FL409730D010 2LBD\*GPH  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
FLOOD OPTIC  
SPUN ROUND TRIM WITH GRAPHITE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1030.8 lumens  
Efficiency: N/A  
Efficacy: 72.1 lumens/watt  
Spacing Criteria (0/90/45): 0.61 / 0.61 / 0.59  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P225114

CATALOG NUMBER: LSSQ2B15FL409730D010 2LBD\*GPH

### Luminous Intensity Polar Plot

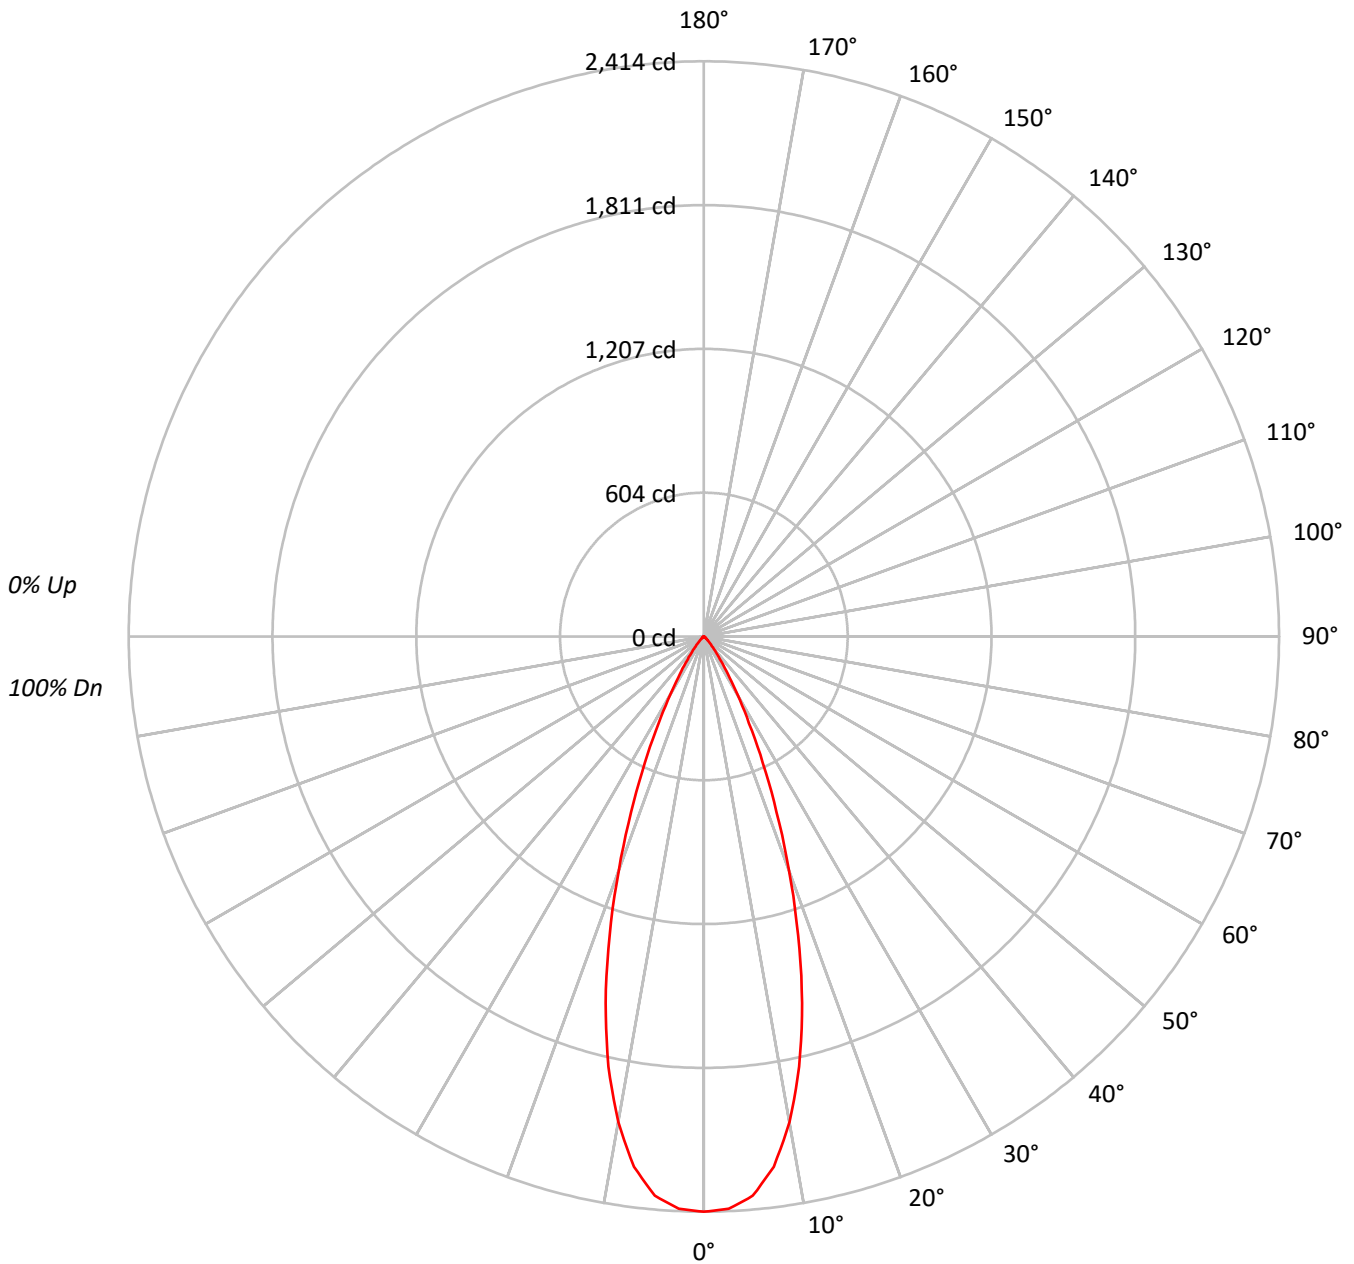



TEST NUMBER: P225114

CATALOG NUMBER: LSSQ2B15FL409730D010 2LBD\*GPH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95	95	95	95
2	110	106	102	100	108	104	101	98	101	99	96	98	96	94	95	94	92	91	91	91	91
3	106	100	96	93	104	99	95	92	96	93	91	94	92	89	92	90	88	87	87	87	87
4	102	95	91	87	100	94	90	87	92	89	86	90	87	85	89	86	84	83	83	83	83
5	98	91	86	83	96	90	85	82	88	84	81	87	83	81	85	82	80	79	79	79	79
6	94	87	82	78	93	86	81	78	85	81	78	83	80	77	82	79	77	75	75	75	75
7	91	83	78	75	89	82	78	74	81	77	74	80	76	74	79	76	73	72	72	72	72
8	87	80	75	71	86	79	74	71	78	74	71	77	73	71	76	73	70	69	69	69	69
9	84	76	72	68	83	76	71	68	75	71	68	74	70	68	73	70	68	66	66	66	66
10	81	73	69	65	80	73	68	65	72	68	65	72	68	65	71	67	65	64	64	64	64

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	935092
5°	916190
10°	814097
15°	638729
20°	429559
25°	249937
30°	125190
35°	58398
40°	27254
45°	11504
50°	5544
55°	3579
60°	2014
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P225114

CATALOG NUMBER: LSSQ2B15FL409730D010 2LBD\*GPH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	215.7	20.9
10°-20°	432.3	41.9
20°-30°	273.4	26.5
30°-40°	85.0	8.3
40°-50°	18.9	1.8
50°-60°	4.8	0.5
60°-70°	0.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	921.4	89.4
0°-40°	1006.4	97.6
0°-60°	1030.2	99.9
0°-90°	1030.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1030.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2414	
5°	2356	216
15°	1593	432
25°	585	273
35°	124	85
45°	21	19
55°	5	5
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P225114

CATALOG NUMBER: LSSQ2B15FL409730D010 2LBD\*GPH

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2414.1
2.5°	2403.6
5°	2356.3
7.5°	2244.6
10°	2069.8
12.5°	1849.0
15°	1592.8
17.5°	1315.5
20°	1042.1
22.5°	796.4
25°	584.8
27.5°	410.0
30°	279.9
32.5°	185.3
35°	123.5
37.5°	82.8
40°	53.9
42.5°	32.9
45°	21.0
47.5°	14.5
50°	9.2
52.5°	6.6
55°	5.3
57.5°	3.9
60°	2.6
62.5°	1.3
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)