

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P224949

Luminaire Tested: **LSSQWM2B15FL408040D010 2LBD\*H**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P224949  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (156)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQWM2B15FL408040D010 2LBD\*H  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
FLOOD OPTIC  
SPUN ROUND TRIM WITH HAZE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1447.4 lumens  
Efficiency: N/A  
Efficacy: 101.2 lumens/watt  
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.59  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P224949

CATALOG NUMBER: LSSQWM2B15FL408040D010 2LBD\*H

### Luminous Intensity Polar Plot

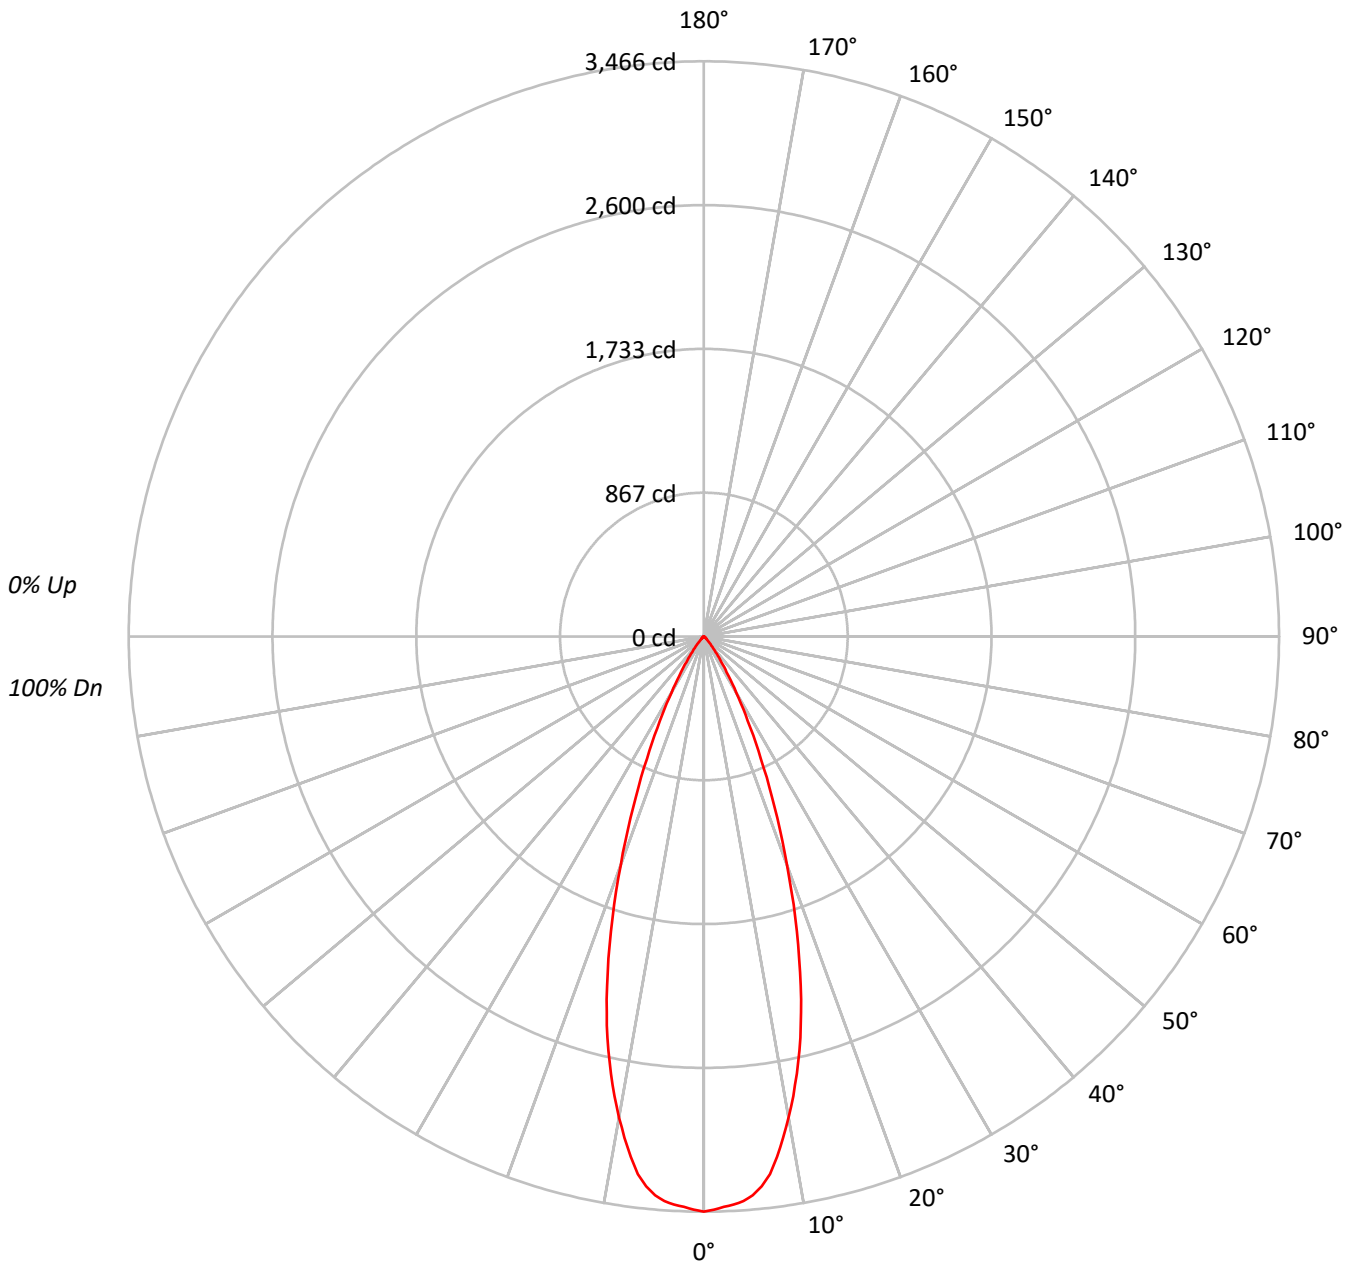



TEST NUMBER: P224949

CATALOG NUMBER: LSSQWM2B15FL408040D010 2LBD\*H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95			95
2	110	106	103	100	108	104	101	99	101	99	97	98	96	94	96	94	93	91			91
3	106	100	96	93	104	99	95	92	97	94	91	94	92	90	92	90	88	87			87
4	102	96	91	88	100	94	90	87	92	89	86	91	88	85	89	86	84	83			83
5	98	91	86	83	96	90	86	82	89	85	82	87	84	81	86	83	80	79			79
6	94	87	82	79	93	86	82	78	85	81	78	84	80	77	82	79	77	76			76
7	91	83	78	75	90	83	78	75	82	77	74	80	77	74	79	76	74	73			73
8	88	80	75	72	87	79	75	72	78	74	71	77	74	71	77	73	71	70			70
9	85	77	72	69	84	76	72	69	75	71	68	75	71	68	74	70	68	67			67
10	82	74	69	66	81	73	69	66	73	69	66	72	68	66	71	68	65	64			64

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1342502
5°	1314425
10°	1157624
15°	908208
20°	603138
25°	346228
30°	173630
35°	80197
40°	32614
45°	14571
50°	7593
55°	4727
60°	2169
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P224949

CATALOG NUMBER: LSSQWM2B15FL408040D010 2LBD\*H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	308.7	21.3
10°-20°	613.0	42.4
20°-30°	380.9	26.3
30°-40°	114.9	7.9
40°-50°	23.5	1.6
50°-60°	6.0	0.4
60°-70°	0.3	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1302.6	90.0
0°-40°	1417.5	97.9
0°-60°	1447.0	100.0
0°-90°	1447.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1447.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3466	
5°	3380	309
15°	2265	613
25°	810	381
35°	170	115
45°	27	23
55°	7	6
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P224949

CATALOG NUMBER: LSSQWM2B15FL408040D010 2LBD\*H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3465.9
1°	3454.7
2°	3439.3
3°	3428.1
4°	3411.3
5°	3380.5
6°	3331.4
7°	3264.1
8°	3167.4
9°	3058.1
10°	2943.2
11°	2821.2
12°	2693.7
13°	2560.6
14°	2414.8
15°	2264.8
17.5°	1862.6
20°	1463.2
22.5°	1110.0
25°	810.1
27.5°	571.8
30°	388.2
32.5°	255.1
35°	169.6
37.5°	105.1
40°	64.5
42.5°	42.0
45°	26.6
47.5°	16.8
50°	12.6
52.5°	8.4
55°	7.0
57.5°	4.2
60°	2.8
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P224949

CATALOG NUMBER: LSSQWM2B15FL408040D010 2LBD\*H

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)