

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LSSQWM2B15WFL558040D010 2LBD\*H**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P29157)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQWM2B15WFL558040D010 2LBD\*H  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
WIDE FLOOD OPTIC  
SPUN ROUND TRIM WITH HAZE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1372.0 lumens  
Efficiency: N/A  
Efficacy: 95.9 lumens/watt  
Spacing Criteria (0/90/45): 0.77 / 0.77 / 0.82  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#  
CATALOG NUMBER: LSSQWM2B15WFL558040D010 2LBD\*H

### Luminous Intensity Polar Plot

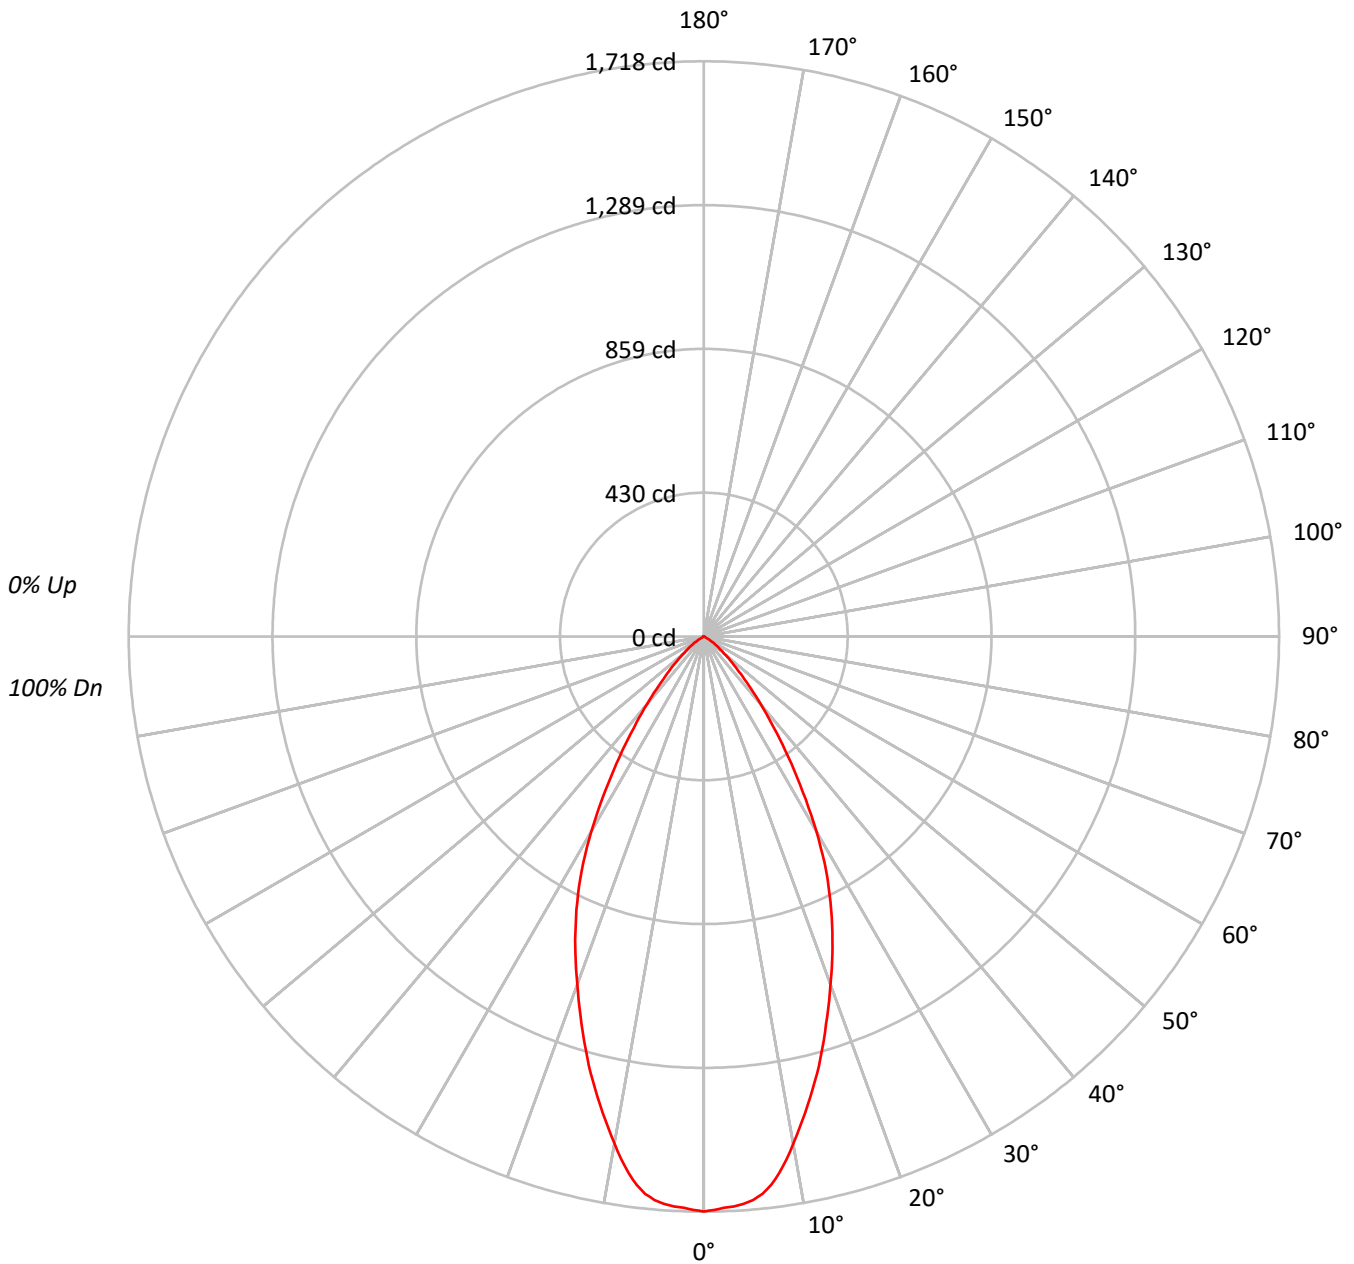



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558040D010 2LBD\*H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	105	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	86	100	94	90	86	92	88	84	89	86	83	87	84	82	80			
4	97	89	83	79	95	88	83	79	86	81	78	84	80	77	82	79	76	74			
5	92	83	77	73	90	82	77	73	81	76	72	79	75	71	77	74	71	69			
6	87	78	72	68	86	77	71	67	76	71	67	74	70	66	73	69	66	64			
7	83	73	67	63	81	73	67	63	71	66	62	70	65	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	56			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	62	56	52	70	61	55	52	60	55	52	59	55	51	59	54	51	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	665305
5°	656960
10°	604968
15°	532461
20°	456022
25°	384736
30°	300386
35°	207539
40°	133288
45°	81402
50°	48148
55°	27485
60°	8677
65°	1283
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558040D010 2LBD\*H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	156.5	11.4
10°-20°	369.0	26.9
20°-30°	409.0	29.8
30°-40°	277.6	20.2
40°-50°	119.8	8.7
50°-60°	37.6	2.7
60°-70°	2.4	0.2
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	934.5	68.1
0°-40°	1212.1	88.3
0°-60°	1369.6	99.8
0°-90°	1372.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1372.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1718	
5°	1690	157
15°	1328	369
25°	900	409
35°	439	278
45°	149	120
55°	41	38
65°	1	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558040D010 2LBD\*H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1717.6
1°	1713.4
2°	1707.8
3°	1705.0
4°	1699.4
5°	1689.6
6°	1674.1
7°	1650.3
8°	1618.1
9°	1580.2
10°	1538.1
11°	1496.1
12°	1454.0
13°	1411.9
14°	1369.9
15°	1327.8
17.5°	1214.2
20°	1106.3
22.5°	1003.9
25°	900.2
27.5°	792.2
30°	671.6
32.5°	549.6
35°	438.9
37.5°	343.5
40°	263.6
42.5°	199.1
45°	148.6
47.5°	109.4
50°	79.9
52.5°	57.5
55°	40.7
57.5°	26.6
60°	11.2
62.5°	2.8
65°	1.4
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558040D010 2LBD\*H

CANDELA DISTRIBUTION (continued):

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)