

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P225464

Luminaire Tested: **LSSQWM2B15FL409040D010 2LBDLC\*MB**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P225464  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14833)  
Test Lab: INNOVATION CENTER (G1)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQWM2B15FL409040D010 2LBDLC\*MB  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
FLOOD OPTIC  
LENSED CAST ROUND TRIM WITH MATTE BLACK FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1079.3 lumens  
Efficiency: N/A  
Efficacy: 75.5 lumens/watt  
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.6  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P225464

CATALOG NUMBER: LSSQWM2B15FL409040D010 2LBDLC\*MB

### Luminous Intensity Polar Plot

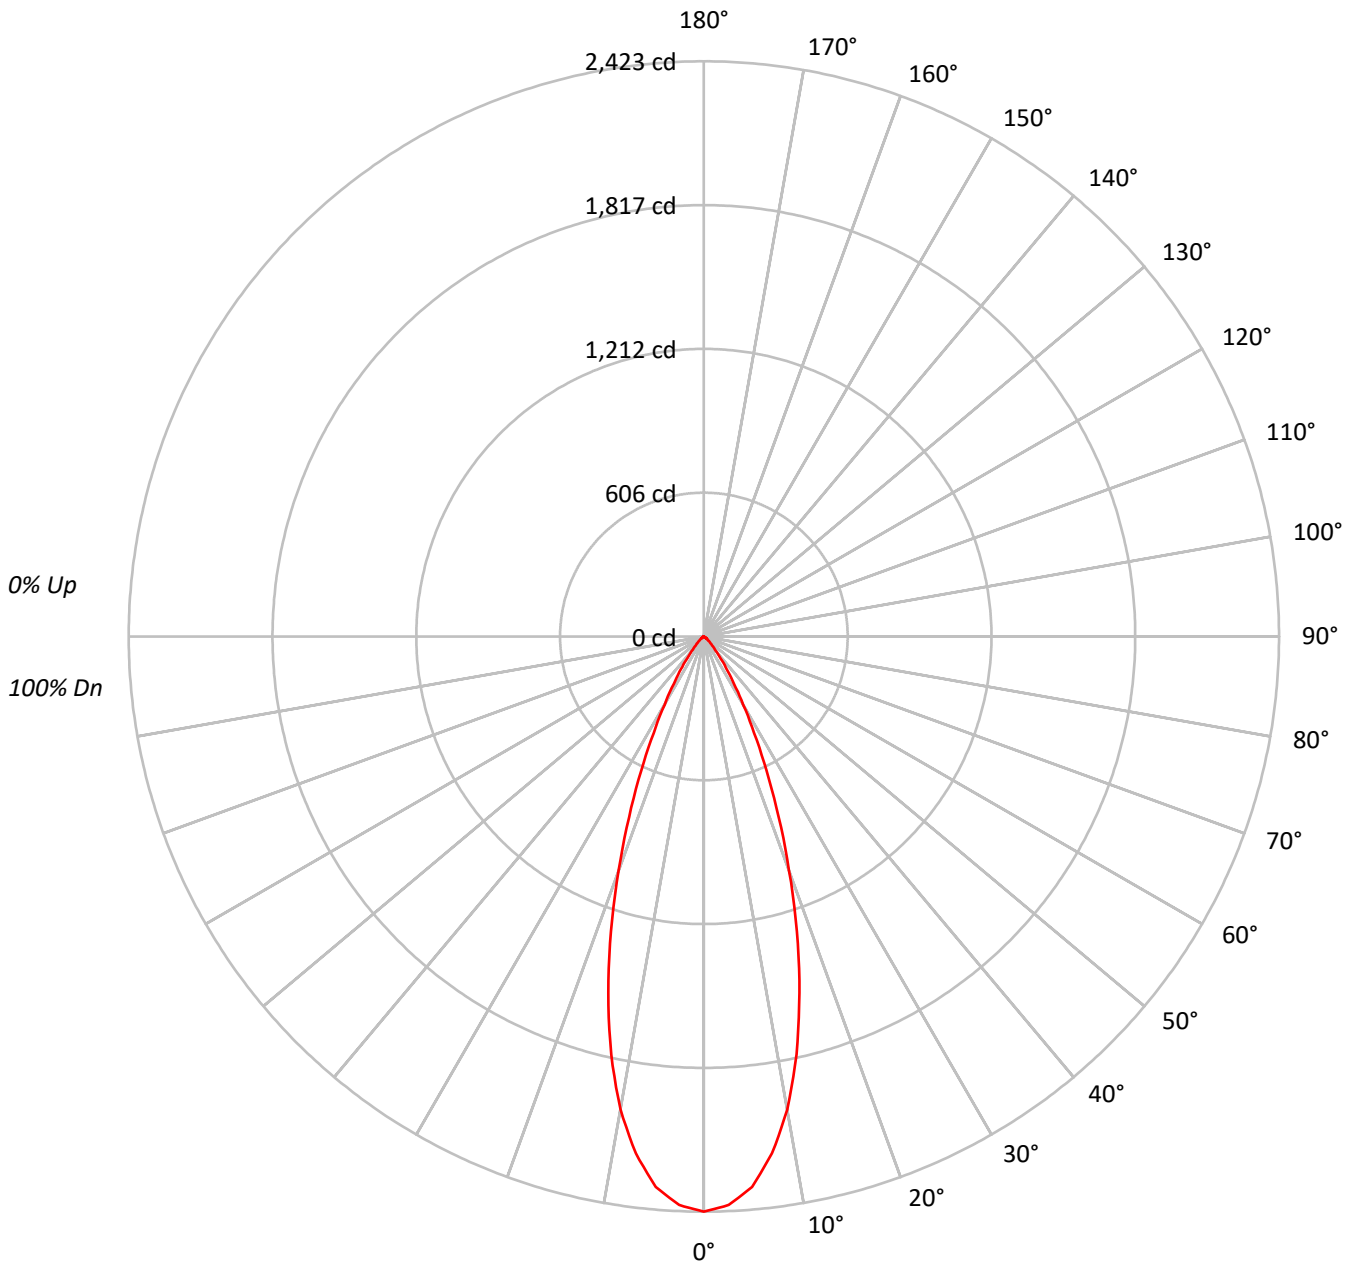



TEST NUMBER: P225464

CATALOG NUMBER: LSSQWM2B15FL409040D010 2LBDLC\*MB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95				95
2	110	105	102	99	107	104	101	98	101	98	96	98	96	94	95	93	92	90				90
3	105	100	95	92	103	98	94	91	96	92	90	93	91	88	91	89	87	86				86
4	101	94	90	86	99	93	89	86	91	87	85	89	86	84	88	85	83	81				81
5	97	90	85	81	95	89	84	81	87	83	80	85	82	79	84	81	79	77				77
6	93	85	80	77	92	85	80	76	83	79	76	82	78	75	81	77	75	74				74
7	89	81	76	73	88	81	76	73	80	75	72	79	75	72	78	74	72	70				70
8	86	78	73	69	85	77	73	69	76	72	69	75	72	69	75	71	68	67				67
9	83	75	70	66	82	74	69	66	73	69	66	72	69	66	72	68	65	64				64
10	80	72	67	63	79	71	66	63	70	66	63	70	66	63	69	65	63	62				62

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	938501
5°	904875
10°	795847
15°	623771
20°	432073
25°	266178
30°	148135
35°	79015
40°	39187
45°	19994
50°	10967
55°	7158
60°	3564
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P225464

CATALOG NUMBER: LSSQWM2B15FL409040D010 2LBDLC\*MB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	212.3	19.7
10°-20°	424.9	39.4
20°-30°	290.3	26.9
30°-40°	110.7	10.3
40°-50°	30.7	2.8
50°-60°	9.6	0.9
60°-70°	0.9	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	927.4	85.9
0°-40°	1038.1	96.2
0°-60°	1078.4	99.9
0°-90°	1079.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1079.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2423	
5°	2327	212
15°	1556	425
25°	623	290
35°	167	111
45°	36	31
55°	11	10
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P225464

CATALOG NUMBER: LSSQWM2B15FL409040D010 2LBDLC\*MB

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2422.9
2.5°	2397.1
5°	2327.2
7.5°	2196.6
10°	2023.4
12.5°	1803.2
15°	1555.5
17.5°	1301.9
20°	1048.2
22.5°	823.3
25°	622.8
27.5°	457.2
30°	331.2
32.5°	235.5
35°	167.1
37.5°	117.0
40°	77.5
42.5°	51.6
45°	36.5
47.5°	25.8
50°	18.2
52.5°	13.7
55°	10.6
57.5°	7.6
60°	4.6
62.5°	1.5
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)