

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LSR2B15WFL558050D010 2LBD\*B**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14809)  
Test Lab: INNOVATION CENTER (G1)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR2B15WFL558050D010 2LBD\*B  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
WIDE FLOOD OPTIC  
SPUN ROUND TRIM WITH BLACK FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1357.7 lumens  
Efficiency: N/A  
Efficacy: 94.9 lumens/watt  
Spacing Criteria (0/90/45): 0.79 / 0.79 / 0.84  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#  
CATALOG NUMBER: LSR2B15WFL558050D010 2LBD\*B

### Luminous Intensity Polar Plot

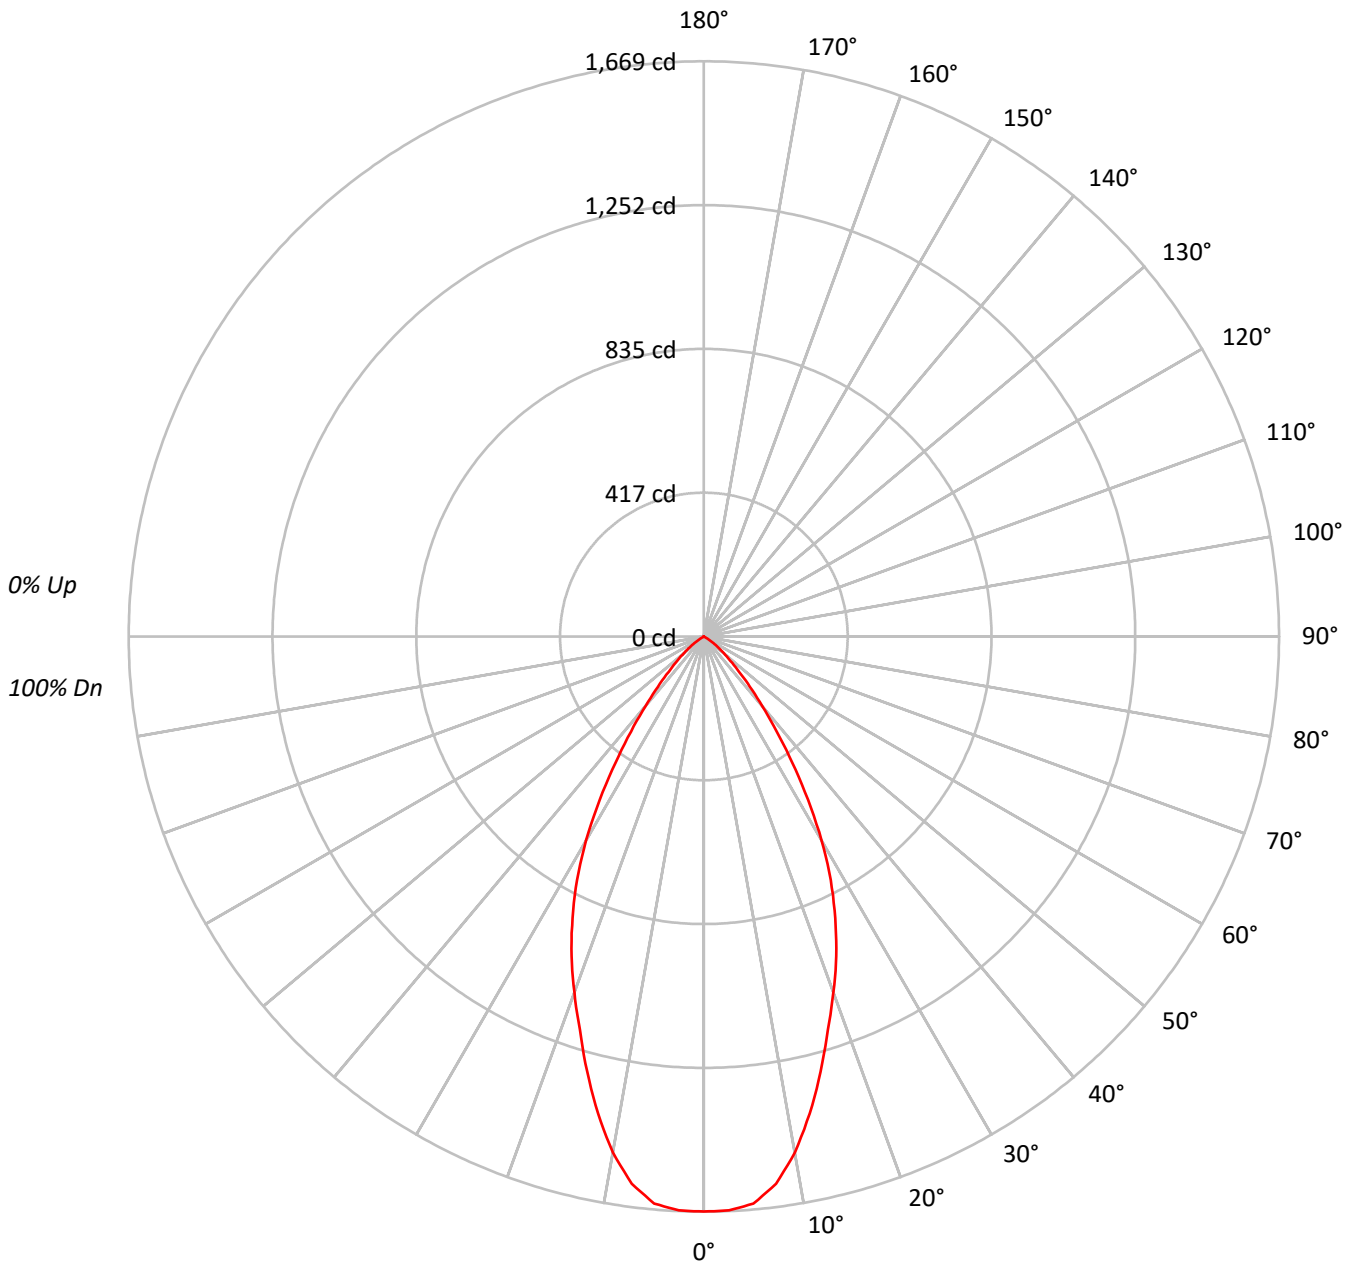



TEST NUMBER: P#

CATALOG NUMBER: LSR2B15WFL558050D010 2LBD\*B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93																			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87																			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80																			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75																			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69																			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65																			
7	83	73	67	63	81	73	67	63	71	66	63	70	66	62	69	65	62	60																			
8	79	69	63	59	78	69	63	59	67	62	59	66	62	58	65	61	58	57																			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53																			
10	71	62	56	52	70	61	56	52	60	55	52	60	55	52	59	55	51	50																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	646326
5°	642184
10°	598085
15°	524521
20°	453055
25°	385377
30°	305663
35°	210944
40°	132479
45°	79046
50°	45738
55°	23096
60°	1472
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P#

CATALOG NUMBER: LSR2B15WFL558050D010 2LBD\*B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	153.4	11.3
10°-20°	364.6	26.9
20°-30°	410.3	30.2
30°-40°	281.9	20.8
40°-50°	117.1	8.6
50°-60°	30.2	2.2
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	928.3	68.4
0°-40°	1210.2	89.1
0°-60°	1357.5	100.0
0°-90°	1357.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1357.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1669	
5°	1652	153
15°	1308	365
25°	902	410
35°	446	282
45°	144	117
55°	34	30
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P#

CATALOG NUMBER: LSR2B15WFL558050D010 2LBD\*B

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1668.6
2.5°	1666.7
5°	1651.6
7.5°	1602.2
10°	1520.6
12.5°	1418.1
15°	1308.0
17.5°	1196.0
20°	1099.1
22.5°	1004.2
25°	901.7
27.5°	797.3
30°	683.4
32.5°	561.9
35°	446.1
37.5°	347.4
40°	262.0
42.5°	197.4
45°	144.3
47.5°	104.4
50°	75.9
52.5°	53.2
55°	34.2
57.5°	11.4
60°	1.9
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)