

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LSSQWM2B15WFL558050D010 2LBDL\*LI**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P29153)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQWM2B15WFL558050D010 2LBDL\*LI  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
WIDE FLOOD OPTIC  
LENSED SPUN ROUND TRIM WITH LI FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1266.1 lumens  
Efficiency: N/A  
Efficacy: 88.5 lumens/watt  
Spacing Criteria (0/90/45): 0.73 / 0.73 / 0.8  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#  
CATALOG NUMBER: LSSQWM2B15WFL558050D010 2LBDL\*LI

### Luminous Intensity Polar Plot

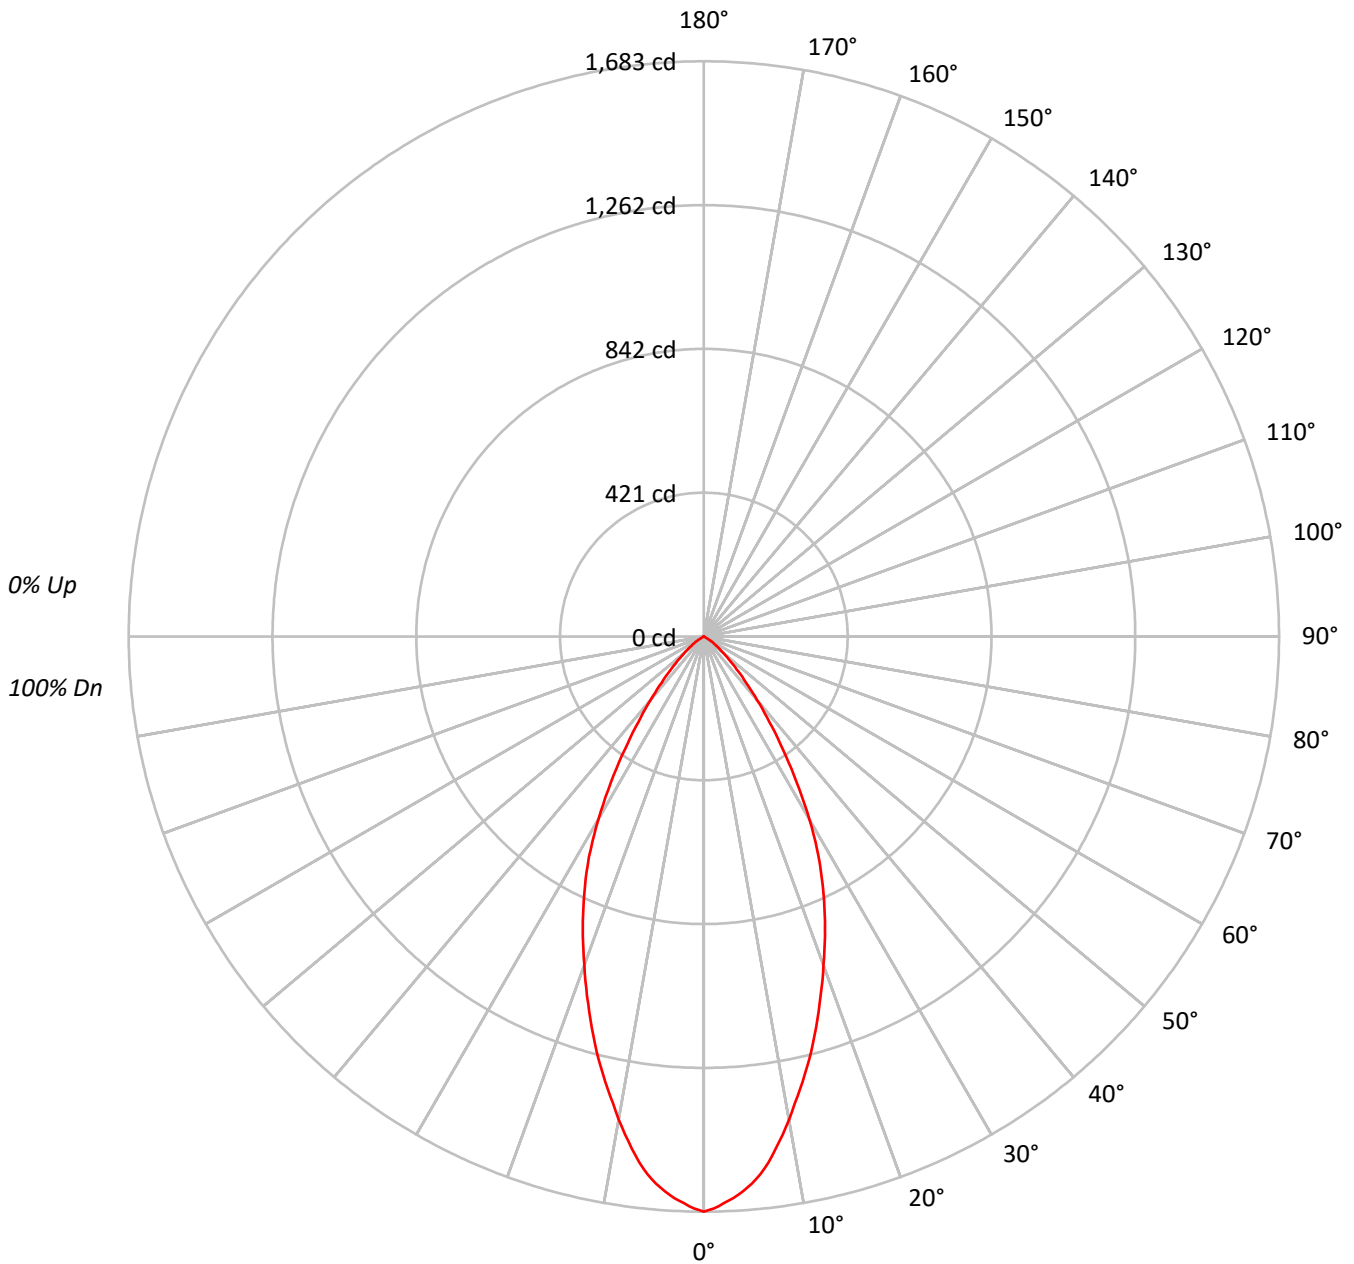



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558050D010 2LBDL\*LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	81	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	82	73	67	63	72	66	63	70	66	62	69	65	62	61			
8	79	69	63	59	78	69	63	59	68	62	59	66	62	58	66	61	58	57			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	651981
5°	624959
10°	564416
15°	494486
20°	421892
25°	353921
30°	276054
35°	190327
40°	122214
45°	73952
50°	43387
55°	24311
60°	6972
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558050D010 2LBDL\*LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	147.9	11.7
10°-20°	342.7	27.1
20°-30°	376.7	29.7
30°-40°	254.9	20.1
40°-50°	109.2	8.6
50°-60°	33.3	2.6
60°-70°	1.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	867.2	68.5
0°-40°	1122.1	88.6
0°-60°	1264.7	99.9
0°-90°	1266.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1266.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1683	
5°	1607	148
15°	1233	343
25°	828	377
35°	402	255
45°	135	109
55°	36	33
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558050D010 2LBDL\*LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1683.2
1°	1674.2
2°	1660.0
3°	1645.9
4°	1627.9
5°	1607.3
6°	1581.6
7°	1550.7
8°	1513.4
9°	1474.9
10°	1435.0
11°	1392.6
12°	1354.0
13°	1314.1
14°	1274.3
15°	1233.1
17.5°	1126.4
20°	1023.5
22.5°	925.8
25°	828.1
27.5°	727.8
30°	617.2
32.5°	505.3
35°	402.5
37.5°	315.0
40°	241.7
42.5°	182.6
45°	135.0
47.5°	99.0
50°	72.0
52.5°	51.4
55°	36.0
57.5°	23.1
60°	9.0
62.5°	1.3
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15WFL558050D010 2LBDL\*LI

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)