

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LSSQ2B15WFL559050D010 2LBDL*LI**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P#
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P29153)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LSSQ2B15WFL559050D010 2LBDL*LI
Description: 1500 Lumen, 2inch Portfolio LED Cylinder
WIDE FLOOD OPTIC
LENSED SPUN ROUND TRIM WITH LI FINISH
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1065.0 lumens
Efficiency: N/A
Efficacy: 74.5 lumens/watt
Spacing Criteria (0/90/45): 0.73 / 0.73 / 0.8
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P#
CATALOG NUMBER: LSSQ2B15WFL559050D010 2LBDL*LI

Luminous Intensity Polar Plot

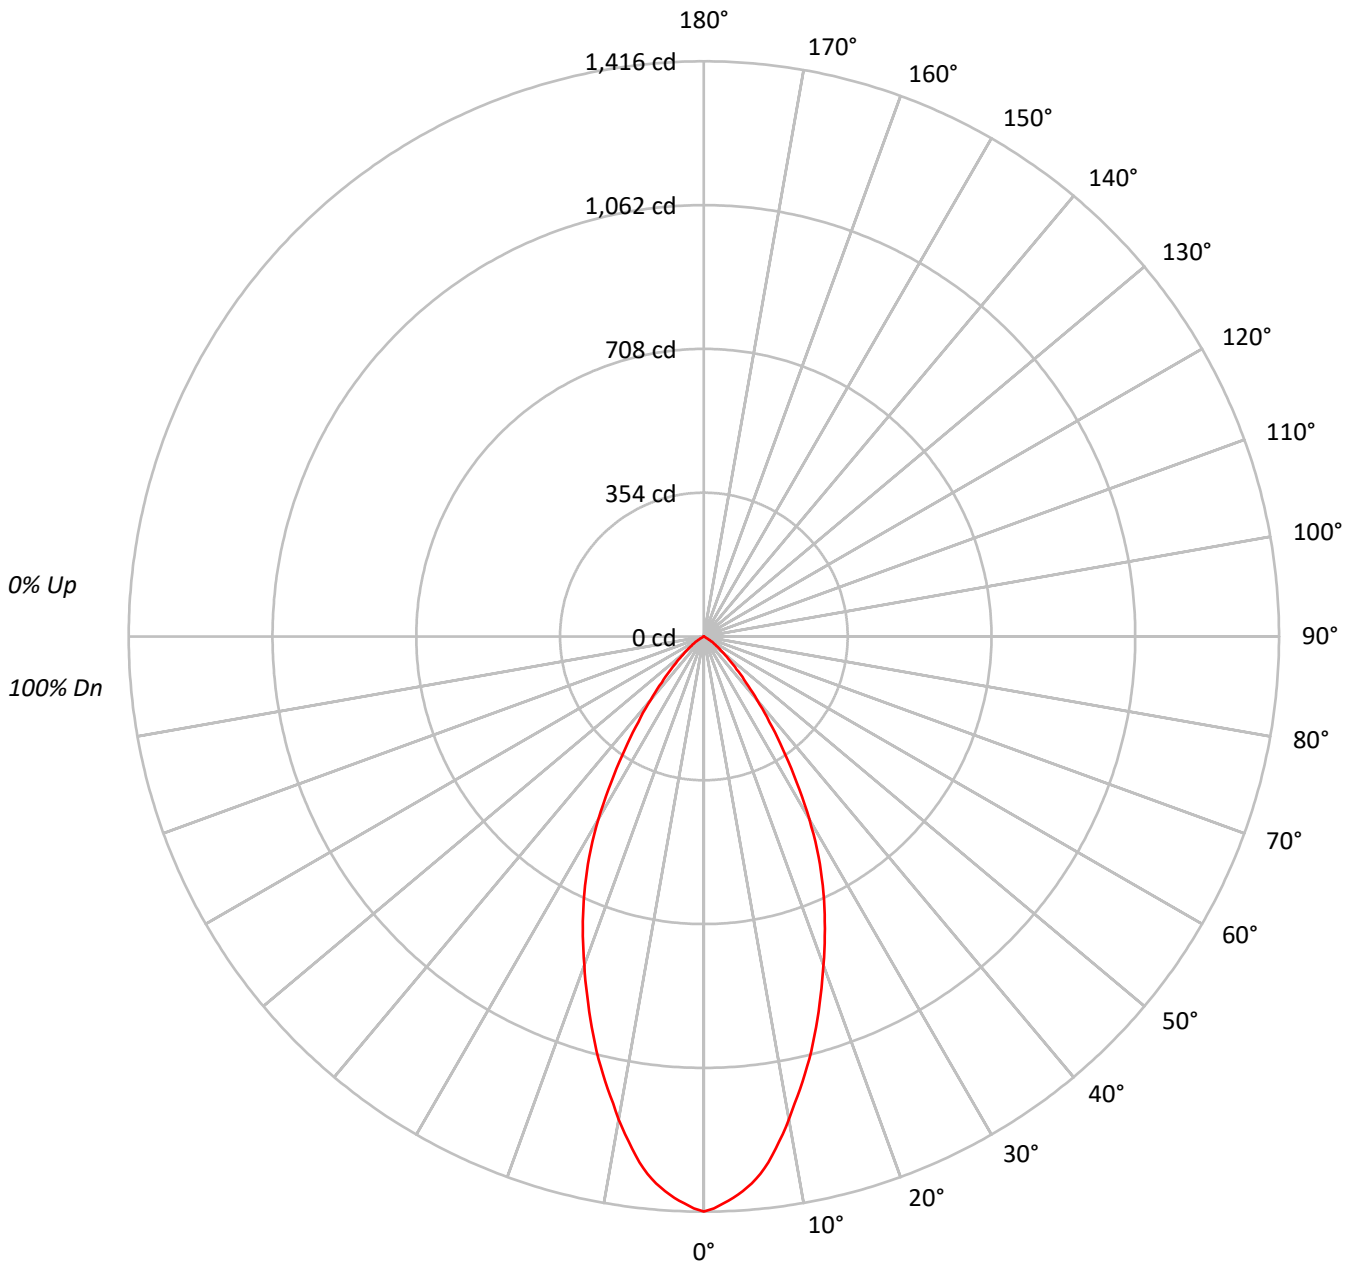



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B15WFL559050D010 2LBDL*LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | |
| 1 | 113 | 111 | 108 | 106 | 111 | 109 | 106 | 104 | 104 | 103 | 101 | 101 | 99 | 98 | 97 | 96 | 95 | 93 | | | |
| 2 | 108 | 103 | 99 | 95 | 106 | 101 | 97 | 94 | 98 | 95 | 92 | 95 | 92 | 90 | 92 | 90 | 88 | 87 | | | |
| 3 | 102 | 96 | 91 | 87 | 100 | 94 | 90 | 86 | 92 | 88 | 85 | 89 | 86 | 83 | 87 | 84 | 82 | 80 | | | |
| 4 | 97 | 89 | 84 | 79 | 95 | 88 | 83 | 79 | 86 | 81 | 78 | 84 | 80 | 77 | 82 | 79 | 76 | 75 | | | |
| 5 | 92 | 83 | 78 | 73 | 90 | 83 | 77 | 73 | 81 | 76 | 72 | 79 | 75 | 72 | 77 | 74 | 71 | 69 | | | |
| 6 | 87 | 78 | 72 | 68 | 86 | 77 | 72 | 68 | 76 | 71 | 67 | 74 | 70 | 67 | 73 | 69 | 66 | 65 | | | |
| 7 | 83 | 73 | 67 | 63 | 82 | 73 | 67 | 63 | 72 | 66 | 63 | 70 | 66 | 62 | 69 | 65 | 62 | 61 | | | |
| 8 | 79 | 69 | 63 | 59 | 78 | 69 | 63 | 59 | 68 | 62 | 59 | 66 | 62 | 58 | 66 | 61 | 58 | 57 | | | |
| 9 | 75 | 65 | 59 | 55 | 74 | 65 | 59 | 55 | 64 | 59 | 55 | 63 | 58 | 55 | 62 | 58 | 55 | 53 | | | |
| 10 | 72 | 62 | 56 | 52 | 71 | 61 | 56 | 52 | 61 | 55 | 52 | 60 | 55 | 52 | 59 | 55 | 52 | 50 | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 548366 |
| 5° | 525653 |
| 10° | 474739 |
| 15° | 415928 |
| 20° | 354867 |
| 25° | 297676 |
| 30° | 232177 |
| 35° | 160064 |
| 40° | 102797 |
| 45° | 62229 |
| 50° | 36518 |
| 55° | 20462 |
| 60° | 5888 |
| 65° | 0 |
| 70° | 0 |
| 75° | 0 |
| 80° | 0 |
| 85° | 0 |



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B15WFL559050D010 2LBDL*LI

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 124.4 | 11.7 |
| 10°-20° | 288.3 | 27.1 |
| 20°-30° | 316.8 | 29.7 |
| 30°-40° | 214.4 | 20.1 |
| 40°-50° | 91.9 | 8.6 |
| 50°-60° | 28.1 | 2.6 |
| 60°-70° | 1.2 | 0.1 |
| 70°-80° | 0.0 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 729.4 | 68.5 |
| 0°-40° | 943.8 | 88.6 |
| 0°-60° | 1063.8 | 99.9 |
| 0°-90° | 1065.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1065.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1416 | |
| 5° | 1352 | 124 |
| 15° | 1037 | 288 |
| 25° | 696 | 317 |
| 35° | 338 | 214 |
| 45° | 114 | 92 |
| 55° | 30 | 28 |
| 65° | 0 | 1 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B15WFL559050D010 2LBDL*LI

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 1415.7 |
| 1° | 1408.1 |
| 2° | 1396.2 |
| 3° | 1384.3 |
| 4° | 1369.2 |
| 5° | 1351.9 |
| 6° | 1330.2 |
| 7° | 1304.3 |
| 8° | 1272.9 |
| 9° | 1240.5 |
| 10° | 1207.0 |
| 11° | 1171.3 |
| 12° | 1138.8 |
| 13° | 1105.3 |
| 14° | 1071.8 |
| 15° | 1037.2 |
| 17.5° | 947.4 |
| 20° | 860.9 |
| 22.5° | 778.7 |
| 25° | 696.5 |
| 27.5° | 612.1 |
| 30° | 519.1 |
| 32.5° | 425.0 |
| 35° | 338.5 |
| 37.5° | 265.0 |
| 40° | 203.3 |
| 42.5° | 153.6 |
| 45° | 113.6 |
| 47.5° | 83.3 |
| 50° | 60.6 |
| 52.5° | 43.3 |
| 55° | 30.3 |
| 57.5° | 19.5 |
| 60° | 7.6 |
| 62.5° | 1.1 |
| 65° | 0.0 |
| 67.5° | 0.0 |
| 70° | 0.0 |
| 72.5° | 0.0 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |



TEST NUMBER: P#

CATALOG NUMBER: LSSQ2B15WFL559050D010 2LBDL*LI

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







| | | |
|-------|--|-----|
| 85° | | 0.0 |
| 87.5° | | 0.0 |



(END OF REPORT)