

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P224920

Luminaire Tested: **LSR2B15FL409030D2WD010 2LBD\*H**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P224920  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (156)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR2B15FL409030D2WD010 2LBD\*H  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
FLOOD OPTIC  
SPUN ROUND TRIM WITH HAZE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 821.2 lumens  
Efficiency: N/A  
Efficacy: 57.4 lumens/watt  
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.59  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P224920

CATALOG NUMBER: LSR2B15FL409030D2WD010 2LBD\*H

### Luminous Intensity Polar Plot

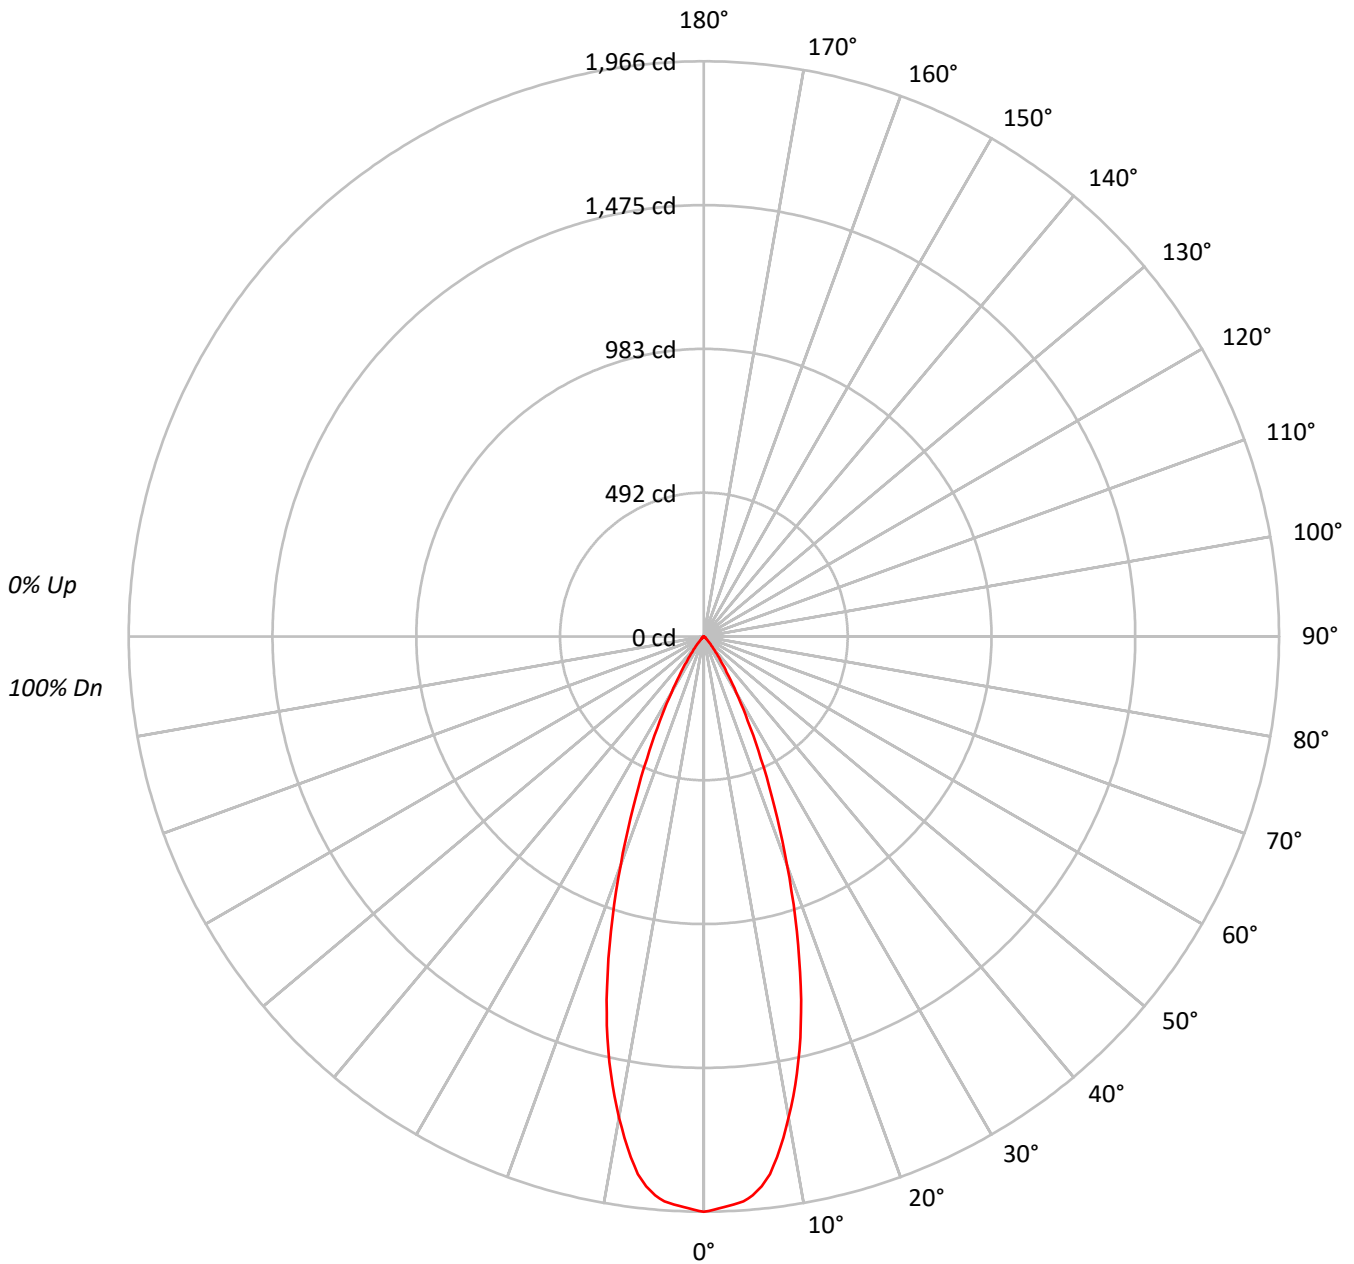



TEST NUMBER: P224920

CATALOG NUMBER: LSR2B15FL409030D2WD010 2LBD\*H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95				95
2	110	106	103	100	108	104	101	99	101	99	97	98	96	94	96	94	93	91				91
3	106	100	96	93	104	99	95	92	97	94	91	94	92	90	92	90	88	87				87
4	102	96	91	88	100	94	90	87	92	89	86	91	88	85	89	86	84	83				83
5	98	91	86	83	96	90	86	82	89	85	82	87	84	81	86	83	80	79				79
6	94	87	82	79	93	86	82	78	85	81	78	84	80	77	82	79	77	76				76
7	91	83	78	75	90	83	78	75	82	77	74	80	77	74	79	76	74	73				73
8	88	80	75	72	87	79	75	72	78	74	71	77	74	71	77	73	71	70				70
9	85	77	72	69	84	76	72	69	75	71	68	75	71	68	74	70	68	67				67
10	82	74	69	66	81	73	69	66	73	69	66	72	68	66	71	68	65	64				64

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	761677
5°	745729
10°	656768
15°	515298
20°	342171
25°	196428
30°	98533
35°	45489
40°	18507
45°	8272
50°	4339
55°	2701
60°	1240
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P224920

CATALOG NUMBER: LSR2B15FL409030D2WD010 2LBD\*H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	175.2	21.3
10°-20°	347.8	42.4
20°-30°	216.1	26.3
30°-40°	65.2	7.9
40°-50°	13.3	1.6
50°-60°	3.4	0.4
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	739.1	90.0
0°-40°	804.2	97.9
0°-60°	821.0	100.0
0°-90°	821.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	821.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1966	
5°	1918	175
15°	1285	348
25°	460	216
35°	96	65
45°	15	13
55°	4	3
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P224920

CATALOG NUMBER: LSR2B15FL409030D2WD010 2LBD\*H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1966.4
1°	1960.0
2°	1951.3
3°	1944.9
4°	1935.4
5°	1917.9
6°	1890.1
7°	1851.9
8°	1797.0
9°	1735.0
10°	1669.8
11°	1600.6
12°	1528.2
13°	1452.7
14°	1370.0
15°	1285.0
17.5°	1056.8
20°	830.1
22.5°	629.8
25°	459.6
27.5°	324.4
30°	220.3
32.5°	144.7
35°	96.2
37.5°	59.6
40°	36.6
42.5°	23.8
45°	15.1
47.5°	9.5
50°	7.2
52.5°	4.7
55°	4.0
57.5°	2.4
60°	1.6
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P224920

CATALOG NUMBER: LSR2B15FL409030D2WD010 2LBD\*H

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)