

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LSSQWM2B15FL409030D2WD010 2LBD\*LI**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P29152)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQWM2B15FL409030D2WD010 2LBD\*LI  
Description: 1500 Lumen, 2inch Portfolio LED Cylinder  
FLOOD OPTIC  
SPUN ROUND TRIM WITH LI FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 826.5 lumens  
Efficiency: N/A  
Efficacy: 57.8 lumens/watt  
Spacing Criteria (0/90/45): 0.59 / 0.59 / 0.58  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#  
CATALOG NUMBER: LSSQWM2B15FL409030D2WD010 2LBD\*LI

### Luminous Intensity Polar Plot

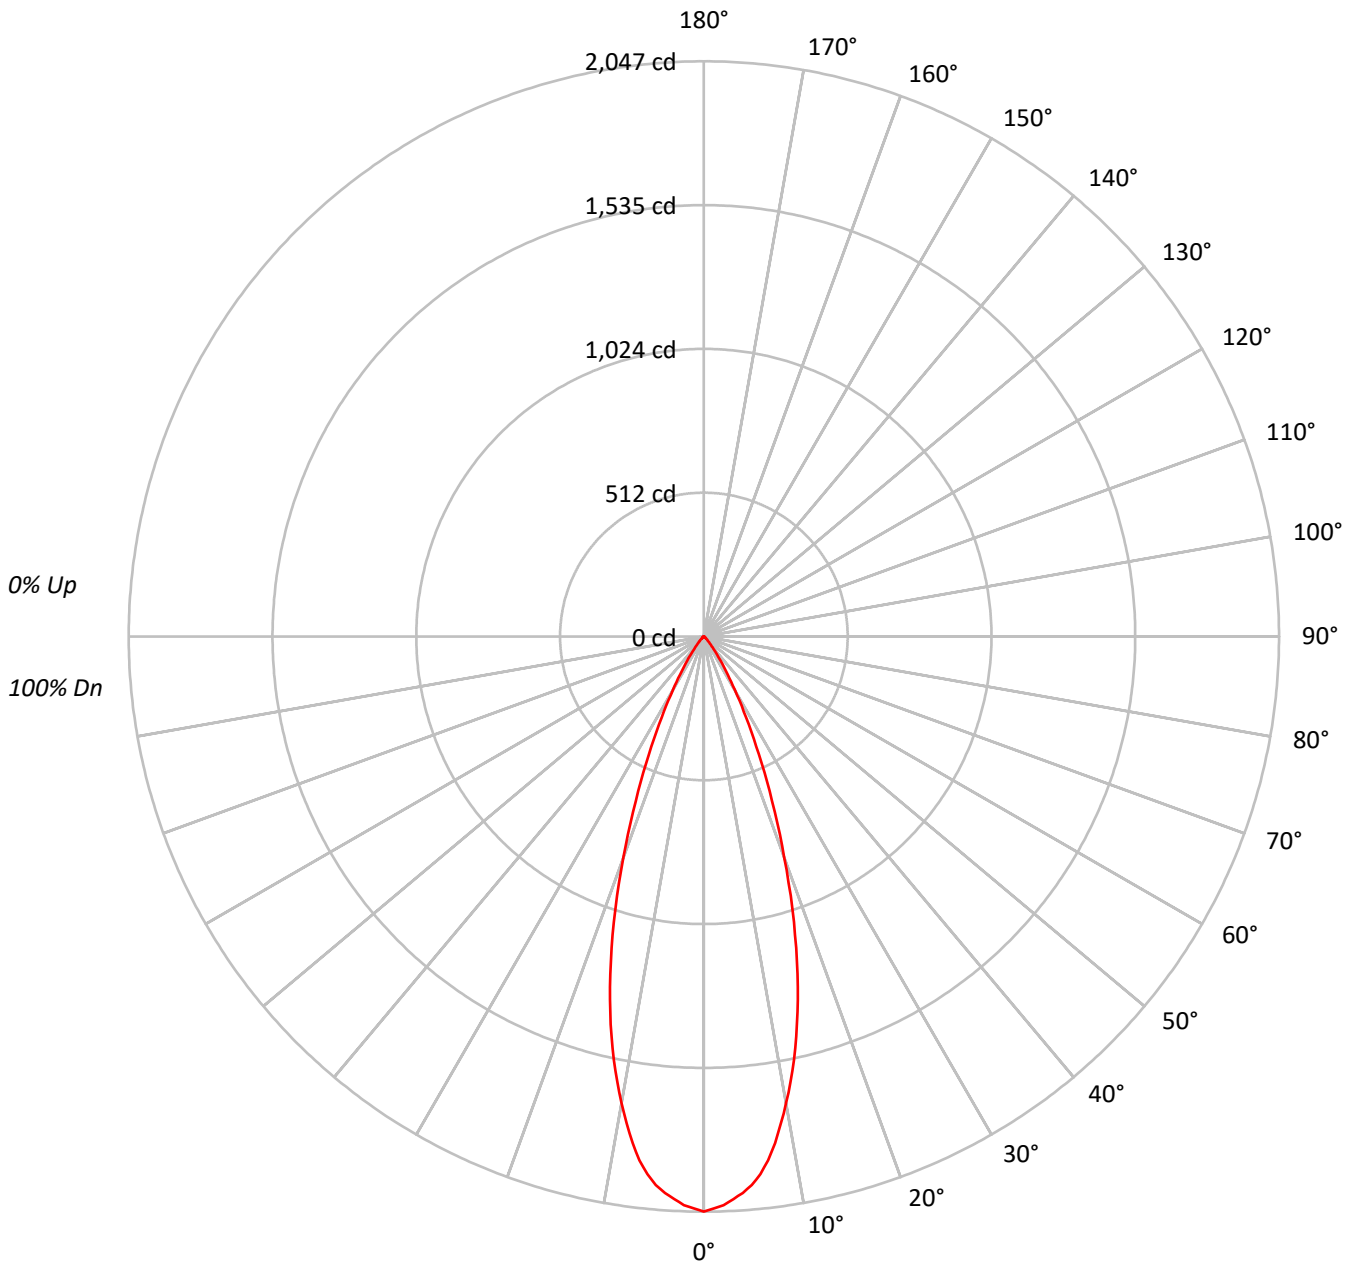



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15FL409030D2WD010 2LBD\*LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	105	103	102	101	100	99	98	97	96	96	96	96
2	110	106	103	100	108	104	101	99	101	99	97	98	96	95	96	94	93	91	91	91	91
3	106	101	96	93	104	99	95	92	97	94	91	94	92	90	92	90	88	87	87	87	87
4	102	96	91	88	100	95	90	87	93	89	86	91	88	85	89	86	84	83	83	83	83
5	98	91	86	83	97	90	86	83	89	85	82	87	84	81	86	83	81	79	79	79	79
6	94	87	82	79	93	86	82	79	85	81	78	84	80	78	83	79	77	76	76	76	76
7	91	83	79	75	90	83	78	75	82	78	75	81	77	74	80	76	74	73	73	73	73
8	88	80	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	70	70	70	70
9	85	77	72	69	84	76	72	69	76	71	69	75	71	68	74	71	68	67	67	67	67
10	82	74	69	66	81	74	69	66	73	69	66	72	68	66	72	68	66	65	65	65	65

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	792820
5°	761904
10°	663219
15°	517905
20°	344438
25°	197240
30°	98041
35°	45064
40°	18052
45°	8272
50°	3857
55°	2161
60°	1240
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15FL409030D2WD010 2LBD\*LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	178.3	21.6
10°-20°	350.2	42.4
20°-30°	216.7	26.2
30°-40°	64.9	7.8
40°-50°	13.0	1.6
50°-60°	3.2	0.4
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	745.3	90.2
0°-40°	810.2	98.0
0°-60°	826.3	100.0
0°-90°	826.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	826.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2047	
5°	1960	178
15°	1292	350
25°	462	217
35°	95	65
45°	15	13
55°	3	3
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15FL409030D2WD010 2LBD\*LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2046.8
1°	2035.7
2°	2025.4
3°	2004.7
4°	1985.7
5°	1959.5
6°	1923.7
7°	1878.5
8°	1820.4
9°	1754.5
10°	1686.2
11°	1615.6
12°	1540.1
13°	1461.4
14°	1377.2
15°	1291.5
17.5°	1065.1
20°	835.6
22.5°	632.3
25°	461.5
27.5°	324.1
30°	219.2
32.5°	144.6
35°	95.3
37.5°	59.6
40°	35.7
42.5°	23.0
45°	15.1
47.5°	9.5
50°	6.4
52.5°	4.7
55°	3.2
57.5°	2.4
60°	1.6
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P#

CATALOG NUMBER: LSSQWM2B15FL409030D2WD010 2LBD\*LI

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)