

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P222742

Luminaire Tested: **LSSQWM2B15NFL259030D2WD010 2LBDC*MB**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P222742
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (155)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LSSQWM2B15NFL259030D2WD010 2LBDC*MB
Description: 1500 Lumen, 2inch Portfolio LED Cylinder
NARROW FLOOD OPTIC
CAST ROUND TRIM WITH MATTE BLACK FINISH
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 805.3 lumens
Efficiency: N/A
Efficacy: 56.3 lumens/watt
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.35
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P222742

CATALOG NUMBER: LSSQWM2B15NFL259030D2WD010 2LBDC*MB

Luminous Intensity Polar Plot

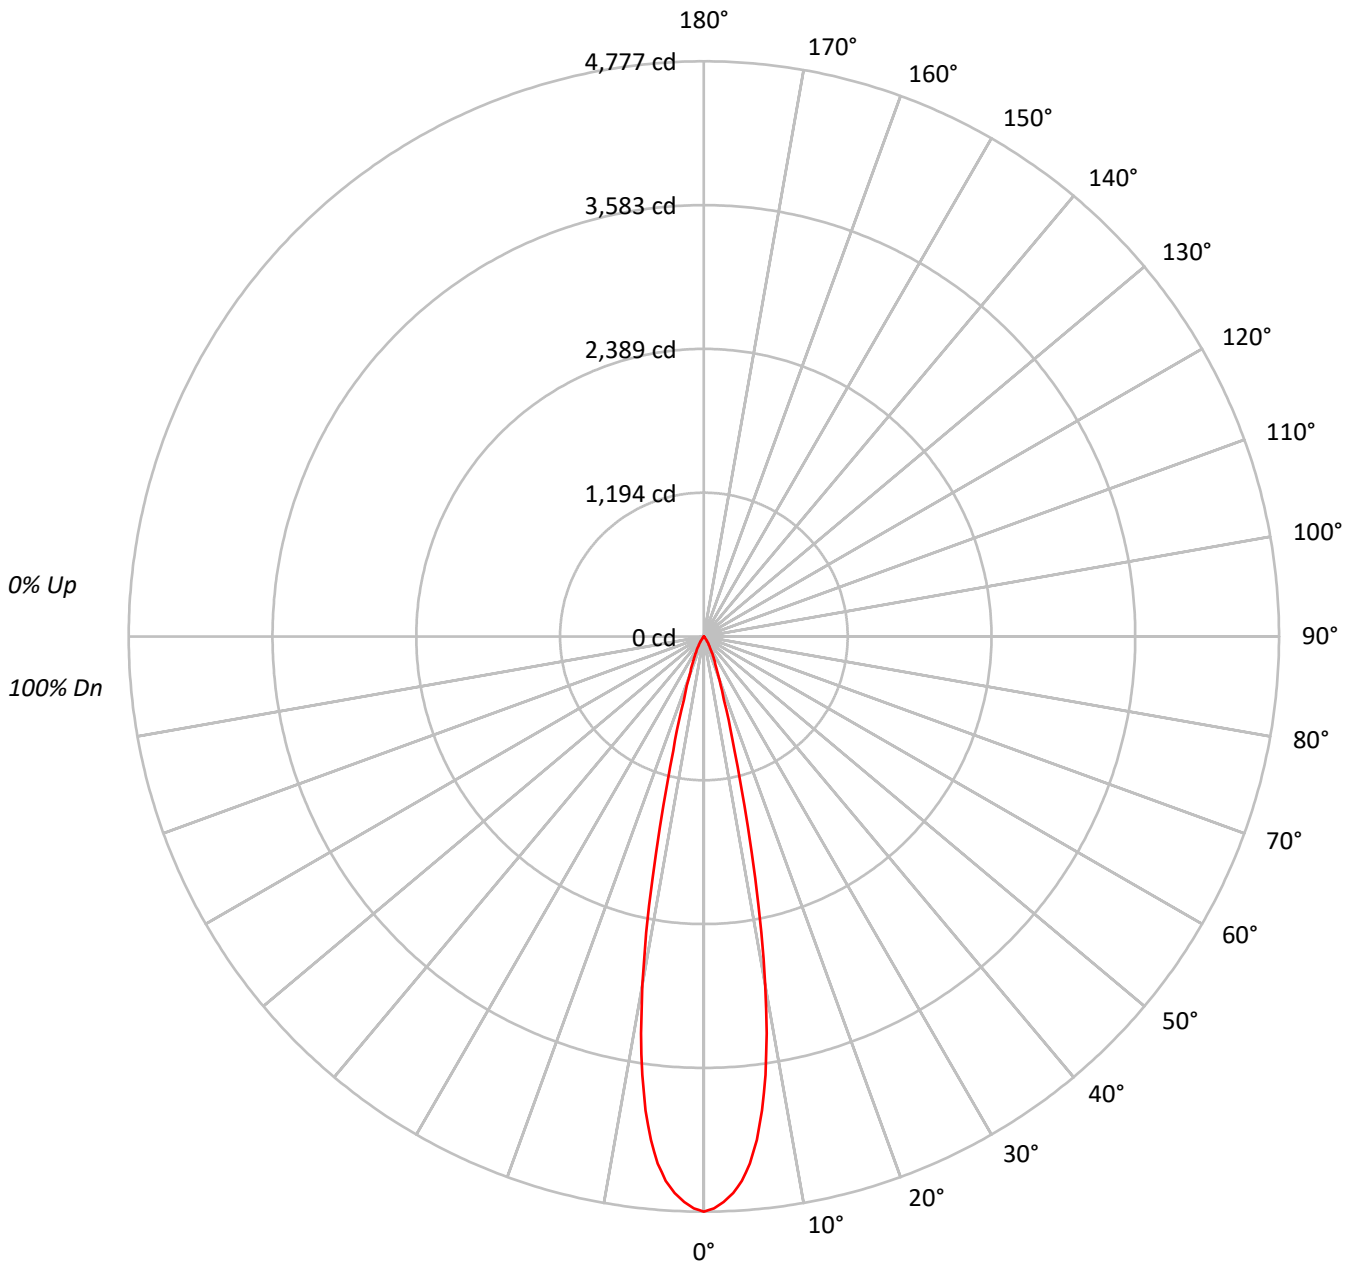



TEST NUMBER: P222742

CATALOG NUMBER: LSSQWM2B15NFL259030D2WD010 2LBDC*MB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	99	97
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97	97	96	95
2	112	109	106	104	110	107	104	102	104	102	100	101	99	98	98	97	96	95	95	94	92
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	96	95	93	92	92	91	90
4	106	101	97	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90	89	88	86
5	103	98	94	91	102	97	94	91	95	92	90	94	91	89	93	90	89	88	87	86	84
6	101	95	91	89	99	94	91	88	93	90	88	92	89	87	91	88	87	86	85	84	82
7	98	92	89	86	97	92	88	86	91	88	85	90	87	85	89	86	85	84	83	82	80
8	96	90	86	84	95	90	86	84	89	86	83	88	85	83	87	85	83	82	81	80	79
9	94	88	84	82	93	88	84	82	87	84	82	86	83	81	85	83	81	80	79	79	79
10	92	86	82	80	91	86	82	80	85	82	80	84	82	80	84	81	79	79	79	79	79

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1850468
5°	1708577
10°	1156483
15°	393431
20°	144519
25°	76631
30°	39404
35°	18347
40°	6017
45°	3013
50°	1446
55°	540
60°	620
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P222742

CATALOG NUMBER: LSSQWM2B15NFL259030D2WD010 2LBDC*MB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	373.8	46.4
10°-20°	314.3	39.0
20°-30°	86.3	10.7
30°-40°	25.1	3.1
40°-50°	4.6	0.6
50°-60°	1.1	0.1
60°-70°	0.1	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	774.3	96.2
0°-40°	799.5	99.3
0°-60°	805.2	100.0
0°-90°	805.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	805.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4777	
5°	4394	374
15°	981	314
25°	179	86
35°	39	25
45°	6	5
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P222742

CATALOG NUMBER: LSSQWM2B15NFL259030D2WD010 2LBDC*MB

CANDELA DISTRIBUTION (FULL):

	0°
0°	4777.3
1°	4749.6
2°	4700.4
3°	4629.8
4°	4533.0
5°	4394.2
6°	4204.6
7°	3967.5
8°	3678.0
9°	3336.1
10°	2940.3
11°	2506.4
12°	2055.1
13°	1624.4
14°	1257.2
15°	981.1
17.5°	553.6
20°	350.6
22.5°	249.9
25°	179.3
27.5°	126.9
30°	88.1
32.5°	61.9
35°	38.8
37.5°	15.8
40°	11.9
42.5°	8.7
45°	5.5
47.5°	3.2
50°	2.4
52.5°	1.6
55°	0.8
57.5°	0.8
60°	0.8
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P222742

CATALOG NUMBER: LSSQWM2B15NFL259030D2WD010 2LBDC*MB

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)