

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P222417

Luminaire Tested: **LSSQWM2B20NFL259050D010 2LBD*WMH**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P222417
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (155)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LSSQWM2B20NFL259050D010 2LBD*WMH
Description: 2000 Lumen, 2inch Portfolio LED Cylinder
NARROW FLOOD OPTIC
SPUN ROUND TRIM WITH WHEAT METALLIC HAZE FINISH
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1618.3 lumens
Efficiency: N/A
Efficacy: 77.4 lumens/watt
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.35
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 20.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P222417

CATALOG NUMBER: LSSQWM2B20NFL259050D010 2LBD*WMH

Luminous Intensity Polar Plot

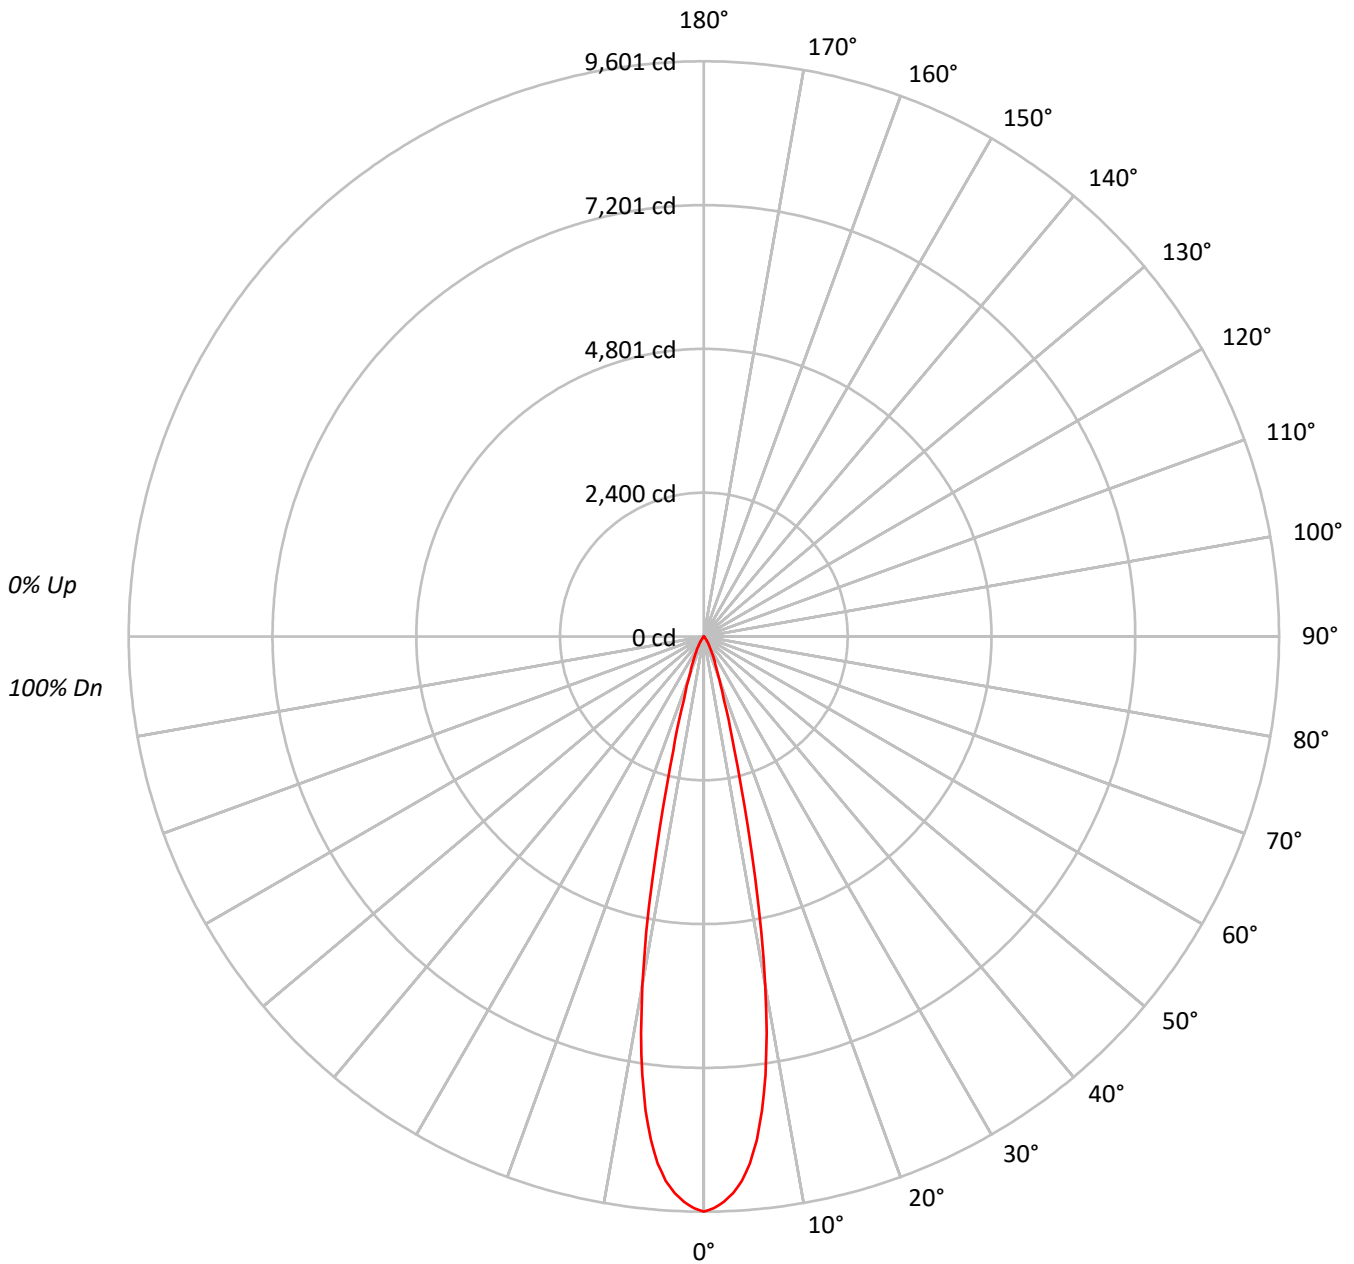



TEST NUMBER: P222417

CATALOG NUMBER: LSSQWM2B20NFL259050D010 2LBD*WMH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97	97	97	97
2	112	109	106	104	110	107	104	102	104	102	100	101	99	98	98	97	96	95	95	95	95
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	96	95	93	92	92	92	92
4	106	101	97	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90	90	90	90
5	103	98	94	91	102	97	94	91	95	92	90	94	91	89	93	90	89	88	88	88	88
6	101	95	91	89	99	94	91	88	93	90	88	92	89	87	91	88	87	86	86	86	86
7	98	92	89	86	97	92	88	86	91	88	85	90	87	85	89	86	85	84	84	84	84
8	96	90	86	84	95	90	86	84	89	86	83	88	85	83	87	85	83	82	82	82	82
9	94	88	84	82	93	88	84	82	87	84	82	86	83	81	85	83	81	80	80	80	80
10	92	86	82	80	91	86	82	80	85	82	80	84	82	80	84	81	79	79	79	79	79

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3718831
5°	3433680
10°	2324136
15°	790712
20°	290440
25°	153946
30°	79122
35°	36931
40°	12085
45°	6135
50°	2892
55°	1081
60°	1240
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P222417

CATALOG NUMBER: LSSQWM2B20NFL259050D010 2LBD*WMH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	751.2	46.4
10°-20°	631.6	39.0
20°-30°	173.3	10.7
30°-40°	50.5	3.1
40°-50°	9.4	0.6
50°-60°	2.1	0.1
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1556.1	96.2
0°-40°	1606.6	99.3
0°-60°	1618.1	100.0
0°-90°	1618.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1618.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9601	
5°	8831	751
15°	1972	632
25°	360	173
35°	78	51
45°	11	9
55°	2	2
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P222417

CATALOG NUMBER: LSSQWM2B20NFL259050D010 2LBD*WMH

CANDELA DISTRIBUTION (FULL):

	0°
0°	9600.8
1°	9545.0
2°	9446.1
3°	9304.3
4°	9109.8
5°	8830.9
6°	8449.9
7°	7973.3
8°	7391.5
9°	6704.4
10°	5909.0
11°	5037.1
12°	4130.1
13°	3264.5
14°	2526.5
15°	1971.8
17.5°	1112.6
20°	704.6
22.5°	502.1
25°	360.2
27.5°	255.0
30°	176.9
32.5°	124.3
35°	78.1
37.5°	31.9
40°	23.9
42.5°	17.5
45°	11.2
47.5°	6.4
50°	4.8
52.5°	3.2
55°	1.6
57.5°	1.6
60°	1.6
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P222417

CATALOG NUMBER: LSSQWM2B20NFL259050D010 2LBD*WMH

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)