

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P224939

Luminaire Tested: **LSR2B05FL409024D010 2LBD\*H**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P224939  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (156)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR2B05FL409024D010 2LBD\*H  
Description: 500 Lumen, 2inch Portfolio LED Cylinder  
FLOOD OPTIC  
SPUN ROUND TRIM WITH HAZE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 549.0 lumens  
Efficiency: N/A  
Efficacy: 75.2 lumens/watt  
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.59  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 7.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P224939

CATALOG NUMBER: LSR2B05FL409024D010 2LBD\*H

### Luminous Intensity Polar Plot

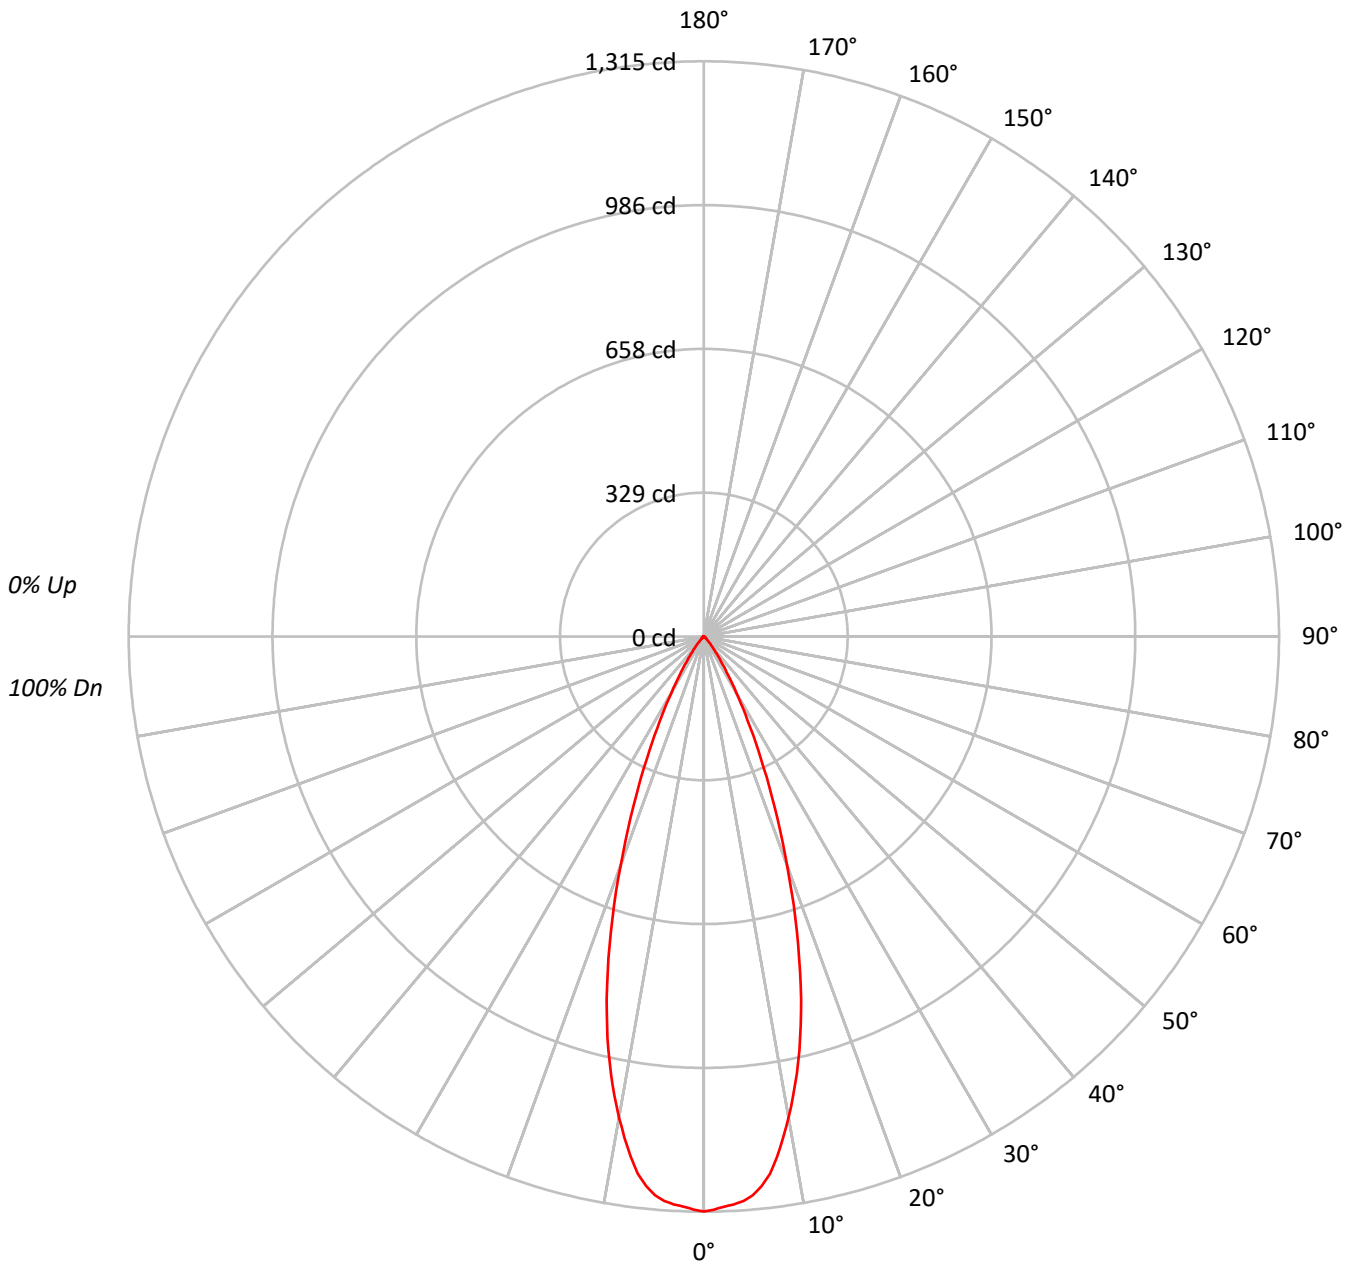



TEST NUMBER: P224939

CATALOG NUMBER: LSR2B05FL409024D010 2LBD\*H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95	95	95	95
2	110	106	103	100	108	104	101	99	101	99	97	98	96	94	96	94	93	91	91	91	91
3	106	100	96	93	104	99	95	92	97	94	91	94	92	90	92	90	88	87	87	87	87
4	102	96	91	88	100	94	90	87	92	89	86	91	88	85	89	86	84	83	83	83	83
5	98	91	86	83	96	90	86	82	89	85	82	87	84	81	86	83	80	79	79	79	79
6	94	87	82	79	93	86	82	78	85	81	78	84	80	77	82	79	77	76	76	76	76
7	91	83	78	75	90	83	78	75	82	77	74	80	77	74	79	76	74	73	73	73	73
8	88	80	75	72	87	79	75	72	78	74	71	77	74	71	77	73	71	70	70	70	70
9	85	77	72	69	84	76	72	69	75	71	68	75	71	68	74	70	68	67	67	67	67
10	82	74	69	66	81	73	69	66	73	69	66	72	68	66	71	68	65	64	64	64	64

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	509205
5°	498552
10°	439104
15°	344508
20°	228774
25°	131337
30°	65883
35°	30405
40°	12388
45°	5533
50°	2892
55°	1823
60°	852
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P224939

CATALOG NUMBER: LSR2B05FL409024D010 2LBD\*H

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	117.1	21.3
10°-20°	232.5	42.3
20°-30°	144.5	26.3
30°-40°	43.6	7.9
40°-50°	8.9	1.6
50°-60°	2.3	0.4
60°-70°	0.1	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	494.1	90.0
0°-40°	537.7	97.9
0°-60°	548.9	100.0
0°-90°	549.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	549.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1315	
5°	1282	117
15°	859	233
25°	307	144
35°	64	44
45°	10	9
55°	3	2
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P224939

CATALOG NUMBER: LSR2B05FL409024D010 2LBD\*H

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1314.6
1°	1310.4
2°	1304.5
3°	1300.3
4°	1293.9
5°	1282.2
6°	1263.6
7°	1238.1
8°	1201.4
9°	1159.9
10°	1116.4
11°	1070.1
12°	1021.7
13°	971.2
14°	915.9
15°	859.1
17.5°	706.5
20°	555.0
22.5°	421.0
25°	307.3
27.5°	216.9
30°	147.3
32.5°	96.8
35°	64.3
37.5°	39.9
40°	24.5
42.5°	15.9
45°	10.1
47.5°	6.4
50°	4.8
52.5°	3.2
55°	2.7
57.5°	1.6
60°	1.1
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P224939

CATALOG NUMBER: LSR2B05FL409024D010 2LBD\*H

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)