

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P223954

Luminaire Tested: **LSSQWM2B05SP159024D010 2LBD\*WH**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P223954  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA ( 150)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQWM2B05SP159024D010 2LBD\*WH  
Description: 500 Lumen, 2inch Portfolio LED Cylinder  
SPOT OPTIC  
SPUN ROUND TRIM WITH WHEAT HAZE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 307.0 lumens  
Efficiency: N/A  
Efficacy: 42.1 lumens/watt  
Spacing Criteria (0/90/45): 0.24 / 0.24 / 0.23  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 7.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P223954

CATALOG NUMBER: LSSQWM2B05SP159024D010 2LBD\*WH

### Luminous Intensity Polar Plot

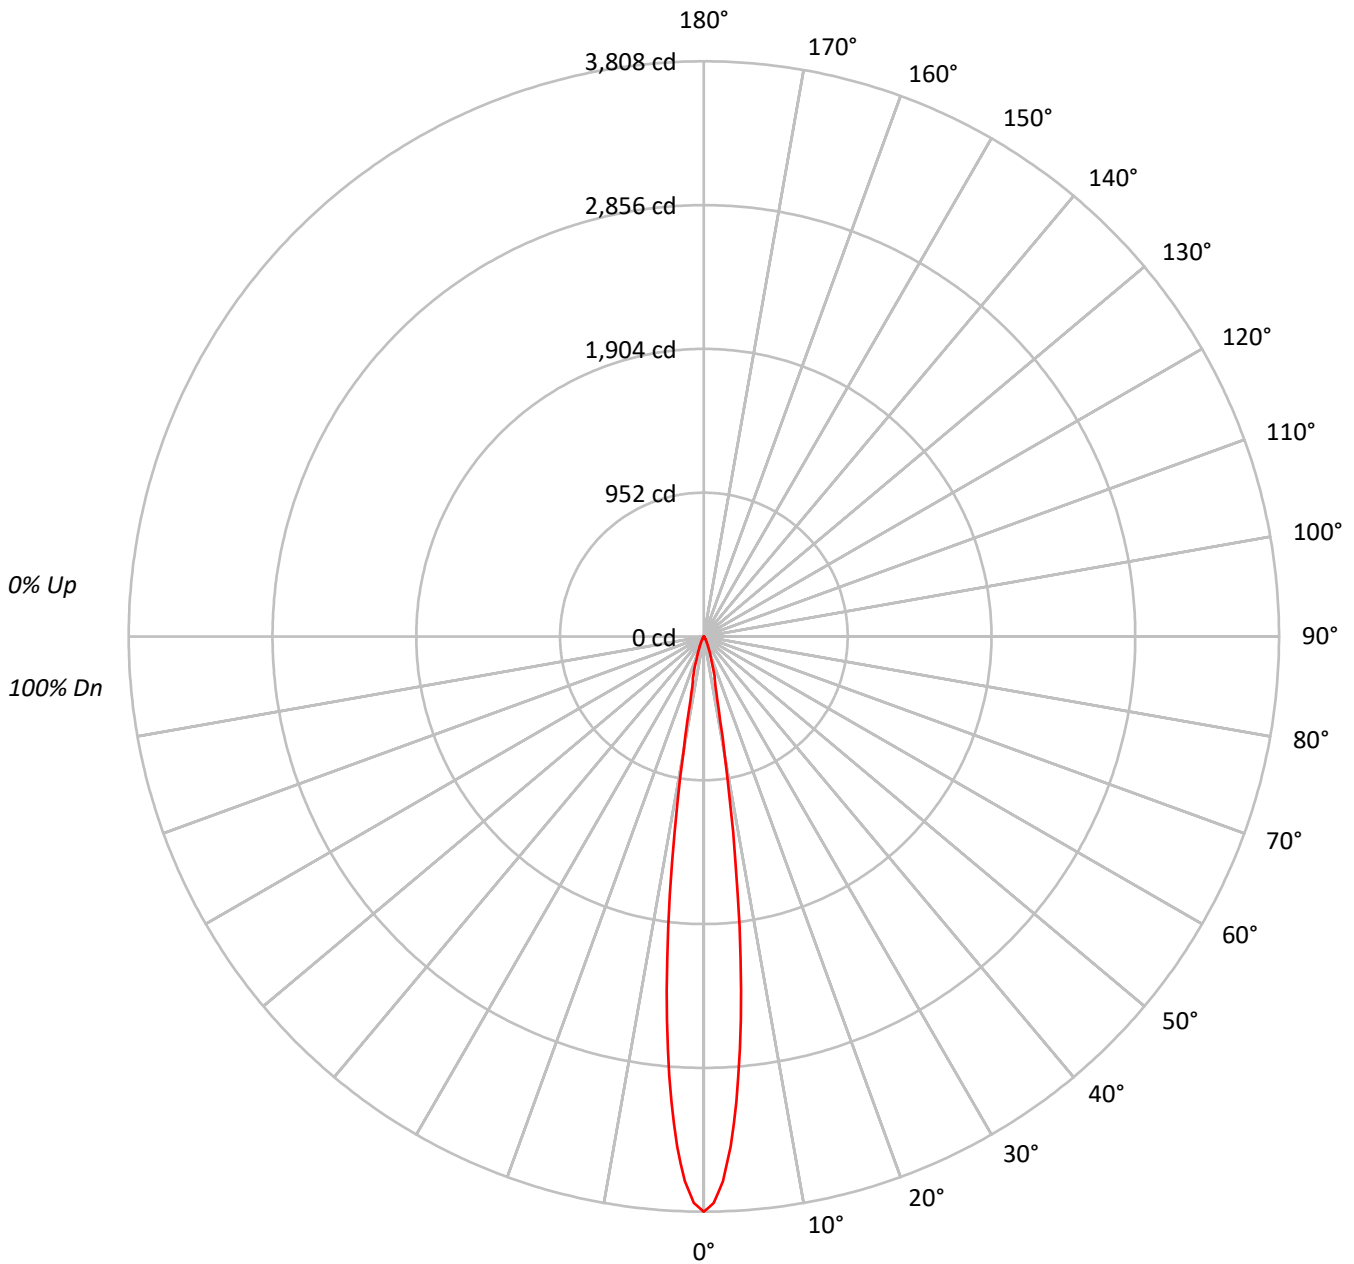



TEST NUMBER: P223954

CATALOG NUMBER: LSSQWM2B05SP159024D010 2LBD\*WH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98			98
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	99	98	96			96
3	110	106	103	101	108	105	102	100	102	100	98	100	99	97	98	97	96	94			94
4	108	103	100	97	106	102	99	97	100	98	96	98	96	95	97	95	94	93			93
5	105	101	97	95	104	100	97	94	98	96	94	97	95	93	96	94	92	91			91
6	103	98	95	93	102	98	95	92	96	94	92	95	93	91	94	92	91	90			90
7	101	96	93	91	100	96	93	90	95	92	90	94	91	90	93	91	89	88			88
8	100	94	91	89	99	94	91	89	93	90	89	92	90	88	92	90	88	87			87
9	98	93	90	88	97	92	89	87	92	89	87	91	89	87	90	88	87	86			86
10	96	91	88	86	96	91	88	86	90	88	86	90	87	86	89	87	86	85			85

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1475207
5°	1066432
10°	310449
15°	108954
20°	46620
25°	20985
30°	8096
35°	4019
40°	2680
45°	1753
50°	964
55°	743
60°	387
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P223954

CATALOG NUMBER: LSSQWM2B05SP159024D010 2LBD\*WH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	194.1	63.2
10°-20°	79.0	25.7
20°-30°	24.2	7.9
30°-40°	6.0	1.9
40°-50°	2.5	0.8
50°-60°	1.1	0.4
60°-70°	0.2	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	297.3	96.8
0°-40°	303.2	98.8
0°-60°	306.8	99.9
0°-90°	307.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	307.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3808	
5°	2743	194
15°	272	79
25°	49	24
35°	8	6
45°	3	2
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P223954

CATALOG NUMBER: LSSQWM2B05SP159024D010 2LBD\*WH

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3808.5
1°	3750.3
2°	3608.3
3°	3382.1
4°	3086.4
5°	2742.7
6°	2355.2
7°	1934.7
8°	1508.2
9°	1109.6
10°	789.3
11°	565.7
12°	425.4
13°	346.4
14°	303.1
15°	271.7
17.5°	167.6
20°	113.1
22.5°	75.8
25°	49.1
27.5°	29.9
30°	18.1
32.5°	11.7
35°	8.5
37.5°	6.9
40°	5.3
42.5°	4.3
45°	3.2
47.5°	2.1
50°	1.6
52.5°	1.6
55°	1.1
57.5°	1.1
60°	0.5
62.5°	0.5
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P223954

CATALOG NUMBER: LSSQWM2B05SP159024D010 2LBD\*WH

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)