

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P223897

Luminaire Tested: **LSSQWM2B05SP159027D010 2LBDL\*MW**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P223897  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA ( 150)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSSQWM2B05SP159027D010 2LBDL\*MW  
Description: 500 Lumen, 2inch Portfolio LED Cylinder  
SPOT OPTIC  
LENSED SPUN ROUND TRIM WITH MATTE WHITE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 315.0 lumens  
Efficiency: N/A  
Efficacy: 43.1 lumens/watt  
Spacing Criteria (0/90/45): 0.24 / 0.24 / 0.23  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 7.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P223897

CATALOG NUMBER: LSSQWM2B05SP159027D010 2LBDL\*MW

### Luminous Intensity Polar Plot

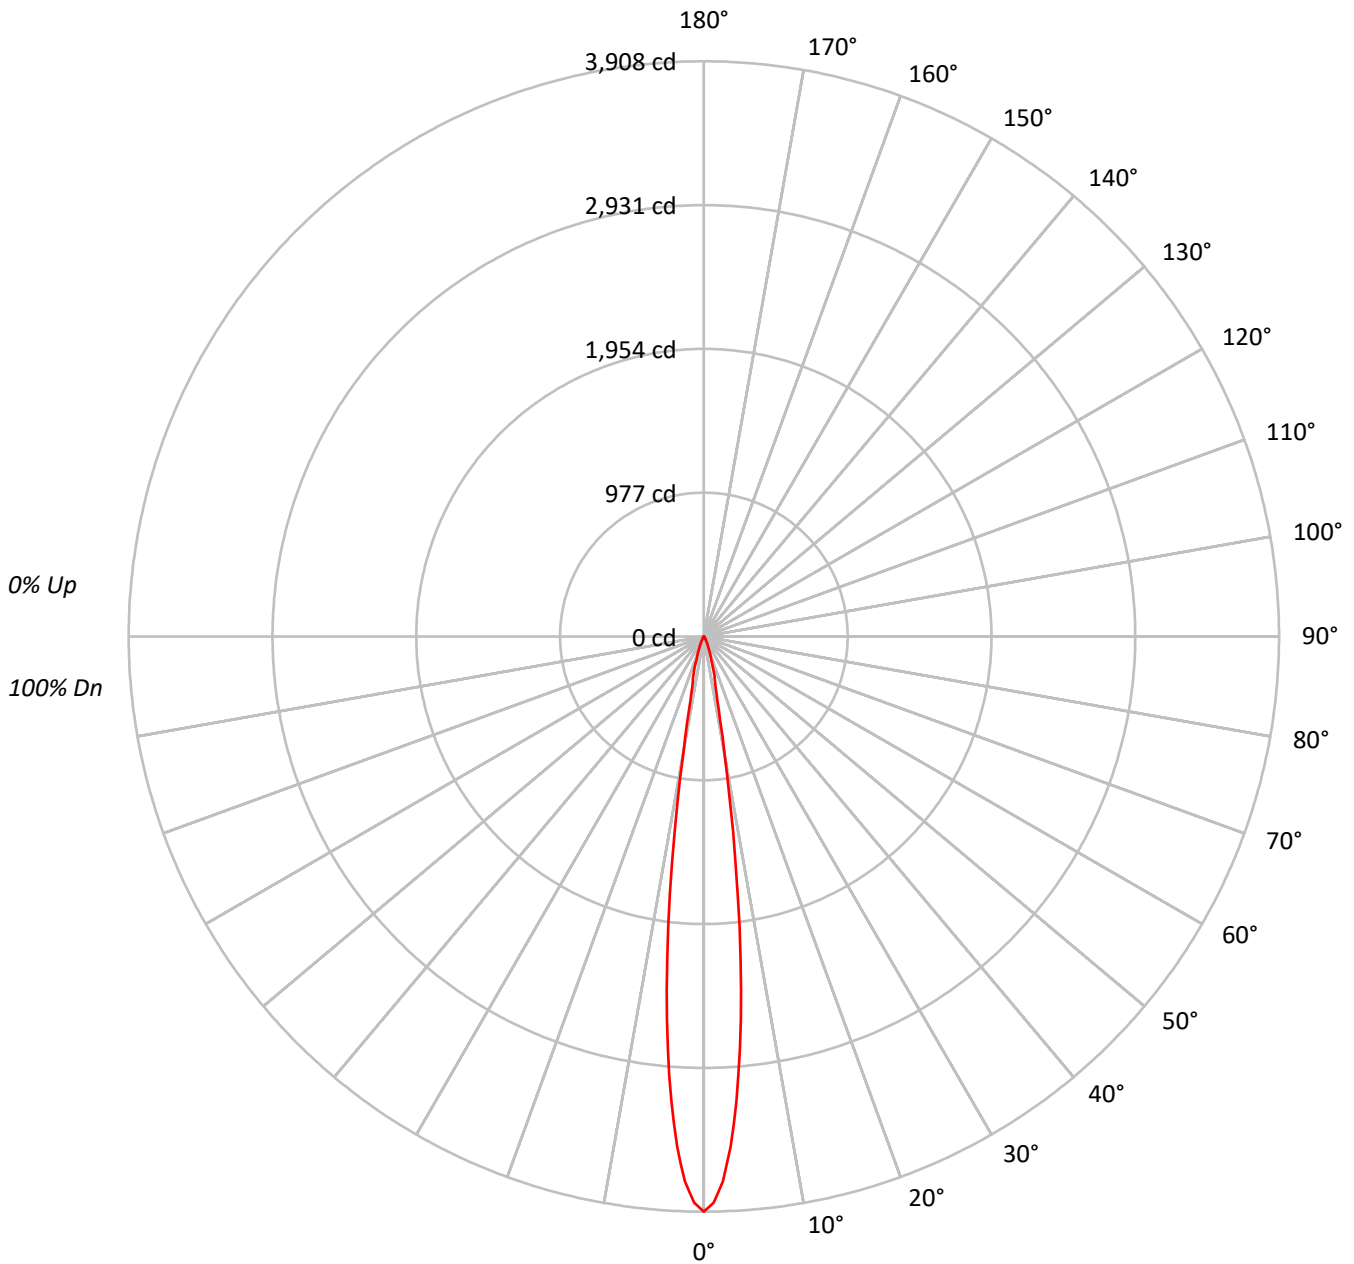



TEST NUMBER: P223897

CATALOG NUMBER: LSSQWM2B05SP159027D010 2LBDL\*MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |    |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |    |    | 20 |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |    |    | 0  |     |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 0  |     |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |    |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    |    | 100 |
| 1   | 116 | 114 | 112 | 111 | 113 | 112 | 110 | 109 | 108 | 107 | 106 | 104 | 103 | 103 | 101 | 100 | 100 | 98  |    |    |    | 98  |
| 2   | 113 | 110 | 107 | 105 | 111 | 108 | 106 | 104 | 105 | 103 | 102 | 102 | 101 | 100 | 100 | 99  | 98  | 96  |    |    |    | 96  |
| 3   | 110 | 106 | 103 | 101 | 108 | 105 | 102 | 100 | 102 | 100 | 98  | 100 | 99  | 97  | 98  | 97  | 96  | 94  |    |    |    | 94  |
| 4   | 108 | 103 | 100 | 97  | 106 | 102 | 99  | 97  | 100 | 98  | 96  | 98  | 96  | 95  | 97  | 95  | 94  | 93  |    |    |    | 93  |
| 5   | 105 | 101 | 97  | 95  | 104 | 100 | 97  | 94  | 98  | 96  | 94  | 97  | 95  | 93  | 96  | 94  | 92  | 91  |    |    |    | 91  |
| 6   | 103 | 98  | 95  | 93  | 102 | 98  | 95  | 92  | 96  | 94  | 92  | 95  | 93  | 91  | 94  | 92  | 91  | 90  |    |    |    | 90  |
| 7   | 101 | 96  | 93  | 91  | 100 | 96  | 93  | 90  | 95  | 92  | 90  | 94  | 91  | 90  | 93  | 91  | 89  | 88  |    |    |    | 88  |
| 8   | 100 | 94  | 91  | 89  | 99  | 94  | 91  | 89  | 93  | 90  | 89  | 92  | 90  | 88  | 92  | 90  | 88  | 87  |    |    |    | 87  |
| 9   | 98  | 93  | 90  | 88  | 97  | 92  | 89  | 87  | 92  | 89  | 87  | 91  | 89  | 87  | 90  | 88  | 87  | 86  |    |    |    | 86  |
| 10  | 96  | 91  | 88  | 86  | 96  | 91  | 88  | 86  | 90  | 88  | 86  | 90  | 87  | 86  | 89  | 87  | 86  | 85  |    |    |    | 85  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 1513632 |
| 5°  | 1094233 |
| 10° | 318551  |
| 15° | 111762  |
| 20° | 47857   |
| 25° | 21540   |
| 30° | 8319    |
| 35° | 4161    |
| 40° | 2781    |
| 45° | 1808    |
| 50° | 964     |
| 55° | 743     |
| 60° | 387     |
| 65° | 0       |
| 70° | 0       |
| 75° | 0       |
| 80° | 0       |
| 85° | 0       |



TEST NUMBER: P223897

CATALOG NUMBER: LSSQWM2B05SP159027D010 2LBDL\*MW

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 199.1  | 63.2      |
| 10°-20°   | 81.0   | 25.7      |
| 20°-30°   | 24.9   | 7.9       |
| 30°-40°   | 6.1    | 1.9       |
| 40°-50°   | 2.6    | 0.8       |
| 50°-60°   | 1.1    | 0.3       |
| 60°-70°   | 0.2    | 0.1       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 305.0  | 96.8      |
| 0°-40°    | 311.2  | 98.8      |
| 0°-60°    | 314.8  | 99.9      |
| 0°-90°    | 315.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 315.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 3908 |      |
| 5°  | 2814 | 199  |
| 15° | 279  | 81   |
| 25° | 50   | 25   |
| 35° | 9    | 6    |
| 45° | 3    | 3    |
| 55° | 1    | 1    |
| 65° | 0    | 0    |
| 75° | 0    | 0    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P223897

CATALOG NUMBER: LSSQWM2B05SP159027D010 2LBDL\*MW

**CANDELA DISTRIBUTION (FULL):**

|       | 0°     |
|-------|--------|
| 0°    | 3907.7 |
| 1°    | 3848.0 |
| 2°    | 3702.4 |
| 3°    | 3470.2 |
| 4°    | 3166.8 |
| 5°    | 2814.2 |
| 6°    | 2416.6 |
| 7°    | 1985.1 |
| 8°    | 1547.5 |
| 9°    | 1138.5 |
| 10°   | 809.9  |
| 11°   | 580.5  |
| 12°   | 436.4  |
| 13°   | 355.4  |
| 14°   | 311.0  |
| 15°   | 278.7  |
| 17.5° | 171.9  |
| 20°   | 116.1  |
| 22.5° | 77.8   |
| 25°   | 50.4   |
| 27.5° | 30.7   |
| 30°   | 18.6   |
| 32.5° | 12.0   |
| 35°   | 8.8    |
| 37.5° | 7.1    |
| 40°   | 5.5    |
| 42.5° | 4.4    |
| 45°   | 3.3    |
| 47.5° | 2.2    |
| 50°   | 1.6    |
| 52.5° | 1.6    |
| 55°   | 1.1    |
| 57.5° | 1.1    |
| 60°   | 0.5    |
| 62.5° | 0.5    |
| 65°   | 0.0    |
| 67.5° | 0.0    |
| 70°   | 0.0    |
| 72.5° | 0.0    |
| 75°   | 0.0    |
| 77.5° | 0.0    |
| 80°   | 0.0    |
| 82.5° | 0.0    |



TEST NUMBER: P223897

CATALOG NUMBER: LSSQWM2B05SP159027D010 2LBDL\*MW

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







|       |  |     |
|-------|--|-----|
| 85°   |  | 0.0 |
| 87.5° |  | 0.0 |



(END OF REPORT)