

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LSR2B05WFL559030D010 2LBDLC\*MW**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14810)  
Test Lab: INNOVATION CENTER (G1)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LSR2B05WFL559030D010 2LBDLC\*MW  
Description: 500 Lumen, 2inch Portfolio LED Cylinder  
WIDE FLOOD OPTIC  
LENSED CAST ROUND TRIM WITH MATTE WHITE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 528.0 lumens  
Efficiency: N/A  
Efficacy: 72.3 lumens/watt  
Spacing Criteria (0/90/45): 0.79 / 0.79 / 0.84  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 7.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#  
CATALOG NUMBER: LSR2B05WFL559030D010 2LBDLC\*MW

### Luminous Intensity Polar Plot

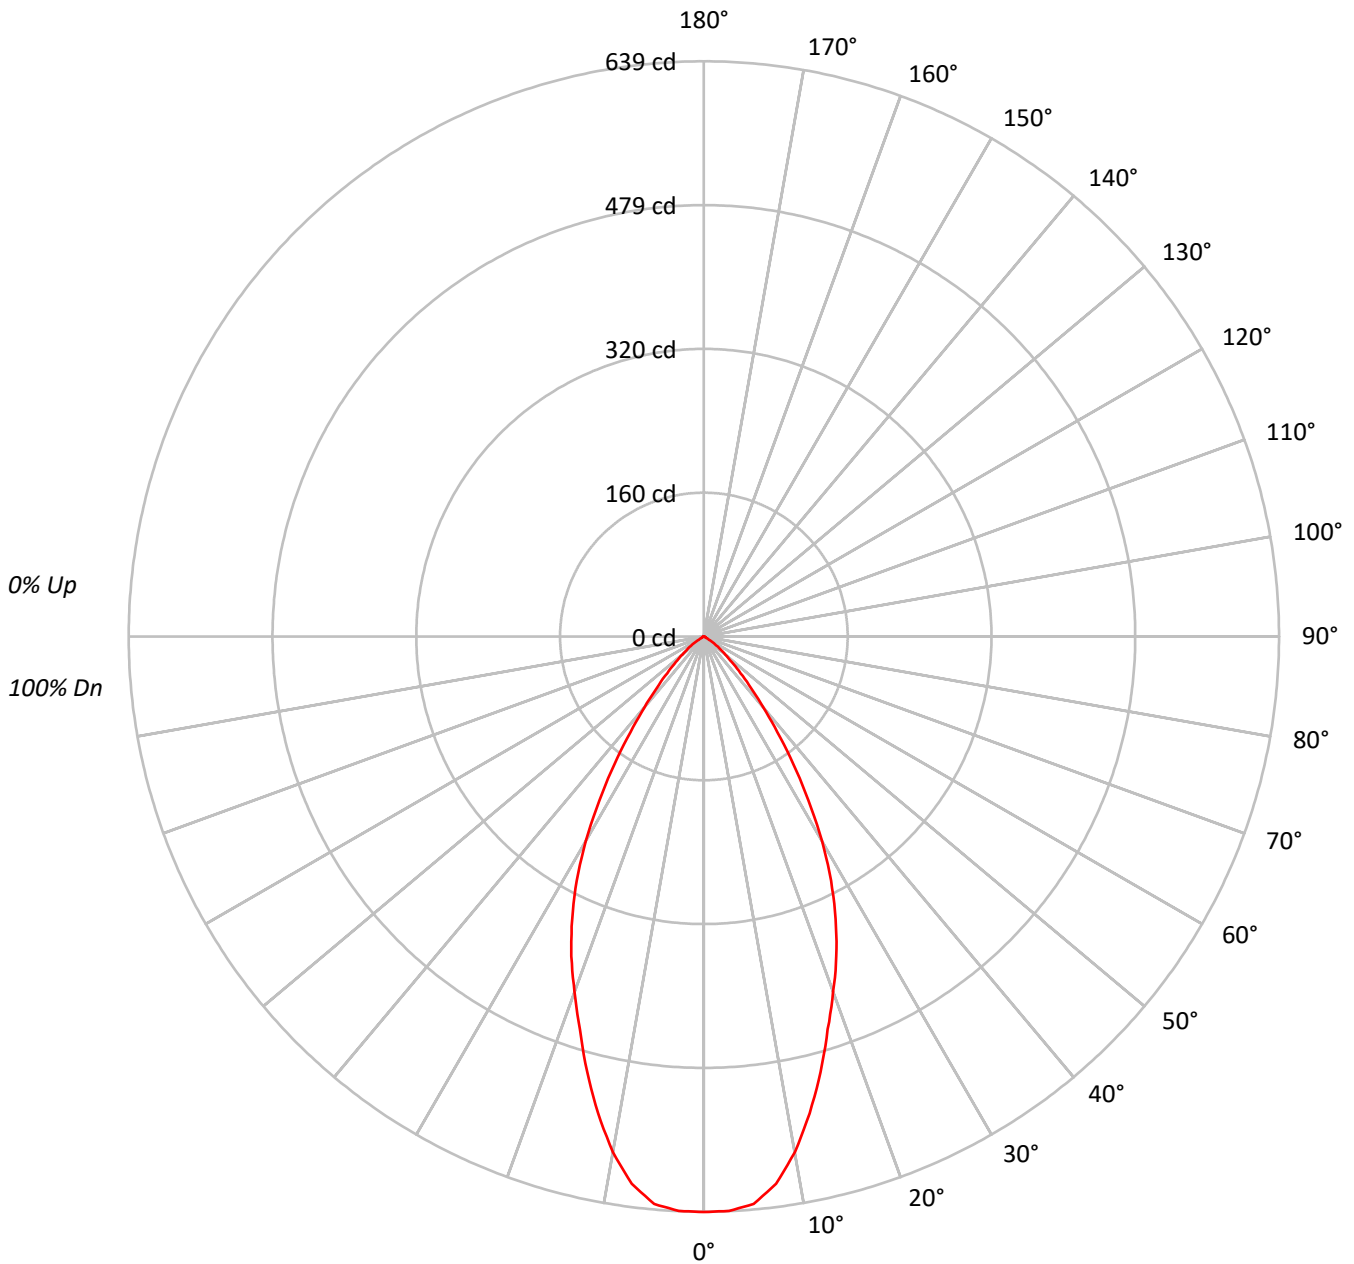



TEST NUMBER: P#

CATALOG NUMBER: LSR2B05WFL559030D010 2LBDLC\*MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |   |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |    |    |   |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     | 0  |    |   |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 0 |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |   |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    |   |
| 1   | 113 | 110 | 108 | 106 | 111 | 108 | 106 | 104 | 104 | 102 | 101 | 101 | 99  | 98  | 97  | 96  | 95  | 93  |    |    |   |
| 2   | 108 | 102 | 98  | 95  | 105 | 101 | 97  | 94  | 98  | 94  | 92  | 95  | 92  | 90  | 92  | 90  | 88  | 86  |    |    |   |
| 3   | 102 | 95  | 90  | 86  | 100 | 94  | 89  | 85  | 91  | 87  | 84  | 89  | 85  | 83  | 87  | 84  | 81  | 80  |    |    |   |
| 4   | 97  | 89  | 83  | 79  | 95  | 88  | 82  | 78  | 85  | 81  | 77  | 83  | 80  | 76  | 82  | 78  | 76  | 74  |    |    |   |
| 5   | 91  | 83  | 77  | 72  | 90  | 82  | 76  | 72  | 80  | 75  | 72  | 78  | 74  | 71  | 77  | 73  | 70  | 69  |    |    |   |
| 6   | 87  | 78  | 71  | 67  | 85  | 77  | 71  | 67  | 75  | 70  | 66  | 74  | 69  | 66  | 73  | 69  | 65  | 64  |    |    |   |
| 7   | 82  | 73  | 67  | 62  | 81  | 72  | 66  | 62  | 71  | 66  | 62  | 70  | 65  | 62  | 69  | 64  | 61  | 60  |    |    |   |
| 8   | 78  | 69  | 62  | 58  | 77  | 68  | 62  | 58  | 67  | 62  | 58  | 66  | 61  | 58  | 65  | 61  | 57  | 56  |    |    |   |
| 9   | 74  | 65  | 59  | 55  | 73  | 64  | 58  | 54  | 63  | 58  | 54  | 62  | 57  | 54  | 61  | 57  | 54  | 53  |    |    |   |
| 10  | 71  | 61  | 55  | 51  | 70  | 61  | 55  | 51  | 60  | 55  | 51  | 59  | 54  | 51  | 58  | 54  | 51  | 49  |    |    |   |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 247669 |
| 5°  | 246088 |
| 10° | 228795 |
| 15° | 200866 |
| 20° | 173126 |
| 25° | 148048 |
| 30° | 117497 |
| 35° | 81900  |
| 40° | 51829  |
| 45° | 31607  |
| 50° | 18681  |
| 55° | 10265  |
| 60° | 2247   |
| 65° | 2016   |
| 70° | 1586   |
| 75° | 2095   |
| 80° | 1561   |
| 85° | 3111   |



TEST NUMBER: P#

CATALOG NUMBER: LSR2B05WFL559030D010 2LBDLC\*MW

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 58.7   | 11.1      |
| 10°-20°   | 139.5  | 26.4      |
| 20°-30°   | 157.4  | 29.8      |
| 30°-40°   | 108.9  | 20.6      |
| 40°-50°   | 46.4   | 8.8       |
| 50°-60°   | 13.4   | 2.5       |
| 60°-70°   | 2.0    | 0.4       |
| 70°-80°   | 1.2    | 0.2       |
| 80°-90°   | 0.5    | 0.1       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 355.6  | 67.4      |
| 0°-40°    | 464.5  | 88.0      |
| 0°-60°    | 524.3  | 99.3      |
| 0°-90°    | 528.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 528.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 639 |      |
| 5°  | 633 | 59   |
| 15° | 501 | 139  |
| 25° | 346 | 157  |
| 35° | 173 | 109  |
| 45° | 58  | 46   |
| 55° | 15  | 13   |
| 65° | 2   | 2    |
| 75° | 1   | 1    |
| 85° | 1   | 0    |
| 90° | 0   |      |



TEST NUMBER: P#

CATALOG NUMBER: LSR2B05WFL559030D010 2LBDLC\*MW

**CANDELA DISTRIBUTION (FULL):**

|       | 0°    |
|-------|-------|
| 0°    | 639.4 |
| 2.5°  | 638.7 |
| 5°    | 632.9 |
| 7.5°  | 613.4 |
| 10°   | 581.7 |
| 12.5° | 542.7 |
| 15°   | 500.9 |
| 17.5° | 457.6 |
| 20°   | 420.0 |
| 22.5° | 384.7 |
| 25°   | 346.4 |
| 27.5° | 306.0 |
| 30°   | 262.7 |
| 32.5° | 215.8 |
| 35°   | 173.2 |
| 37.5° | 134.2 |
| 40°   | 102.5 |
| 42.5° | 77.2  |
| 45°   | 57.7  |
| 47.5° | 41.9  |
| 50°   | 31.0  |
| 52.5° | 22.4  |
| 55°   | 15.2  |
| 57.5° | 6.5   |
| 60°   | 2.9   |
| 62.5° | 2.2   |
| 65°   | 2.2   |
| 67.5° | 1.4   |
| 70°   | 1.4   |
| 72.5° | 1.4   |
| 75°   | 1.4   |
| 77.5° | 0.7   |
| 80°   | 0.7   |
| 82.5° | 0.7   |
| 85°   | 0.7   |
| 87.5° | 0.0   |
| 90°   | 0.0   |



Report Generated By E9808895 / USPTCWHP6082093

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report







— 0°-180°







(END OF REPORT)