

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P223529

Luminaire Tested: **LD2B10D010 EU2B10NFL258027 2LBDC*MMS**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P223529
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (155)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B10D010 EU2B10NFL258027 2LBDC*MMS
Description: 1000 Lumen, 2inch Portfolio LED Downlight
NARROW FLOOD OPTIC
CAST ROUND TRIM WITH MATTE METALLIC SILVER
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 992.6 lumens
Efficiency: N/A
Efficacy: 96.4 lumens/watt
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.35
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P223529

CATALOG NUMBER: LD2B10D010 EU2B10NFL258027 2LBDC*MMS

Luminous Intensity Polar Plot

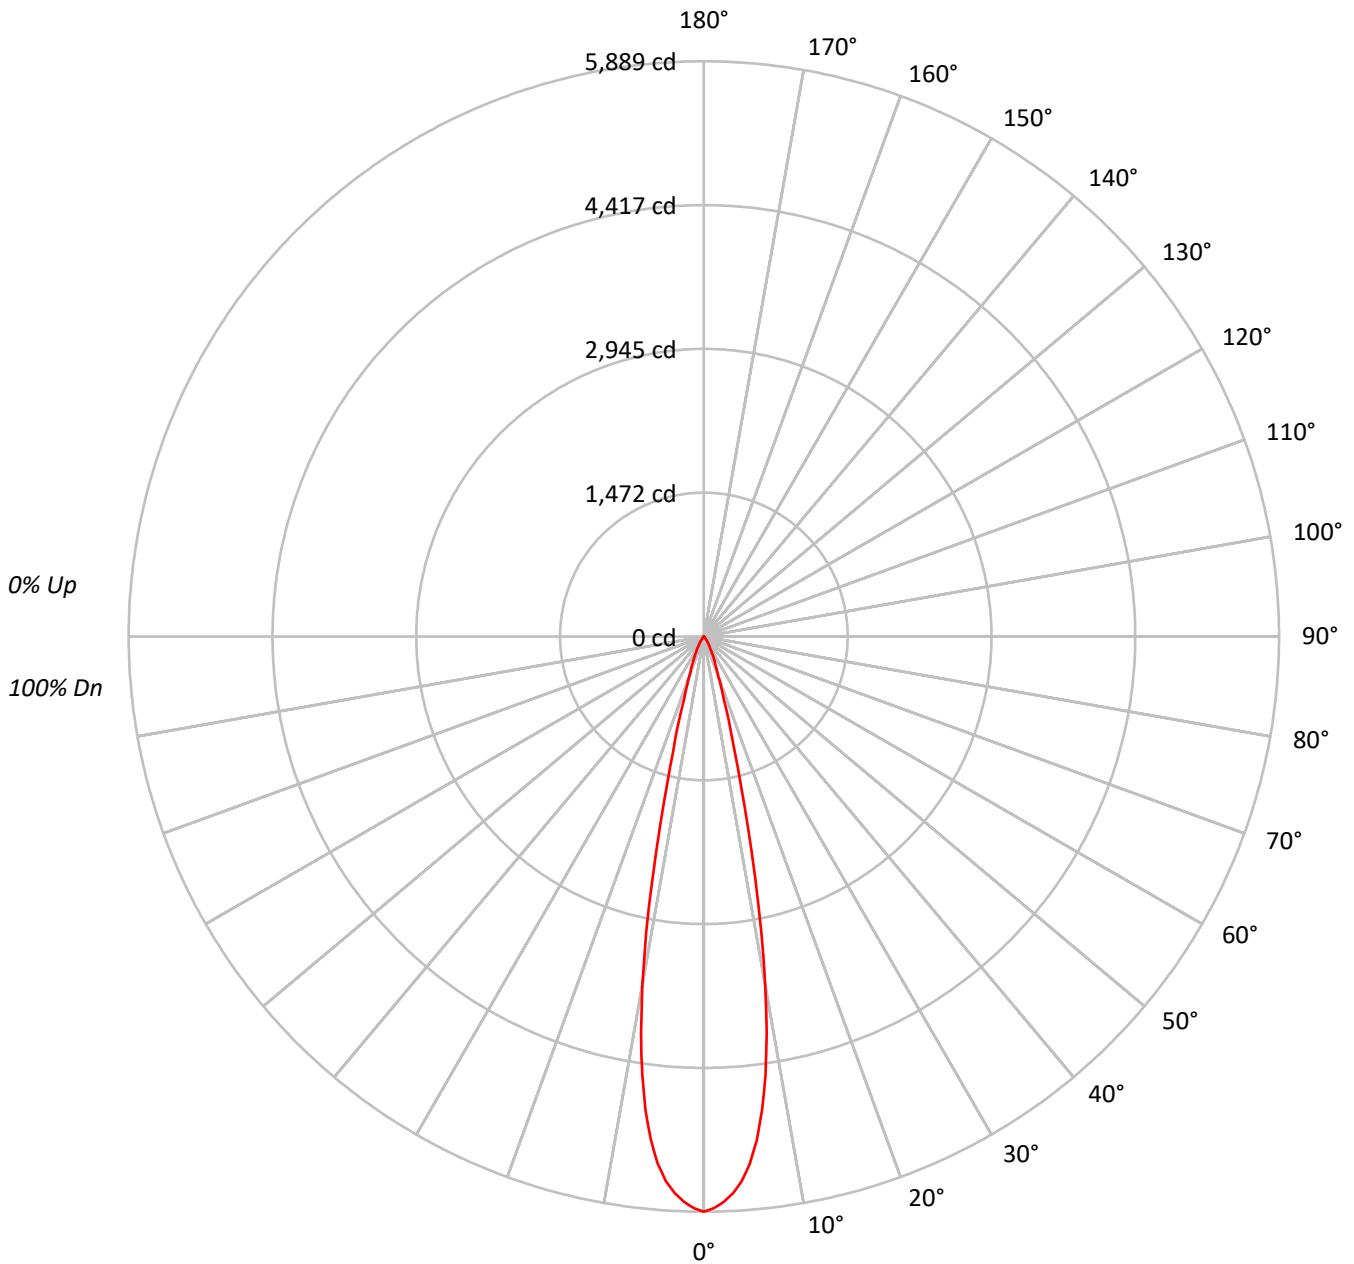



TEST NUMBER: P223529

CATALOG NUMBER: LD2B10D010 EU2B10NFL258027 2LBDC*MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97	97	97	97
2	112	109	106	104	110	107	104	102	104	102	100	101	99	98	98	97	96	95	95	95	95
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	96	95	93	92	92	92	92
4	106	101	97	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90	90	90	90
5	103	98	94	91	102	97	94	91	95	92	90	94	91	89	93	90	89	88	88	88	88
6	101	95	91	89	99	94	91	88	93	90	88	92	89	87	91	88	87	86	86	86	86
7	98	92	89	86	97	92	88	86	91	88	85	90	87	85	89	86	85	84	84	84	84
8	96	90	86	84	95	90	86	84	89	86	83	88	85	83	87	85	83	82	82	82	82
9	94	88	84	82	93	88	84	82	87	84	82	86	83	81	85	83	81	80	80	80	80
10	92	86	82	80	91	86	82	80	85	82	80	84	82	80	84	81	79	79	79	79	79

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2280964
5°	2106074
10°	1425554
15°	484982
20°	178114
25°	94453
30°	48529
35°	22650
40°	7433
45°	3725
50°	1748
55°	675
60°	775
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P223529

CATALOG NUMBER: LD2B10D010 EU2B10NFL258027 2LBDC*MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	460.7	46.4
10°-20°	387.4	39.0
20°-30°	106.3	10.7
30°-40°	31.0	3.1
40°-50°	5.7	0.6
50°-60°	1.3	0.1
60°-70°	0.1	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	954.4	96.2
0°-40°	985.5	99.3
0°-60°	992.5	100.0
0°-90°	992.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	992.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5889	
5°	5416	461
15°	1209	387
25°	221	106
35°	48	31
45°	7	6
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P223529

CATALOG NUMBER: LD2B10D010 EU2B10NFL258027 2LBDC*MMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	5888.7
1°	5854.5
2°	5793.9
3°	5706.9
4°	5587.6
5°	5416.5
6°	5182.8
7°	4890.5
8°	4533.6
9°	4112.2
10°	3624.4
11°	3089.5
12°	2533.2
13°	2002.3
14°	1549.7
15°	1209.4
17.5°	682.4
20°	432.1
22.5°	308.0
25°	221.0
27.5°	156.4
30°	108.5
32.5°	76.3
35°	47.9
37.5°	19.6
40°	14.7
42.5°	10.8
45°	6.8
47.5°	3.9
50°	2.9
52.5°	2.0
55°	1.0
57.5°	1.0
60°	1.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P223529

CATALOG NUMBER: LD2B10D010 EU2B10NFL258027 2LBDC*MMS

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)