

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P224601

Luminaire Tested: **LD2B10D010 EU2B10FL409727 2LBDLC*MMS**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P224601
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14836)
Test Lab: INNOVATION CENTER (G1)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B10D010 EU2B10FL409727 2LBDLC*MMS
Description: 1000 Lumen, 2inch Portfolio LED Downlight
FLOOD OPTIC
LENSED CAST ROUND TRIM WITH MATTE METALLIC SILVER
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 659.1 lumens
Efficiency: N/A
Efficacy: 64.0 lumens/watt
Spacing Criteria (0/90/45): 0.61 / 0.61 / 0.59
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P224601

CATALOG NUMBER: LD2B10D010 EU2B10FL409727 2LBDLC*MMS

Luminous Intensity Polar Plot

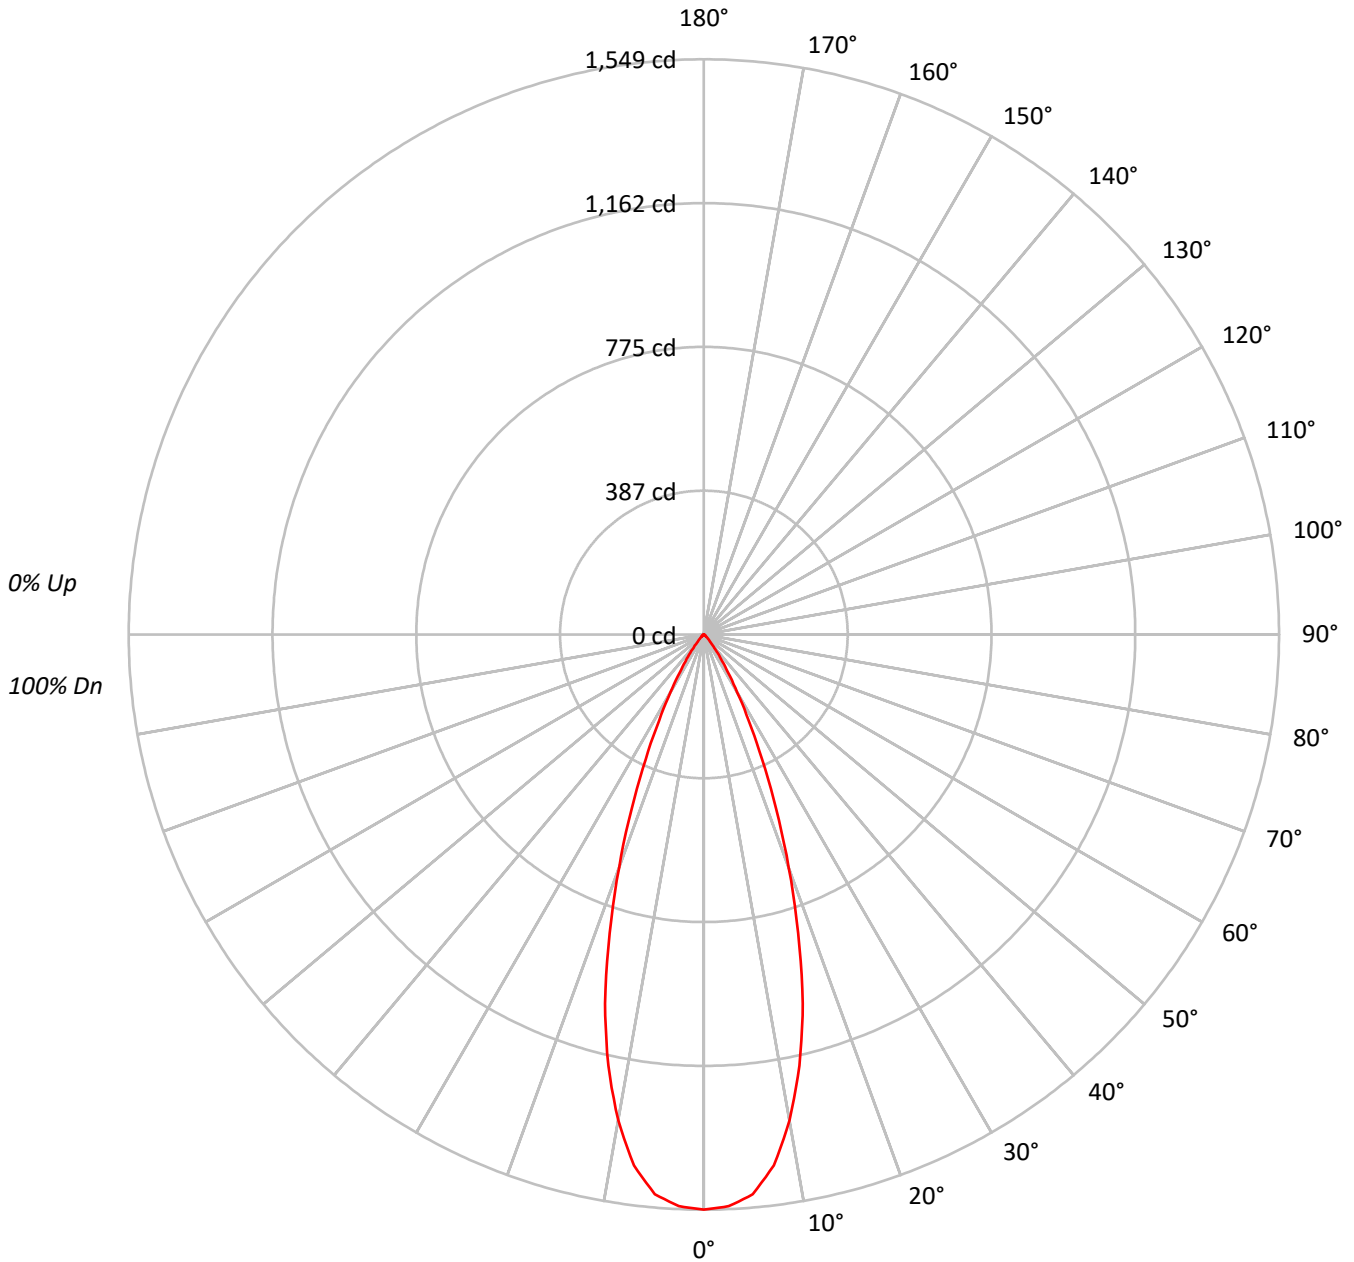



TEST NUMBER: P224601

CATALOG NUMBER: LD2B10D010 EU2B10FL409727 2LBDLC*MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95	95	95	95
2	110	106	102	100	108	104	101	99	101	99	96	98	96	94	95	94	92	91	91	91	91
3	106	100	96	93	104	99	95	92	97	93	91	94	92	89	92	90	88	87	87	87	87
4	102	95	91	87	100	94	90	87	92	89	86	90	87	85	89	86	84	83	83	83	83
5	98	91	86	83	96	90	86	82	88	85	82	87	83	81	85	83	80	79	79	79	79
6	94	87	82	78	93	86	82	78	85	81	78	83	80	77	82	79	77	76	76	76	76
7	91	83	78	75	89	82	78	75	81	77	74	80	77	74	79	76	73	72	72	72	72
8	87	80	75	71	86	79	75	71	78	74	71	77	73	71	76	73	70	69	69	69	69
9	84	76	72	68	83	76	71	68	75	71	68	74	71	68	74	70	68	67	67	67	67
10	81	74	69	66	81	73	69	66	72	68	65	72	68	65	71	68	65	64	64	64	64

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	599960
5°	588449
10°	522685
15°	412479
20°	275106
25°	158348
30°	80195
35°	37593
40°	15422
45°	6957
50°	3555
55°	2296
60°	1317
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P224601

CATALOG NUMBER: LD2B10D010 EU2B10FL409727 2LBDLC*MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.5	21.0
10°-20°	278.0	42.2
20°-30°	174.1	26.4
30°-40°	53.9	8.2
40°-50°	11.2	1.7
50°-60°	3.1	0.5
60°-70°	0.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	590.6	89.6
0°-40°	644.4	97.8
0°-60°	658.7	99.9
0°-90°	659.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	659.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1549	
5°	1513	139
15°	1029	278
25°	370	174
35°	80	54
45°	13	11
55°	3	3
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P224601

CATALOG NUMBER: LD2B10D010 EU2B10FL409727 2LBDLC*MMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	1548.9
2.5°	1541.3
5°	1513.4
7.5°	1442.3
10°	1328.9
12.5°	1189.4
15°	1028.6
17.5°	843.4
20°	667.4
22.5°	507.6
25°	370.5
27.5°	260.5
30°	179.3
32.5°	120.1
35°	79.5
37.5°	49.9
40°	30.5
42.5°	19.5
45°	12.7
47.5°	8.5
50°	5.9
52.5°	4.2
55°	3.4
57.5°	2.5
60°	1.7
62.5°	0.8
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°







(END OF REPORT)