

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P224399

Luminaire Tested: **LD2B10D010 EU2B10FL409727 2LBDSQC*MW**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P224399
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14831)
Test Lab: INNOVATION CENTER (G1)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B10D010 EU2B10FL409727 2LBDSQC*MW
Description: 1000 Lumen, 2inch Portfolio LED Downlight
FLOOD OPTIC
SQUARE CAST TRIM WITH MATTE WHITE FINISH
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 712.1 lumens
Efficiency: N/A
Efficacy: 69.1 lumens/watt
Spacing Criteria (0/90/45): 0.61 / 0.61 / 0.59
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P224399

CATALOG NUMBER: LD2B10D010 EU2B10FL409727 2LBDSQC*MW

Luminous Intensity Polar Plot

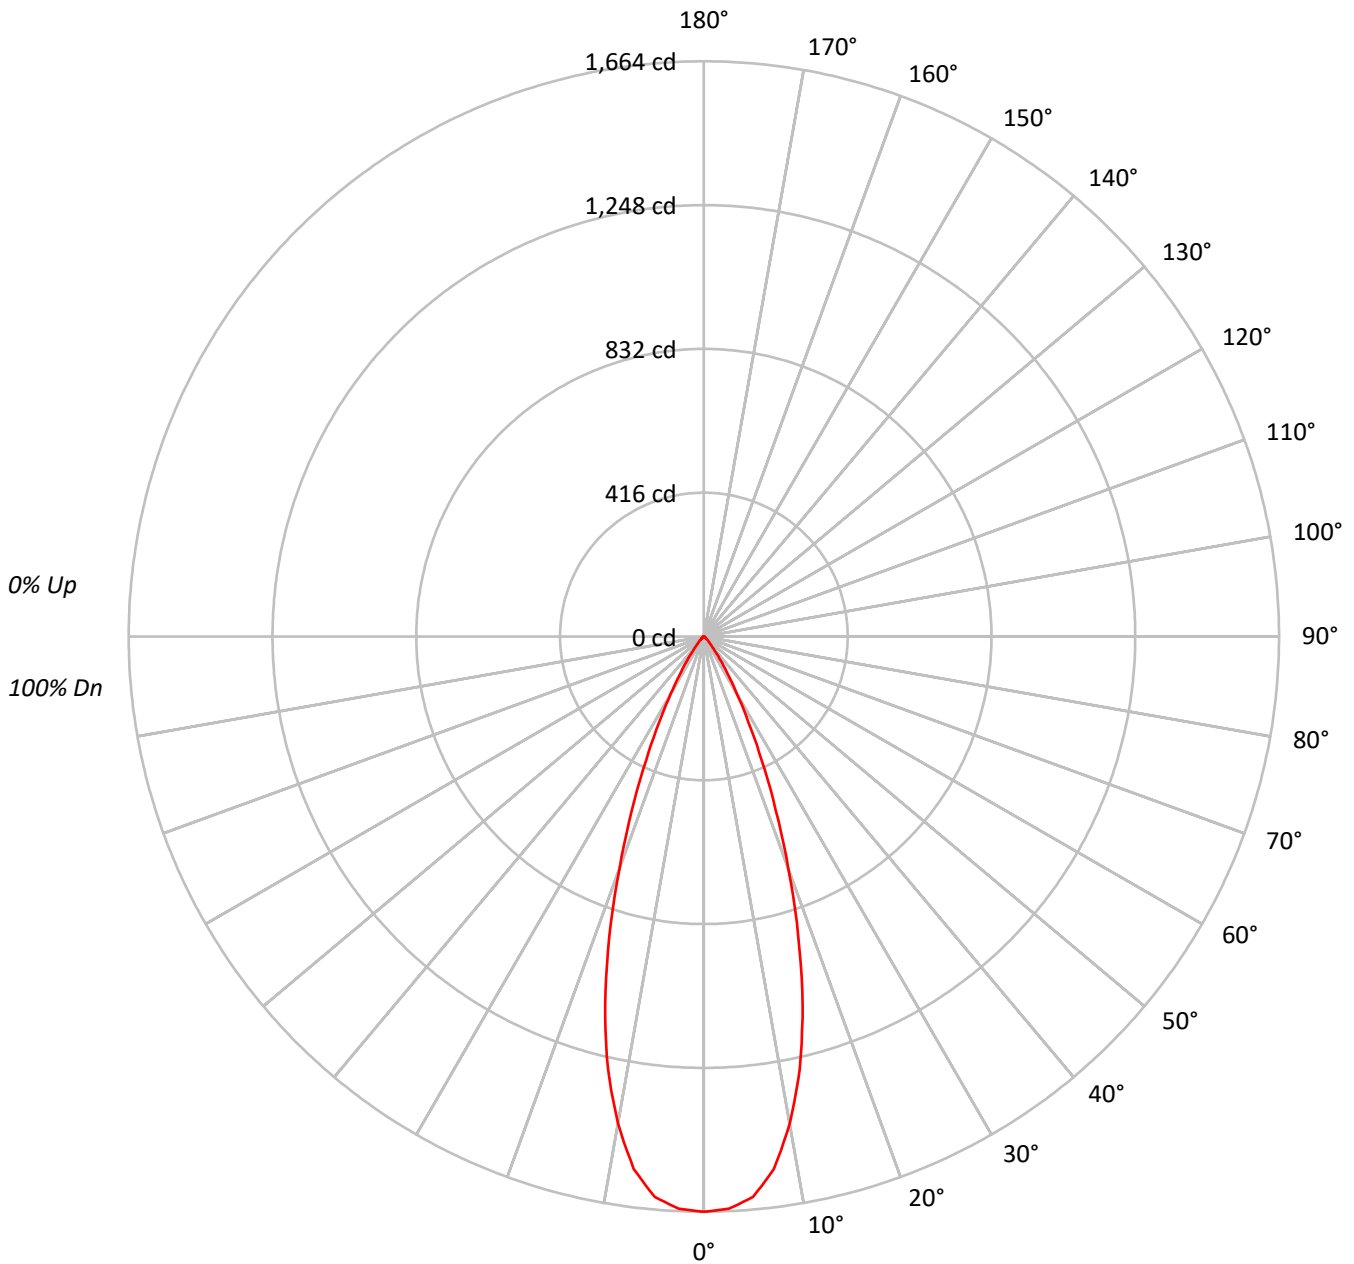



TEST NUMBER: P224399

CATALOG NUMBER: LD2B10D010 EU2B10FL409727 2LBDSQC*MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95			95																
2	110	106	102	99	108	104	101	98	101	98	96	98	96	94	95	94	92	91			91																
3	105	100	96	93	104	99	95	92	96	93	90	94	91	89	92	90	88	86			86																
4	101	95	90	87	100	94	90	86	92	88	85	90	87	85	88	86	84	82			82																
5	98	91	86	82	96	90	85	82	88	84	81	86	83	80	85	82	80	79			79																
6	94	87	82	78	93	86	81	78	84	80	77	83	80	77	82	79	76	75			75																
7	90	83	78	74	89	82	77	74	81	77	74	80	76	73	79	76	73	72			72																
8	87	79	74	71	86	79	74	71	78	74	71	77	73	70	76	73	70	69			69																
9	84	76	71	68	83	76	71	68	75	71	68	74	70	67	73	70	67	66			66																
10	81	73	68	65	80	73	68	65	72	68	65	71	68	65	71	67	65	64			64																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	644660
5°	632930
10°	562646
15°	442515
20°	294438
25°	169032
30°	85384
35°	40193
40°	16181
45°	7998
50°	4399
55°	3106
60°	2866
65°	1650
70°	2039
75°	1347
80°	2008
85°	0



TEST NUMBER: P224399

CATALOG NUMBER: LD2B10D010 EU2B10FL409727 2LBDSQC*MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	149.1	20.9
10°-20°	298.9	42.0
20°-30°	186.0	26.1
30°-40°	57.2	8.0
40°-50°	12.5	1.8
50°-60°	4.5	0.6
60°-70°	2.2	0.3
70°-80°	1.3	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	633.9	89.0
0°-40°	691.1	97.1
0°-60°	708.2	99.5
0°-90°	712.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	712.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1664	
5°	1628	149
15°	1104	299
25°	396	186
35°	85	57
45°	15	13
55°	5	4
65°	2	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P224399

CATALOG NUMBER: LD2B10D010 EU2B10FL409727 2LBDSQC*MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	1664.3
2.5°	1657.0
5°	1627.8
7.5°	1553.8
10°	1430.5
12.5°	1282.5
15°	1103.5
17.5°	908.0
20°	714.3
22.5°	541.7
25°	395.5
27.5°	278.6
30°	190.9
32.5°	128.8
35°	85.0
37.5°	51.2
40°	32.0
42.5°	21.9
45°	14.6
47.5°	10.0
50°	7.3
52.5°	6.4
55°	4.6
57.5°	3.7
60°	3.7
62.5°	2.7
65°	1.8
67.5°	1.8
70°	1.8
72.5°	1.8
75°	0.9
77.5°	0.9
80°	0.9
82.5°	0.9
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)