

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P223778

Luminaire Tested: **LD2B10D010 EU2B10SP159035 2LBDSQLC*MMS**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P223778
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (150)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B10D010 EU2B10SP159035 2LBDSQLC*MMS
Description: 1000 Lumen, 2inch Portfolio LED Downlight
SPOT OPTIC
LENSED SQUARE CAST TRIM WITH MATTE METALLIC SILVER
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 429.6 lumens
Efficiency: N/A
Efficacy: 41.7 lumens/watt
Spacing Criteria (0/90/45): 0.24 / 0.24 / 0.23
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 10.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P223778

CATALOG NUMBER: LD2B10D010 EU2B10SP159035 2LBDSQLC*MMS

Luminous Intensity Polar Plot

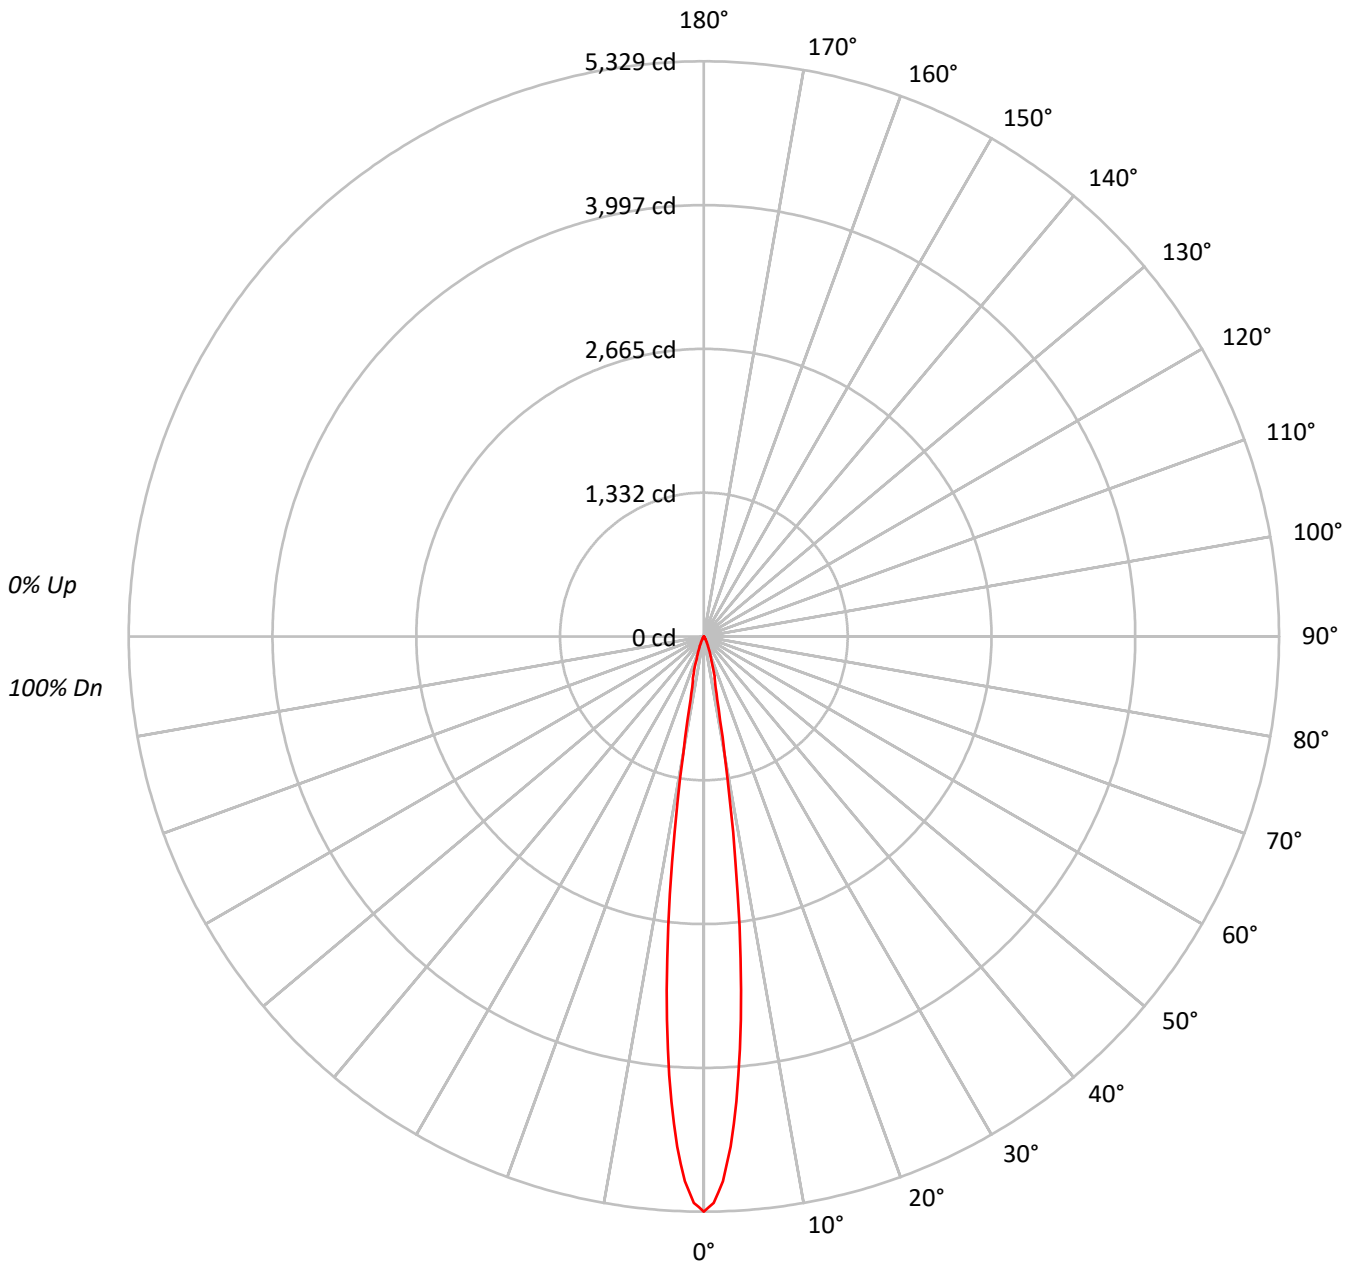



TEST NUMBER: P223778

CATALOG NUMBER: LD2B10D010 EU2B10SP159035 2LBDSQLC*MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98	98	98	98
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	99	98	96	96	96	96
3	110	106	103	101	108	105	102	100	102	100	98	100	99	97	98	97	96	94	94	94	94
4	108	103	100	97	106	102	99	97	100	98	96	98	96	95	97	95	94	93	93	93	93
5	105	101	97	95	104	100	97	94	98	96	94	97	95	93	96	94	92	91	91	91	91
6	103	98	95	93	102	98	95	92	96	94	92	95	93	91	94	92	91	90	90	90	90
7	101	96	93	91	100	96	93	90	95	92	90	94	91	90	93	91	89	88	88	88	88
8	100	94	91	89	99	94	91	89	93	90	89	92	90	88	92	90	88	87	87	87	87
9	98	93	90	88	97	92	89	87	92	89	87	91	89	87	90	88	87	86	86	86	86
10	96	91	88	86	96	91	88	86	90	88	86	90	87	86	89	87	86	85	85	85	85

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2064322
5°	1492313
10°	434463
15°	152424
20°	65252
25°	29362
30°	11361
35°	5627
40°	3792
45°	2465
50°	1326
55°	1013
60°	542
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P223778

CATALOG NUMBER: LD2B10D010 EU2B10SP159035 2LBDSQLC*MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	271.6	63.2
10°-20°	110.5	25.7
20°-30°	33.9	7.9
30°-40°	8.4	1.9
40°-50°	3.5	0.8
50°-60°	1.5	0.3
60°-70°	0.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	416.0	96.8
0°-40°	424.3	98.8
0°-60°	429.3	99.9
0°-90°	429.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	429.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5329	
5°	3838	272
15°	380	110
25°	69	34
35°	12	8
45°	4	3
55°	2	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P223778

CATALOG NUMBER: LD2B10D010 EU2B10SP159035 2LBDSQLC*MMS

CANDELA DISTRIBUTION (FULL):

0°	
0°	5329.4
1°	5248.0
2°	5049.3
3°	4732.7
4°	4318.9
5°	3838.0
6°	3295.8
7°	2707.3
8°	2110.5
9°	1552.7
10°	1104.6
11°	791.6
12°	595.2
13°	484.7
14°	424.2
15°	380.1
17.5°	234.5
20°	158.3
22.5°	106.1
25°	68.7
27.5°	41.8
30°	25.4
32.5°	16.4
35°	11.9
37.5°	9.7
40°	7.5
42.5°	6.0
45°	4.5
47.5°	3.0
50°	2.2
52.5°	2.2
55°	1.5
57.5°	1.5
60°	0.7
62.5°	0.7
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P223778

CATALOG NUMBER: LD2B10D010 EU2B10SP159035 2LBDSQLC*MMS

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)