

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P264292

Luminaire Tested: **LD2B10D010 EU2B1010SP159030D2W 2LBD\*GPH**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P264292  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)  
Test Lab: INNOVATION CENTER(G2)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD2B10D010 EU2B1010SP159030D2W 2LBD\*GPH  
Description: 1000 Lumen, 2inch Portfolio LED Downlight  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 549.1 lumens  
Efficiency: N/A  
Efficacy: 53.3 lumens/watt  
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28  
Luminous Opening: Circular (Dia: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 10.3  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P264292

CATALOG NUMBER: LD2B10D010 EU2B1010SP159030D2W 2LBD\*GPH

### Luminous Intensity Polar Plot

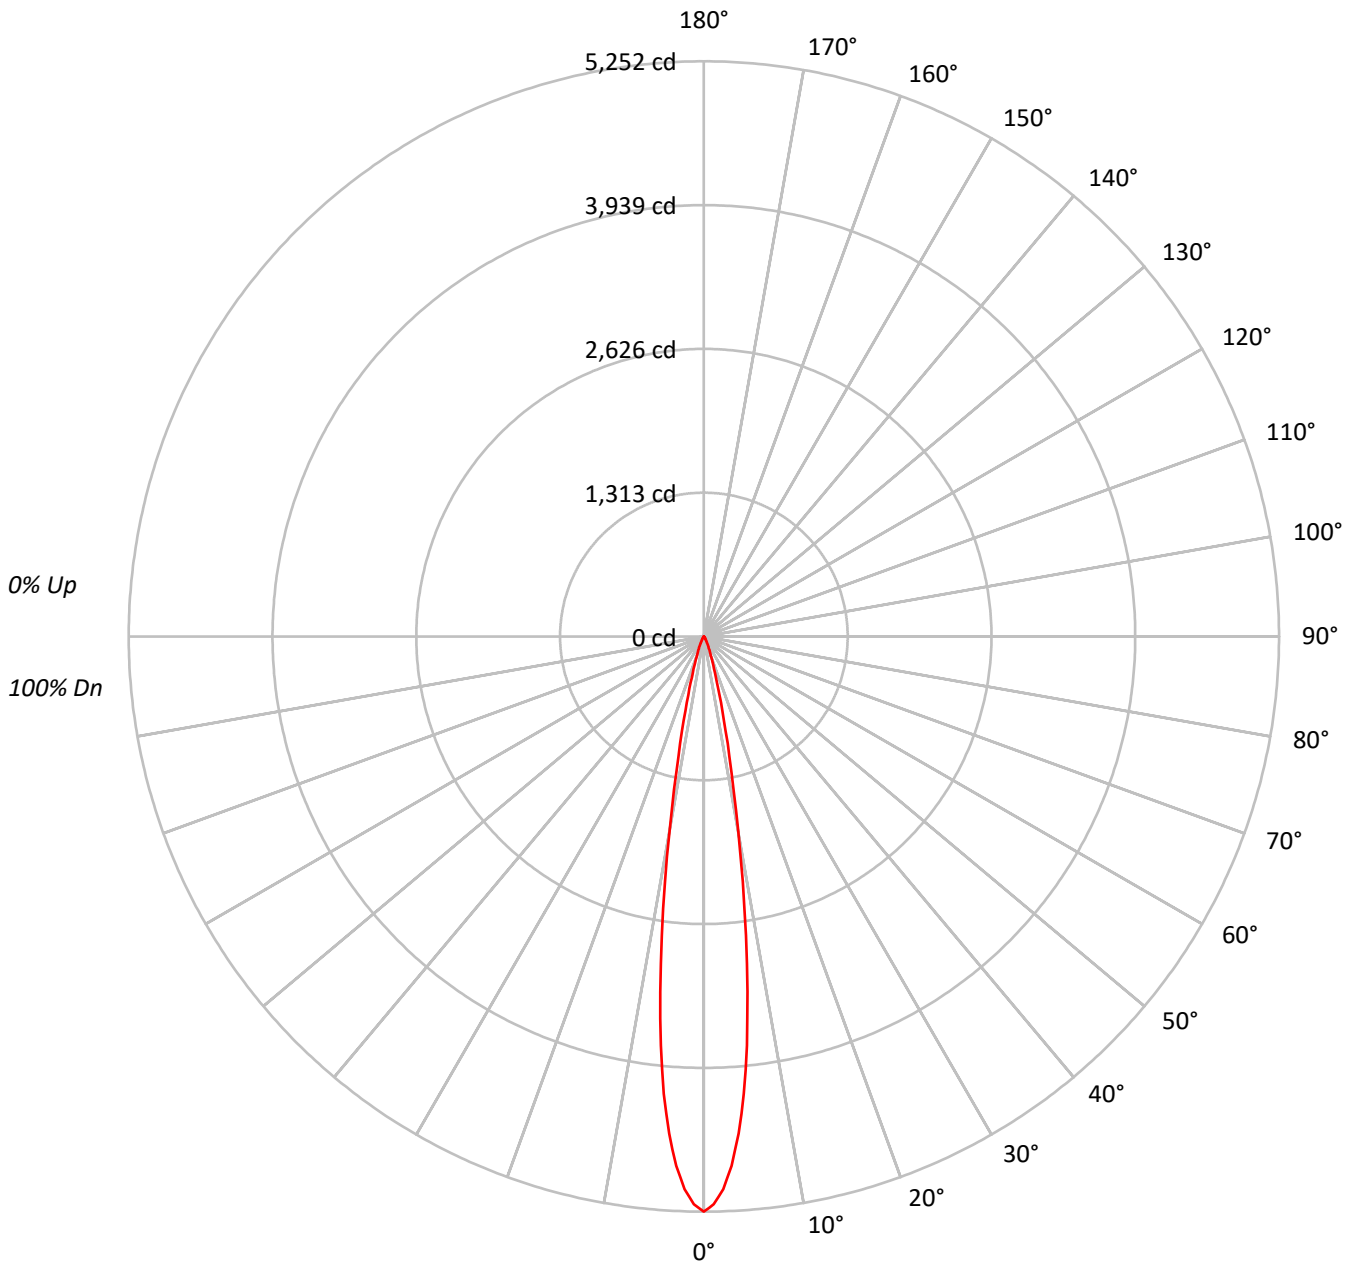



TEST NUMBER: P264292

CATALOG NUMBER: LD2B10D010 EU2B1010SP159030D2W 2LBD\*GPH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90
6	103	98	94	92	102	97	94	91	96	93	91	95	92	90	93	91	90	89
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85
10	95	90	87	85	95	90	87	85	89	86	85	89	86	84	88	86	84	83

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2590889
5°	2076717
10°	906410
15°	280921
20°	97917
25°	43277
30°	19540
35°	10179
40°	5796
45°	2721
50°	1689
55°	946
60°	592
65°	700
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P264292

CATALOG NUMBER: LD2B10D010 EU2B1010SP159030D2W 2LBD\*GPH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	318.4	58.0
10°-20°	174.4	31.8
20°-30°	39.7	7.2
30°-40°	11.4	2.1
40°-50°	3.5	0.6
50°-60°	1.1	0.2
60°-70°	0.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	532.6	97.0
0°-40°	544.0	99.1
0°-60°	548.6	99.9
0°-90°	549.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	549.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	5252	
5°	4193	318
15°	550	174
25°	80	40
35°	17	11
45°	4	4
55°	1	1
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P264292

CATALOG NUMBER: LD2B10D010 EU2B1010SP159030D2W 2LBD\*GPH

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	5251.5
1°	5186.1
2°	5050.4
3°	4839.6
4°	4550.0
5°	4193.3
6°	3756.1
7°	3267.5
8°	2757.6
9°	2264.0
10°	1809.3
11°	1424.4
12°	1121.3
13°	882.4
14°	697.0
15°	550.0
16°	433.9
17°	345.4
18°	277.8
19°	225.9
20°	186.5
22.5°	120.5
25°	79.5
26°	67.0
27°	56.9
28°	47.9
29°	40.0
30°	34.3
32.5°	23.7
35°	16.9
37.5°	12.4
40°	9.0
42.5°	6.2
45°	3.9
47.5°	2.8
50°	2.2
52.5°	1.7
55°	1.1
57.5°	0.6
60°	0.6
62.5°	0.6
65°	0.6
67.5°	0.6



TEST NUMBER: P264292

CATALOG NUMBER: LD2B10D010 EU2B1010SP159030D2W 2LBD\*GPH

**CANDELA DISTRIBUTION (continued):**

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)