

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P264207

Luminaire Tested: **LD2B15D010 EU2B1510SP159024 2LBDC*MMS**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P264207
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B15D010 EU2B1510SP159024 2LBDC*MMS
Description: 1500 Lumen, 2inch Portfolio LED Downlight
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 888.0 lumens
Efficiency: N/A
Efficacy: 62.1 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P264207

CATALOG NUMBER: LD2B15D010 EU2B1510SP159024 2LBDC*MMS

Luminous Intensity Polar Plot

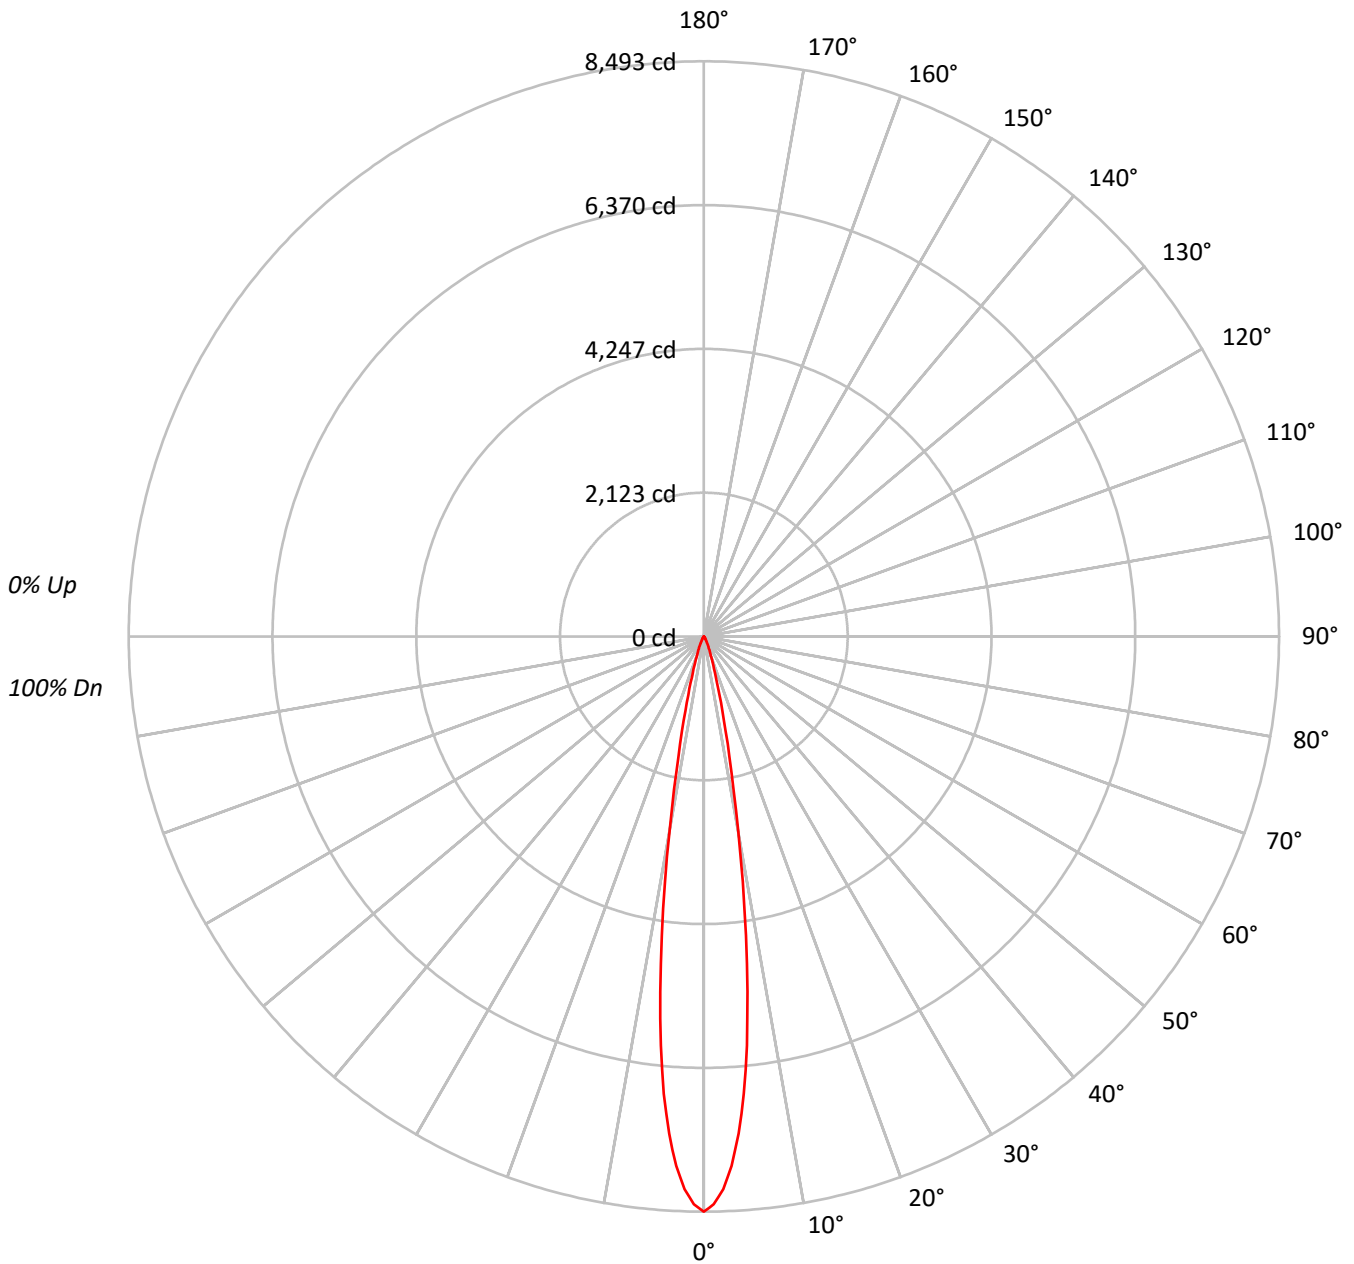



TEST NUMBER: P264207

CATALOG NUMBER: LD2B15D010 EU2B1510SP159024 2LBDC*MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98				98
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96				96
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94				94
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92				92
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90				90
6	103	98	94	92	102	97	94	91	96	93	91	95	92	90	93	91	90	89				89
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87				87
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86				86
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85				85
10	95	90	87	85	95	90	87	85	89	86	85	89	86	84	88	86	84	83				83

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	4190122
5°	3358563
10°	1465896
15°	454275
20°	158347
25°	69951
30°	31674
35°	16442
40°	9403
45°	4465
50°	2763
55°	1548
60°	888
65°	1051
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P264207

CATALOG NUMBER: LD2B15D010 EU2B1510SP159024 2LBDC*MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	515.0	58.0
10°-20°	282.0	31.8
20°-30°	64.3	7.2
30°-40°	18.5	2.1
40°-50°	5.7	0.6
50°-60°	1.7	0.2
60°-70°	0.8	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	861.3	97.0
0°-40°	879.8	99.1
0°-60°	887.2	99.9
0°-90°	888.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	888.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8493	
5°	6782	515
15°	889	282
25°	128	64
35°	27	18
45°	6	6
55°	2	2
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P264207

CATALOG NUMBER: LD2B15D010 EU2B1510SP159024 2LBDC*MMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	8493.0
1°	8387.3
2°	8167.7
3°	7826.9
4°	7358.5
5°	6781.6
6°	6074.5
7°	5284.4
8°	4459.7
9°	3661.5
10°	2926.1
11°	2303.7
12°	1813.4
13°	1427.0
14°	1127.2
15°	889.4
16°	701.7
17°	558.6
18°	449.3
19°	365.4
20°	301.6
22.5°	195.0
25°	128.5
26°	108.4
27°	92.0
28°	77.5
29°	64.7
30°	55.6
32.5°	38.3
35°	27.3
37.5°	20.0
40°	14.6
42.5°	10.0
45°	6.4
47.5°	4.6
50°	3.6
52.5°	2.7
55°	1.8
57.5°	0.9
60°	0.9
62.5°	0.9
65°	0.9
67.5°	0.9



TEST NUMBER: P264207

CATALOG NUMBER: LD2B15D010 EU2B1510SP159024 2LBDC*MMS

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)