

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LD2B15D010 EU2B15WFL559024 2LBD\*LI**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P29153)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD2B15D010 EU2B15WFL559024 2LBD\*LI  
Description: 1500 Lumen, 2inch Portfolio LED Downlight  
WIDE FLOOD OPTIC  
SPUN ROUND TRIM WITH LI FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 941.0 lumens  
Efficiency: N/A  
Efficacy: 65.8 lumens/watt  
Spacing Criteria (0/90/45): 0.73 / 0.73 / 0.8  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#  
CATALOG NUMBER: LD2B15D010 EU2B15WFL559024 2LBD\*LI

### Luminous Intensity Polar Plot

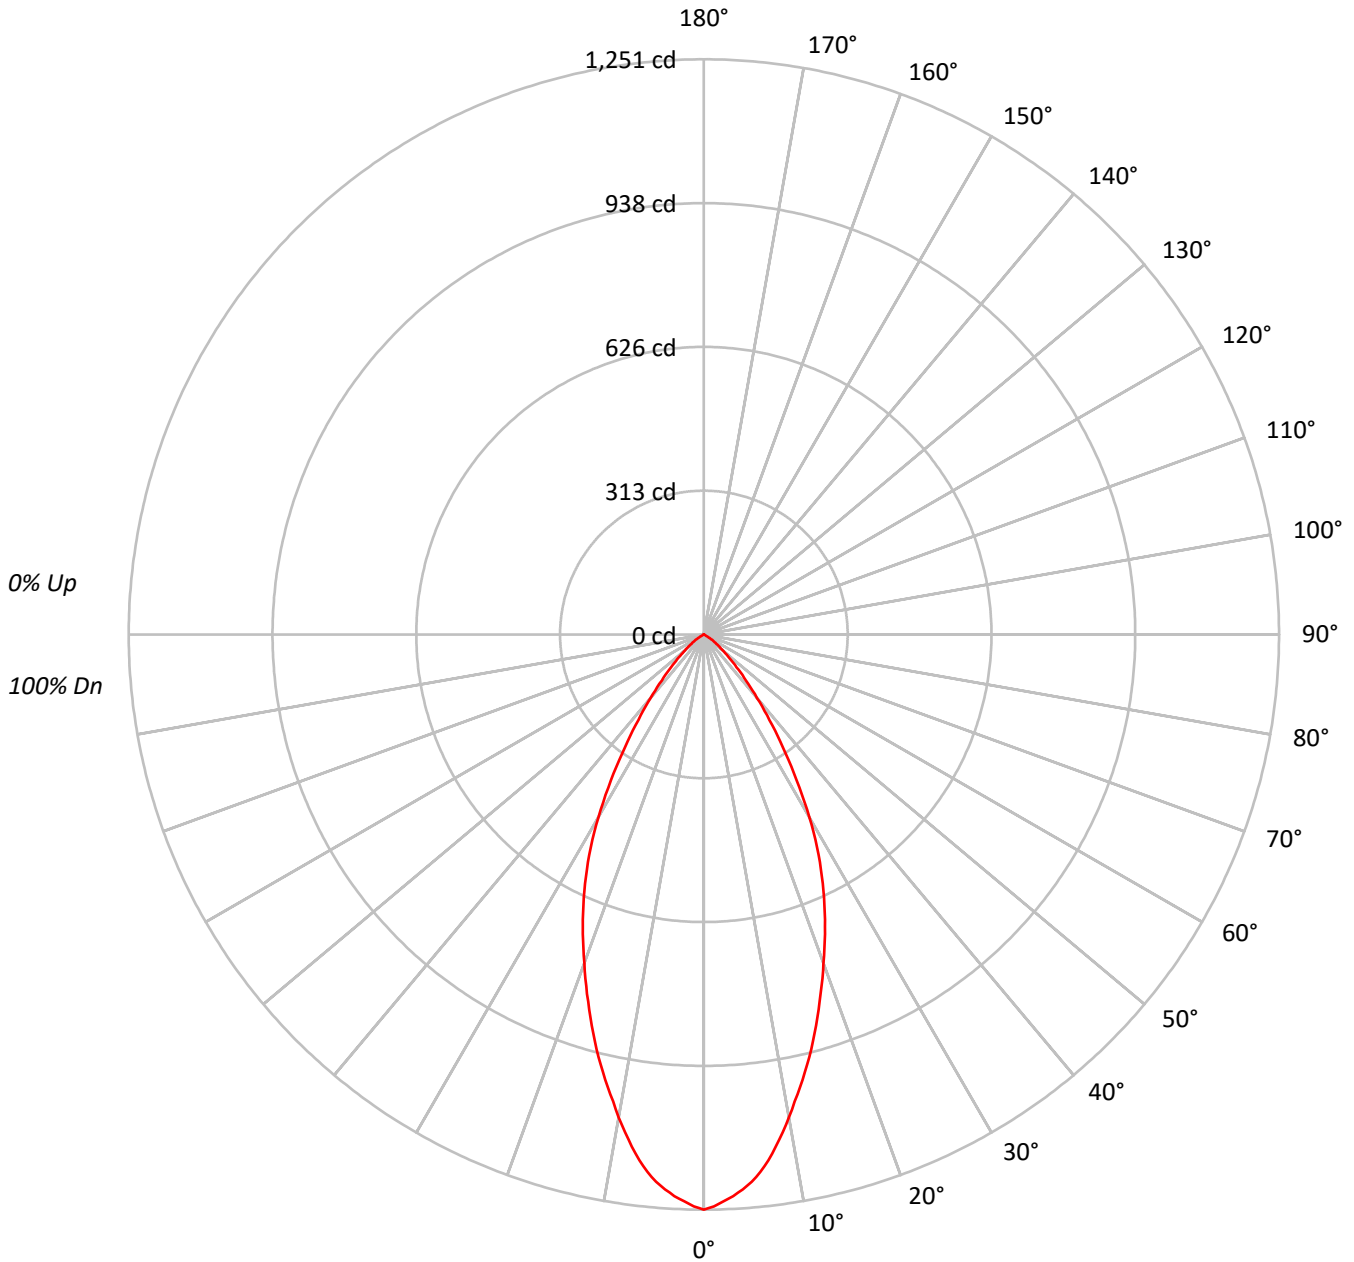



TEST NUMBER: P#

CATALOG NUMBER: LD2B15D010 EU2B15WFL559024 2LBD\*LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	81	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	82	73	67	63	72	66	63	70	66	62	69	65	62	61			
8	79	69	63	59	78	69	63	59	68	62	59	66	62	58	66	61	58	57			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	484570
5°	464491
10°	419477
15°	367526
20°	313564
25°	263015
30°	205162
35°	141433
40°	90864
45°	54943
50°	32239
55°	18098
60°	5190
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P#

CATALOG NUMBER: LD2B15D010 EU2B15WFL559024 2LBD\*LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	109.9	11.7
10°-20°	254.7	27.1
20°-30°	279.9	29.7
30°-40°	189.4	20.1
40°-50°	81.2	8.6
50°-60°	24.8	2.6
60°-70°	1.0	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	644.5	68.5
0°-40°	834.0	88.6
0°-60°	940.0	99.9
0°-90°	941.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	941.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1251	
5°	1195	110
15°	916	255
25°	615	280
35°	299	189
45°	100	81
55°	27	25
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P#

CATALOG NUMBER: LD2B15D010 EU2B15WFL559024 2LBD\*LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1251.0
1°	1244.3
2°	1233.8
3°	1223.3
4°	1209.9
5°	1194.6
6°	1175.5
7°	1152.5
8°	1124.8
9°	1096.2
10°	1066.5
11°	1035.0
12°	1006.3
13°	976.7
14°	947.1
15°	916.5
17.5°	837.2
20°	760.7
22.5°	688.1
25°	615.4
27.5°	540.9
30°	458.7
32.5°	375.6
35°	299.1
37.5°	234.1
40°	179.7
42.5°	135.7
45°	100.3
47.5°	73.6
50°	53.5
52.5°	38.2
55°	26.8
57.5°	17.2
60°	6.7
62.5°	1.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P#

CATALOG NUMBER: LD2B15D010 EU2B15WFL559024 2LBD\*LI

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)