

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P223463

Luminaire Tested: **LD2B15D010 EU2B15NFL258027 2LBDSQC*MB**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P223463
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (155)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B15D010 EU2B15NFL258027 2LBDSQC*MB
Description: 1500 Lumen, 2inch Portfolio LED Downlight
NARROW FLOOD OPTIC
SQUARE CAST TRIM WITH MATTE BLACK FINISH
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1267.8 lumens
Efficiency: N/A
Efficacy: 88.7 lumens/watt
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.35
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P223463

CATALOG NUMBER: LD2B15D010 EU2B15NFL258027 2LBDSQC*MB

Luminous Intensity Polar Plot

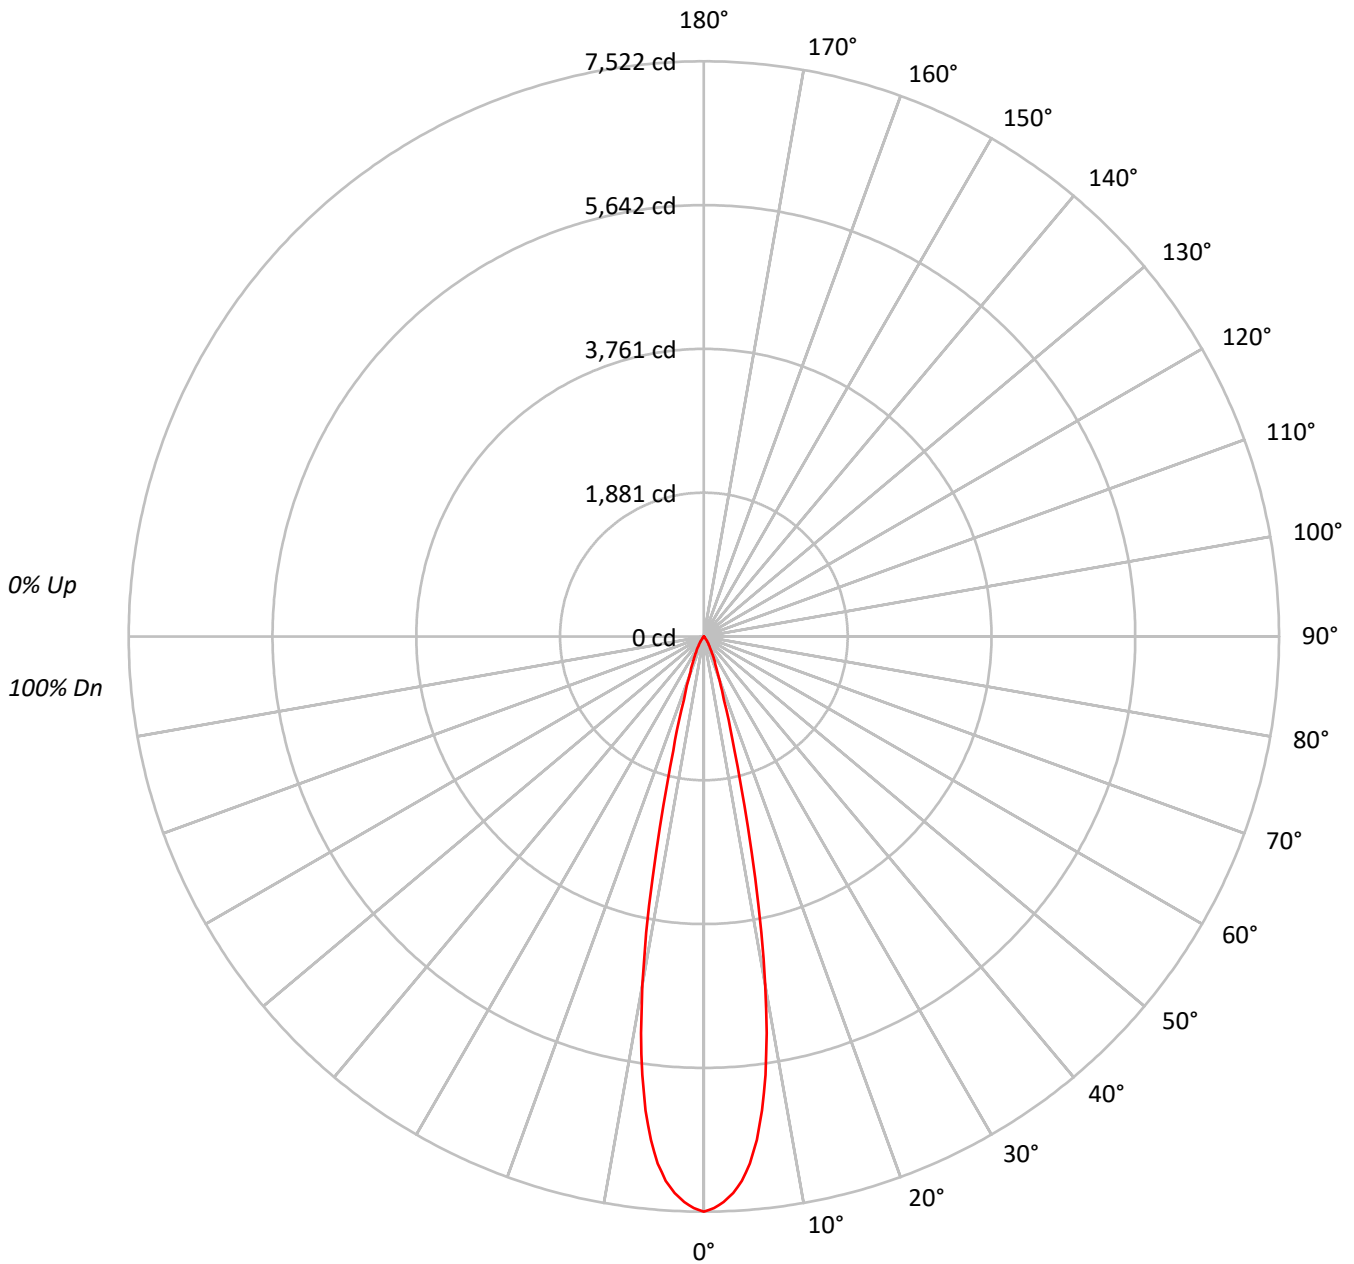



TEST NUMBER: P223463

CATALOG NUMBER: LD2B15D010 EU2B15NFL258027 2LBDSQC*MB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97	97	97	97
2	112	109	106	104	110	107	104	102	104	102	100	101	99	98	98	97	96	95	95	95	95
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	96	95	93	92	92	92	92
4	106	101	97	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90	90	90	90
5	103	98	94	91	102	97	94	91	95	92	90	94	91	89	93	90	89	88	88	88	88
6	101	95	91	89	99	94	91	88	93	90	88	92	89	87	91	88	87	86	86	86	86
7	98	92	89	86	97	92	88	86	91	88	85	90	87	85	89	87	85	84	84	84	84
8	96	90	86	84	95	90	86	84	89	86	83	88	85	83	87	85	83	82	82	82	82
9	94	88	84	82	93	88	84	82	87	84	82	86	83	81	85	83	81	80	80	80	80
10	92	86	82	80	91	86	82	80	85	82	80	84	82	80	84	81	79	79	79	79	79

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2913617
5°	2690206
10°	1820921
15°	619520
20°	227537
25°	120609
30°	61991
35°	28939
40°	9456
45°	4766
50°	2230
55°	810
60°	930
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P223463

CATALOG NUMBER: LD2B15D010 EU2B15NFL258027 2LBDSQC*MB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	588.5	46.4
10°-20°	494.8	39.0
20°-30°	135.8	10.7
30°-40°	39.6	3.1
40°-50°	7.3	0.6
50°-60°	1.6	0.1
60°-70°	0.1	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1219.2	96.2
0°-40°	1258.8	99.3
0°-60°	1267.7	100.0
0°-90°	1267.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1267.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7522	
5°	6919	589
15°	1545	495
25°	282	136
35°	61	40
45°	9	7
55°	1	2
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P223463

CATALOG NUMBER: LD2B15D010 EU2B15NFL258027 2LBDSQC*MB

CANDELA DISTRIBUTION (FULL):

	0°
0°	7522.0
1°	7478.3
2°	7400.8
3°	7289.7
4°	7137.3
5°	6918.8
6°	6620.3
7°	6246.9
8°	5791.0
9°	5252.8
10°	4629.6
11°	3946.4
12°	3235.8
13°	2557.7
14°	1979.5
15°	1544.9
17.5°	871.7
20°	552.0
22.5°	393.4
25°	282.2
27.5°	199.8
30°	138.6
32.5°	97.4
35°	61.2
37.5°	25.0
40°	18.7
42.5°	13.7
45°	8.7
47.5°	5.0
50°	3.7
52.5°	2.5
55°	1.2
57.5°	1.2
60°	1.2
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P223463

CATALOG NUMBER: LD2B15D010 EU2B15NFL258027 2LBDSQC*MB

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)