

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P225051

Luminaire Tested: **LD2B15D010 EU2B15FL409027 2LBD*WMH**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P225051
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14830)
Test Lab: INNOVATION CENTER (G1)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B15D010 EU2B15FL409027 2LBD*WMH
Description: 1500 Lumen, 2inch Portfolio LED Downlight
FLOOD OPTIC
SPUN ROUND TRIM WITH WHEAT METALLIC HAZE FINISH
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1000.3 lumens
Efficiency: N/A
Efficacy: 70.0 lumens/watt
Spacing Criteria (0/90/45): 0.61 / 0.61 / 0.59
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P225051

CATALOG NUMBER: LD2B15D010 EU2B15FL409027 2LBD*WMH

Luminous Intensity Polar Plot

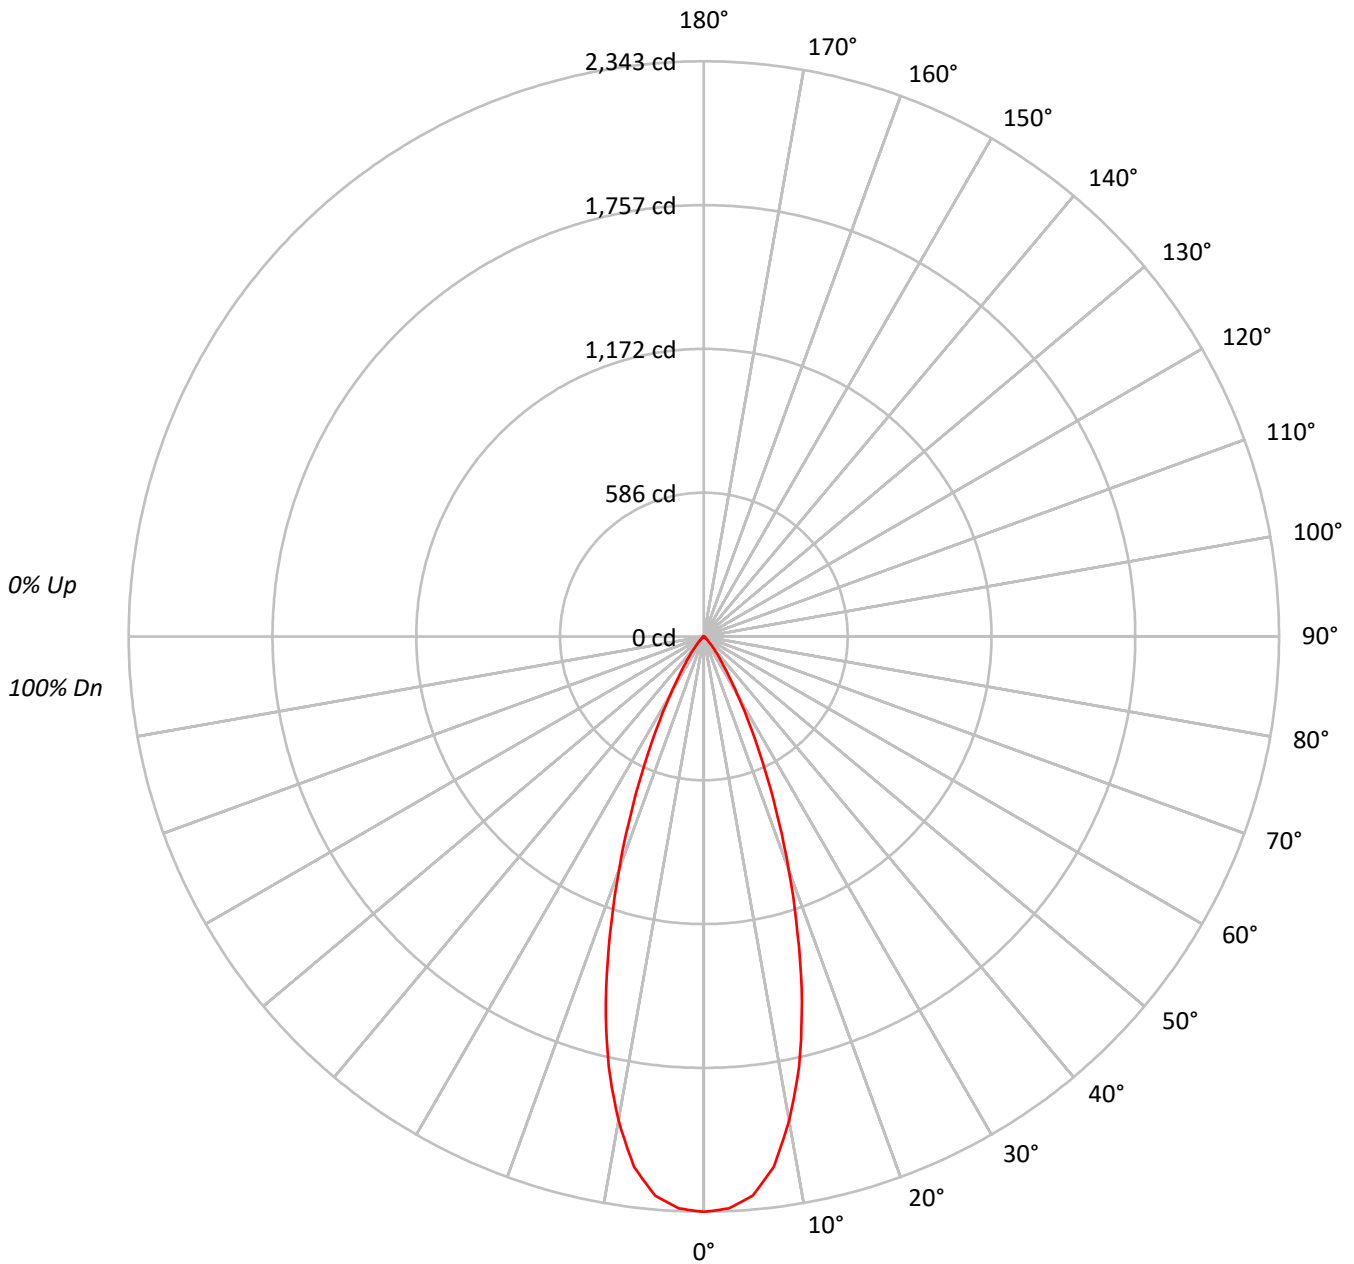



TEST NUMBER: P225051

CATALOG NUMBER: LD2B15D010 EU2B15FL409027 2LBD*WMH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95				95															
2	110	106	102	100	108	104	101	98	101	98	96	98	96	94	95	94	92	91				91															
3	106	100	96	93	104	99	95	92	96	93	91	94	91	89	92	90	88	87				87															
4	102	95	91	87	100	94	90	87	92	89	86	90	87	85	88	86	84	83				83															
5	98	91	86	82	96	90	85	82	88	84	81	87	83	81	85	82	80	79				79															
6	94	87	82	78	93	86	81	78	85	81	77	83	80	77	82	79	77	75				75															
7	91	83	78	75	89	82	78	74	81	77	74	80	76	74	79	76	73	72				72															
8	87	79	75	71	86	79	74	71	78	74	71	77	73	71	76	73	70	69				69															
9	84	76	71	68	83	76	71	68	75	71	68	74	70	68	73	70	67	66				66															
10	81	73	69	65	80	73	68	65	72	68	65	72	68	65	71	67	65	64				64															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	907707
5°	888972
10°	787547
15°	618839
20°	416080
25°	241731
30°	120807
35°	56980
40°	26951
45°	11832
50°	6086
55°	3444
60°	1937
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P225051

CATALOG NUMBER: LD2B15D010 EU2B15FL409027 2LBD*WMH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.2	20.9
10°-20°	418.6	41.8
20°-30°	264.6	26.5
30°-40°	82.8	8.3
40°-50°	19.2	1.9
50°-60°	5.0	0.5
60°-70°	0.9	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	892.3	89.2
0°-40°	975.1	97.5
0°-60°	999.4	99.9
0°-90°	1000.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1000.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2343	
5°	2286	209
15°	1543	419
25°	566	265
35°	120	83
45°	22	19
55°	5	5
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P225051

CATALOG NUMBER: LD2B15D010 EU2B15FL409027 2LBD*WMH

CANDELA DISTRIBUTION (FULL):

	0°
0°	2343.4
2.5°	2332.0
5°	2286.3
7.5°	2178.5
10°	2002.3
12.5°	1793.0
15°	1543.2
17.5°	1270.6
20°	1009.4
22.5°	768.4
25°	565.6
27.5°	399.4
30°	270.1
32.5°	180.1
35°	120.5
37.5°	81.2
40°	53.3
42.5°	33.0
45°	21.6
47.5°	15.2
50°	10.1
52.5°	7.6
55°	5.1
57.5°	3.8
60°	2.5
62.5°	2.5
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)