

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P264000

Luminaire Tested: **LD2B15D010 EU2B1510SP158030 2LBSQC*MB**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P264000
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B15D010 EU2B1510SP158030 2LBSQC*MB
Description: 1500 Lumen, 2inch Portfolio LED Downlight
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1281.0 lumens
Efficiency: N/A
Efficacy: 89.6 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P264000

CATALOG NUMBER: LD2B15D010 EU2B1510SP158030 2LBSQC*MB

Luminous Intensity Polar Plot

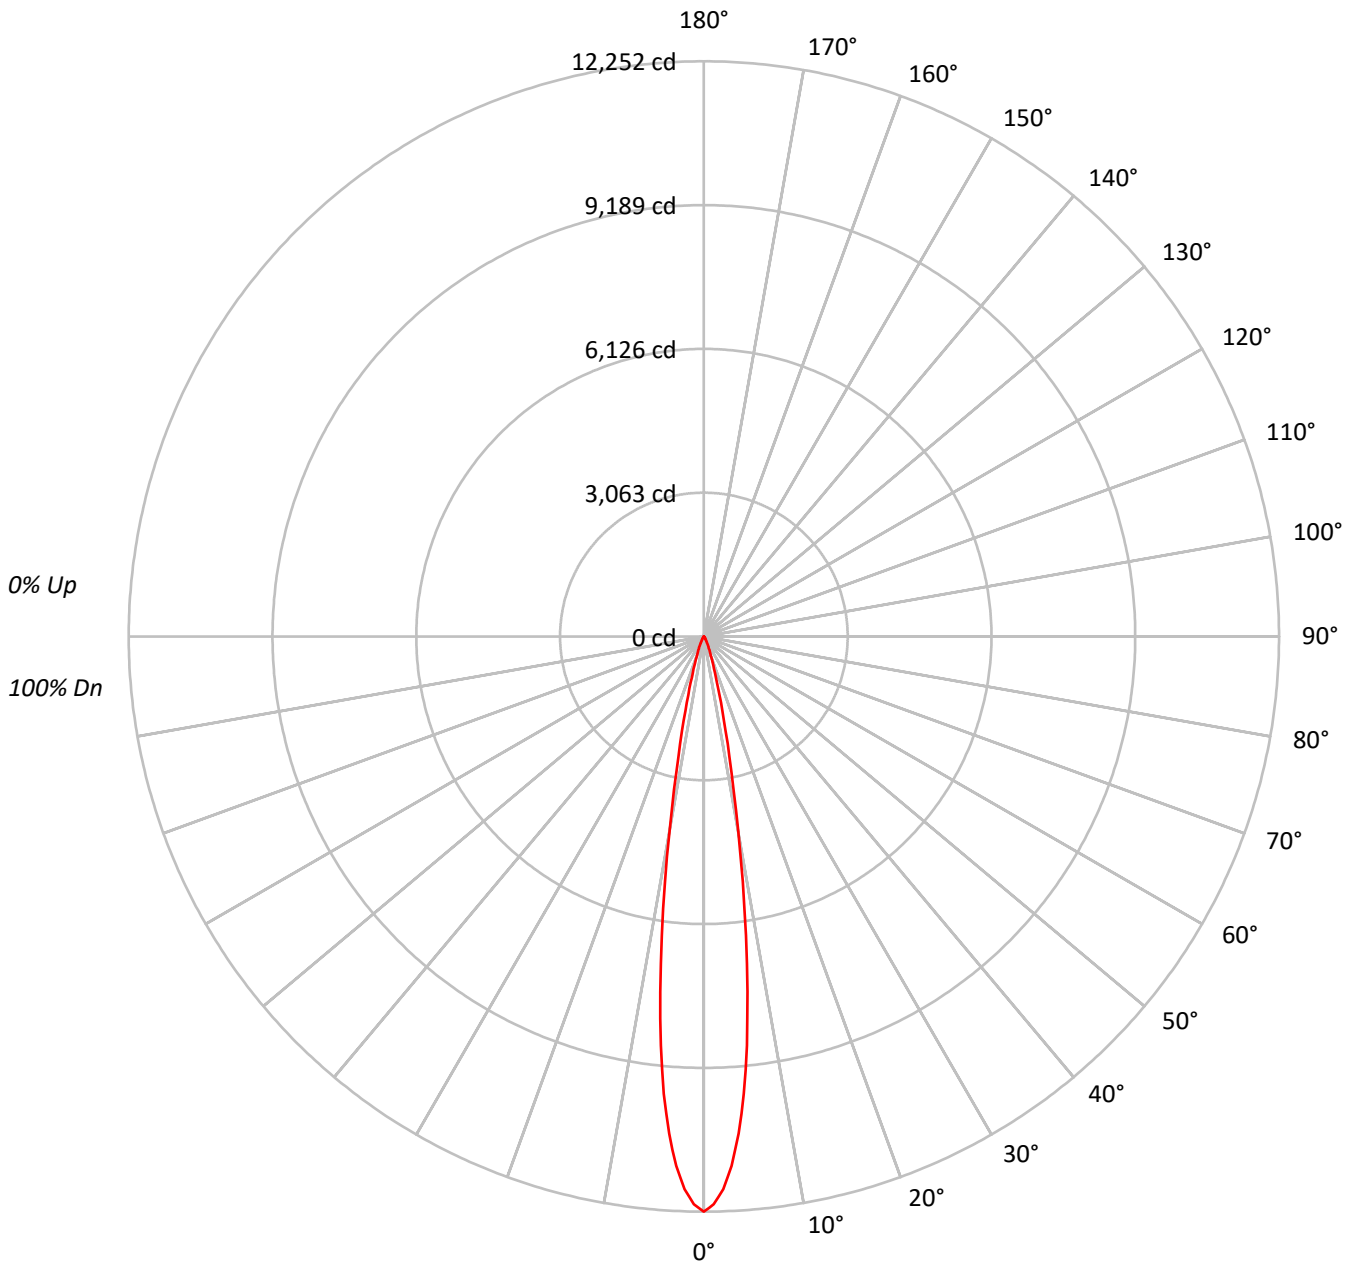



TEST NUMBER: P264000

CATALOG NUMBER: LD2B15D010 EU2B1510SP158030 2LBSQC*MB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98			98
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96			96
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94			94
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92			92
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90			90
6	103	98	94	92	102	97	94	91	96	93	91	95	92	90	93	91	90	89			89
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87			87
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86			86
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85			85
10	95	90	87	85	95	90	87	85	89	86	85	89	86	84	88	86	84	83			83

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	6044521
5°	4844995
10°	2114656
15°	655312
20°	228438
25°	100925
30°	45689
35°	23730
40°	13525
45°	6419
50°	4068
55°	2236
60°	1283
65°	1518
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P264000

CATALOG NUMBER: LD2B15D010 EU2B1510SP158030 2LBSQC*MB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	742.9	58.0
10°-20°	406.9	31.8
20°-30°	92.7	7.2
30°-40°	26.6	2.1
40°-50°	8.2	0.6
50°-60°	2.5	0.2
60°-70°	1.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1242.5	97.0
0°-40°	1269.1	99.1
0°-60°	1279.8	99.9
0°-90°	1281.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1281.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12252	
5°	9783	743
15°	1283	407
25°	185	93
35°	39	27
45°	9	8
55°	3	2
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P264000

CATALOG NUMBER: LD2B15D010 EU2B1510SP158030 2LBSQC*MB

CANDELA DISTRIBUTION (FULL):

	0°
0°	12251.7
1°	12099.2
2°	11782.4
3°	11290.8
4°	10615.1
5°	9783.0
6°	8762.9
7°	7623.2
8°	6433.5
9°	5281.9
10°	4221.1
11°	3323.2
12°	2616.0
13°	2058.6
14°	1626.1
15°	1283.0
16°	1012.2
17°	805.8
18°	648.1
19°	527.1
20°	435.1
22.5°	281.3
25°	185.4
26°	156.4
27°	132.8
28°	111.7
29°	93.3
30°	80.2
32.5°	55.2
35°	39.4
37.5°	28.9
40°	21.0
42.5°	14.5
45°	9.2
47.5°	6.6
50°	5.3
52.5°	3.9
55°	2.6
57.5°	1.3
60°	1.3
62.5°	1.3
65°	1.3
67.5°	1.3



TEST NUMBER: P264000

CATALOG NUMBER: LD2B15D010 EU2B1510SP158030 2LBSQC*MB

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)