

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P224349

Luminaire Tested: **LD2B15D010 EU2B15FL409030 2LBDSQC\*MMS**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P224349  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14831)  
Test Lab: INNOVATION CENTER (G1)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD2B15D010 EU2B15FL409030 2LBDSQC\*MMS  
Description: 1500 Lumen, 2inch Portfolio LED Downlight  
FLOOD OPTIC  
SQUARE CAST TRIM WITH MATTE METALLIC SILVER  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1057.8 lumens  
Efficiency: N/A  
Efficacy: 74.0 lumens/watt  
Spacing Criteria (0/90/45): 0.61 / 0.61 / 0.59  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P224349

CATALOG NUMBER: LD2B15D010 EU2B15FL409030 2LBDSQC\*MMS

### Luminous Intensity Polar Plot

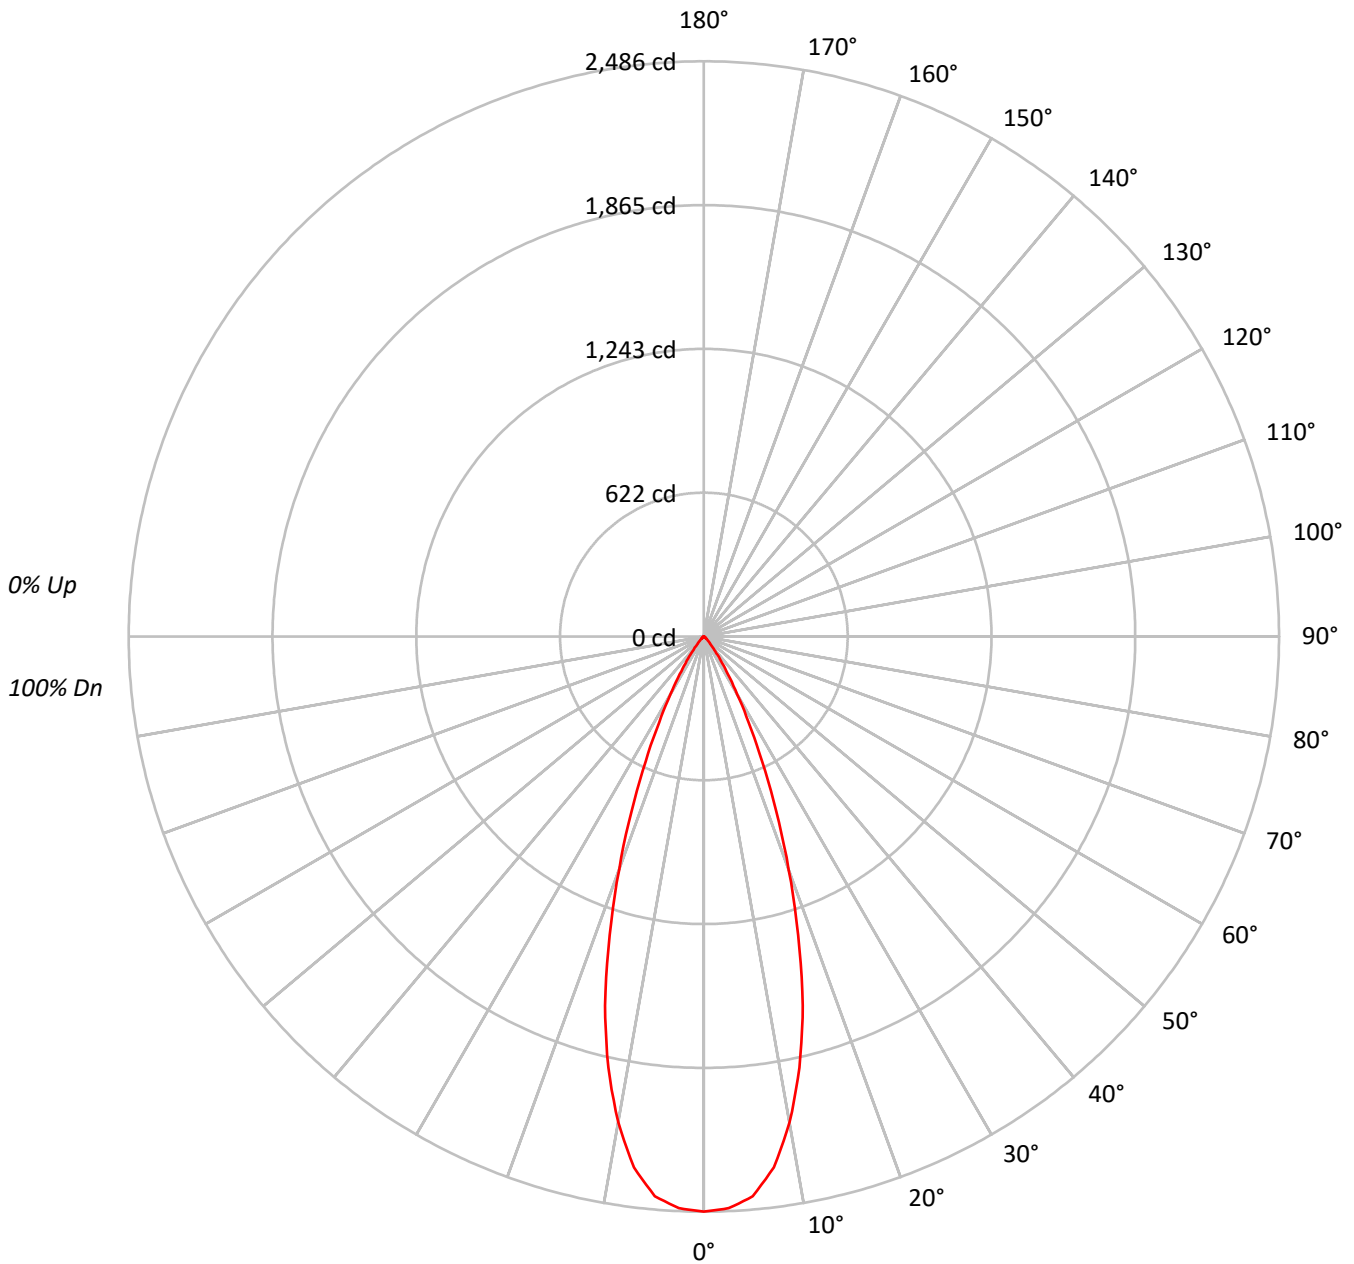



TEST NUMBER: P224349

CATALOG NUMBER: LD2B15D010 EU2B15FL409030 2LBDSQC\*MMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95			95
2	110	106	102	100	108	104	101	99	101	99	96	98	96	94	95	94	92	91			91
3	106	100	96	93	104	99	95	92	97	93	91	94	92	89	92	90	88	87			87
4	102	95	91	87	100	94	90	87	92	89	86	90	87	85	89	86	84	83			83
5	98	91	86	83	96	90	86	82	88	85	82	87	83	81	85	82	80	79			79
6	94	87	82	78	93	86	82	78	85	81	78	83	80	77	82	79	77	76			76
7	91	83	78	75	89	82	78	75	81	77	74	80	77	74	79	76	73	72			72
8	87	80	75	71	86	79	75	71	78	74	71	77	73	71	76	73	70	69			69
9	84	76	72	68	83	76	71	68	75	71	68	74	71	68	74	70	68	67			67
10	81	74	69	66	81	73	69	66	72	68	65	72	68	65	71	68	65	64			64

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	962865
5°	944380
10°	838915
15°	662028
20°	441554
25°	254126
30°	128724
35°	60337
40°	24726
45°	11175
50°	5725
55°	3647
60°	2092
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P224349

CATALOG NUMBER: LD2B15D010 EU2B15FL409030 2LBDSQC\*MMS

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	222.3	21.0
10°-20°	446.1	42.2
20°-30°	279.4	26.4
30°-40°	86.5	8.2
40°-50°	17.9	1.7
50°-60°	5.0	0.5
60°-70°	0.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	947.8	89.6
0°-40°	1034.3	97.8
0°-60°	1057.2	99.9
0°-90°	1057.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1057.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2486	
5°	2429	222
15°	1651	446
25°	595	279
35°	128	86
45°	20	18
55°	5	5
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P224349

CATALOG NUMBER: LD2B15D010 EU2B15FL409030 2LBDSQC\*MMS

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2485.8
2.5°	2473.6
5°	2428.8
7.5°	2314.8
10°	2132.9
12.5°	1908.8
15°	1650.9
17.5°	1353.6
20°	1071.2
22.5°	814.6
25°	594.6
27.5°	418.2
30°	287.8
32.5°	192.8
35°	127.6
37.5°	80.1
40°	48.9
42.5°	31.2
45°	20.4
47.5°	13.6
50°	9.5
52.5°	6.8
55°	5.4
57.5°	4.1
60°	2.7
62.5°	1.4
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







(END OF REPORT)