

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P222754

Luminaire Tested: **LD2B15D010 EU2B15NFL259030 2LBDLC*MW**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P222754
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (155)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B15D010 EU2B15NFL259030 2LBDLC*MW
Description: 1500 Lumen, 2inch Portfolio LED Downlight
NARROW FLOOD OPTIC
LENSED CAST ROUND TRIM WITH MATTE WHITE FINISH
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1038.0 lumens
Efficiency: N/A
Efficacy: 72.6 lumens/watt
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.35
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P222754

CATALOG NUMBER: LD2B15D010 EU2B15NFL259030 2LBDLC*MW

Luminous Intensity Polar Plot

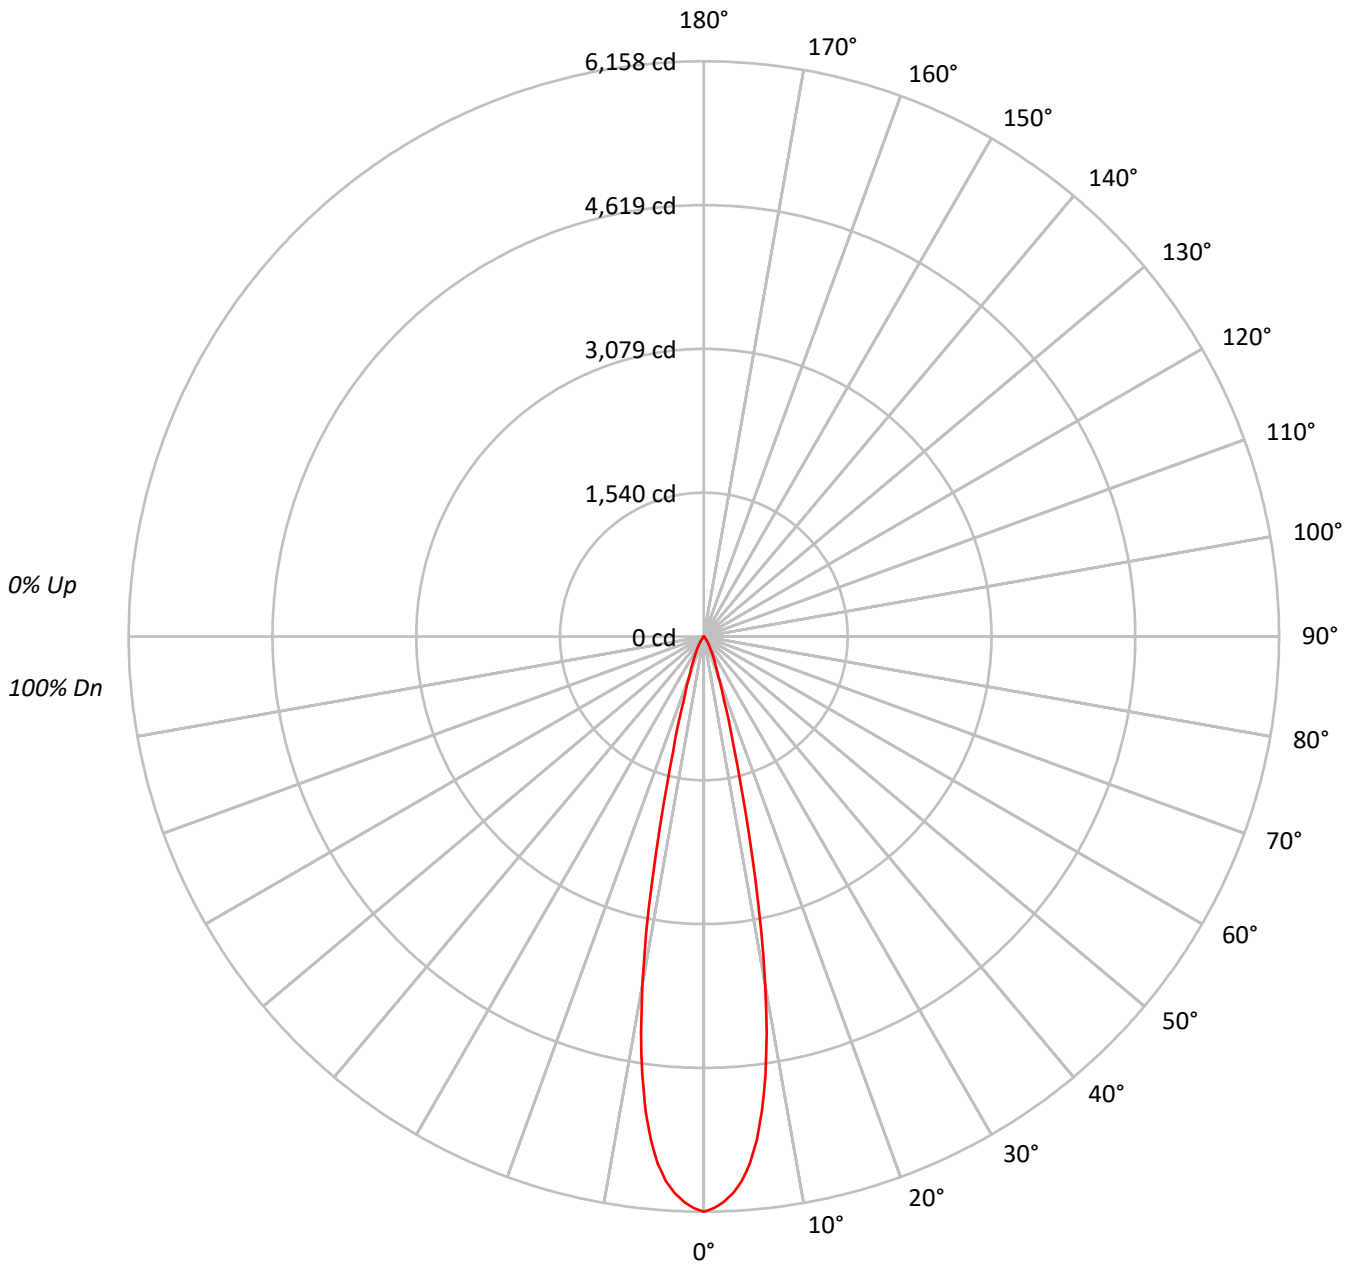



TEST NUMBER: P222754

CATALOG NUMBER: LD2B15D010 EU2B15NFL259030 2LBDLC*MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	99	97
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97	97	96	95
2	112	109	106	104	110	107	104	102	104	102	100	101	99	98	98	97	96	95	95	93	92
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	96	95	93	92	92	91	90
4	106	101	97	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90	89	88	88
5	103	98	94	91	102	97	94	91	95	92	90	94	91	89	93	90	89	88	87	86	86
6	101	95	91	89	99	94	91	88	93	90	88	92	89	87	91	88	87	86	85	84	84
7	98	92	89	86	97	92	88	86	91	88	85	90	87	85	89	87	85	84	83	82	82
8	96	90	86	84	95	90	86	84	89	86	83	88	85	83	87	85	83	82	81	80	80
9	94	88	84	82	93	88	84	82	87	84	82	86	83	81	85	83	81	80	79	79	79
10	92	86	82	80	91	86	82	80	85	82	80	84	82	80	84	81	79	79	79	79	79

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2385315
5°	2202386
10°	1490728
15°	507157
20°	186275
25°	98770
30°	50765
35°	23690
40°	7736
45°	3944
50°	1868
55°	675
60°	775
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P222754

CATALOG NUMBER: LD2B15D010 EU2B15NFL259030 2LBDLC*MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	481.8	46.4
10°-20°	405.1	39.0
20°-30°	111.2	10.7
30°-40°	32.4	3.1
40°-50°	6.0	0.6
50°-60°	1.3	0.1
60°-70°	0.1	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	998.1	96.2
0°-40°	1030.5	99.3
0°-60°	1037.9	100.0
0°-90°	1038.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1038.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6158	
5°	5664	482
15°	1265	405
25°	231	111
35°	50	32
45°	7	6
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P222754

CATALOG NUMBER: LD2B15D010 EU2B15NFL259030 2LBDLC*MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	6158.1
1°	6122.3
2°	6058.9
3°	5967.9
4°	5843.2
5°	5664.2
6°	5419.9
7°	5114.2
8°	4741.0
9°	4300.3
10°	3790.1
11°	3230.9
12°	2649.1
13°	2093.9
14°	1620.5
15°	1264.7
17.5°	713.7
20°	451.9
22.5°	322.1
25°	231.1
27.5°	163.6
30°	113.5
32.5°	79.7
35°	50.1
37.5°	20.4
40°	15.3
42.5°	11.2
45°	7.2
47.5°	4.1
50°	3.1
52.5°	2.0
55°	1.0
57.5°	1.0
60°	1.0
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P222754

CATALOG NUMBER: LD2B15D010 EU2B15NFL259030 2LBDLC*MW

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)