

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P#

Luminaire Tested: **LD2B15D010 EU2B15WFL559730 2LBD\*LI**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P#  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P29153)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD2B15D010 EU2B15WFL559730 2LBD\*LI  
Description: 1500 Lumen, 2inch Portfolio LED Downlight  
WIDE FLOOD OPTIC  
SPUN ROUND TRIM WITH LI FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 971.5 lumens  
Efficiency: N/A  
Efficacy: 67.9 lumens/watt  
Spacing Criteria (0/90/45): 0.73 / 0.73 / 0.8  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P#  
CATALOG NUMBER: LD2B15D010 EU2B15WFL559730 2LBD\*LI

### Luminous Intensity Polar Plot

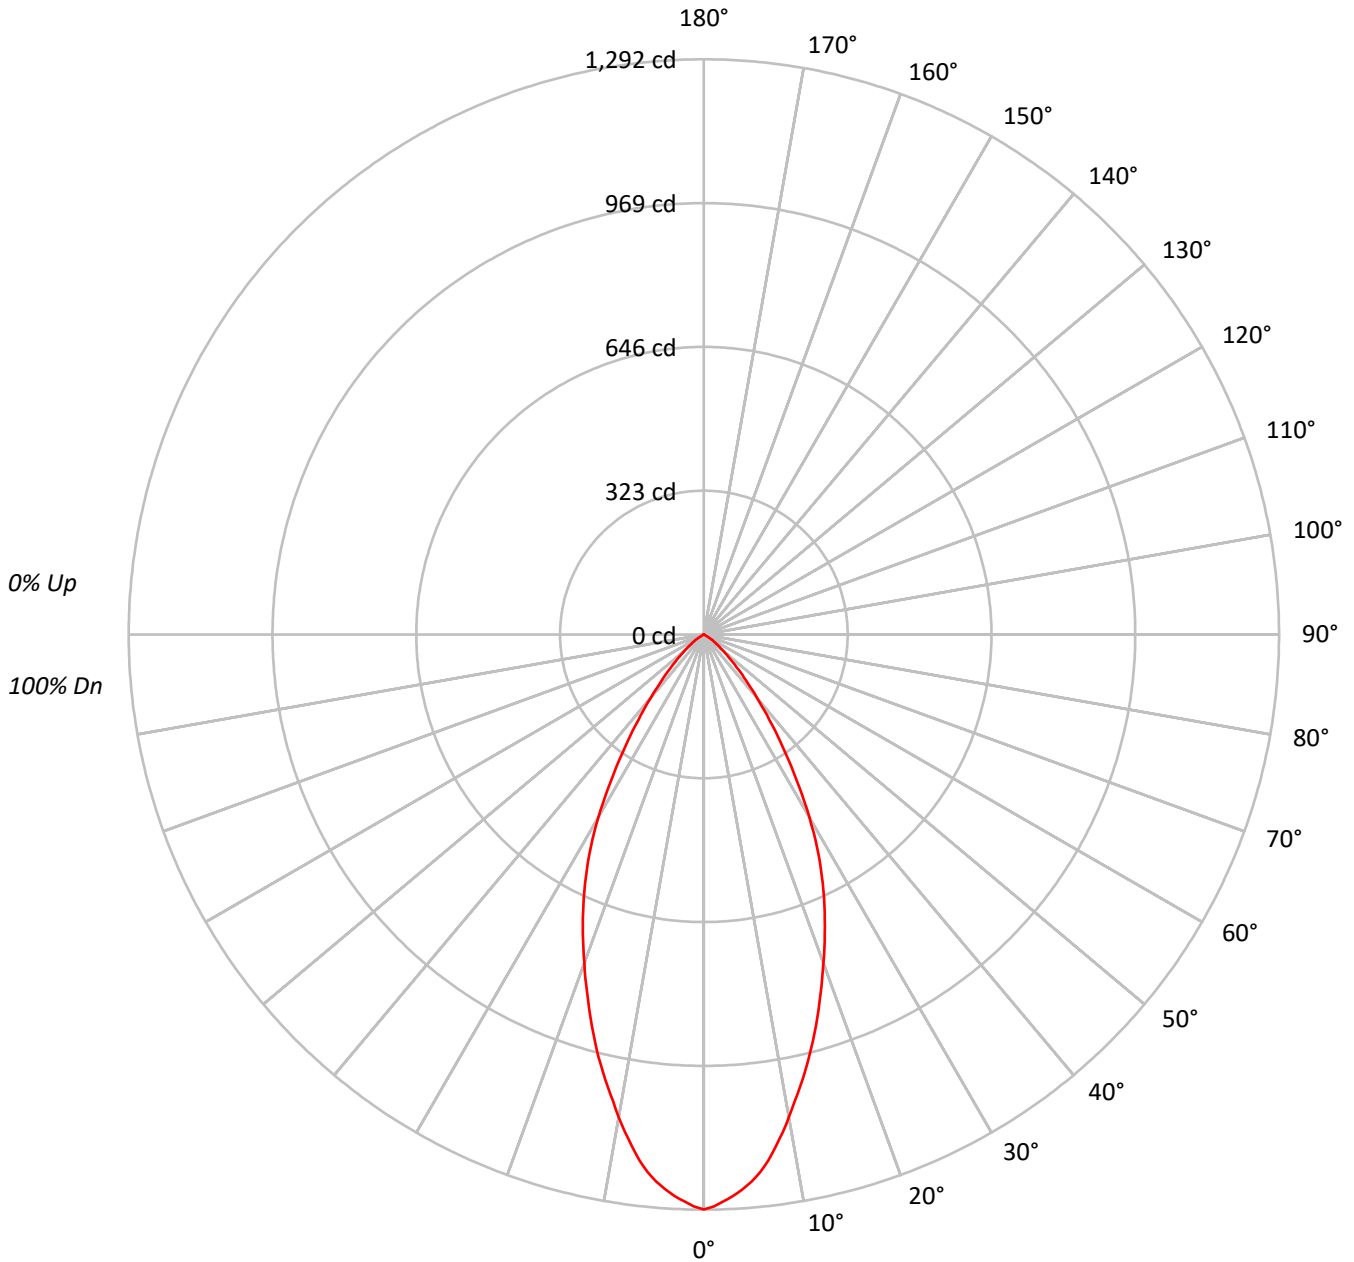



TEST NUMBER: P#

CATALOG NUMBER: LD2B15D010 EU2B15WFL559730 2LBD\*LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	109	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	81	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	82	73	67	63	72	66	63	70	66	62	69	65	62	61			
8	79	69	63	59	78	69	63	59	68	62	59	66	62	58	66	61	58	57			
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53			
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	500257
5°	479539
10°	433086
15°	379436
20°	323746
25°	271563
30°	211826
35°	146020
40°	93797
45°	56751
50°	33324
55°	18639
60°	5345
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P#

CATALOG NUMBER: LD2B15D010 EU2B15WFL559730 2LBD\*LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	113.5	11.7
10°-20°	263.0	27.1
20°-30°	289.0	29.7
30°-40°	195.6	20.1
40°-50°	83.8	8.6
50°-60°	25.6	2.6
60°-70°	1.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	665.4	68.5
0°-40°	861.0	88.6
0°-60°	970.5	99.9
0°-90°	971.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	971.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1292	
5°	1233	113
15°	946	263
25°	635	289
35°	309	196
45°	104	84
55°	28	26
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P#

CATALOG NUMBER: LD2B15D010 EU2B15WFL559730 2LBD\*LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1291.5
1°	1284.6
2°	1273.8
3°	1262.9
4°	1249.1
5°	1233.3
6°	1213.6
7°	1189.9
8°	1161.3
9°	1131.7
10°	1101.1
11°	1068.5
12°	1038.9
13°	1008.3
14°	977.8
15°	946.2
17.5°	864.3
20°	785.4
22.5°	710.4
25°	635.4
27.5°	558.4
30°	473.6
32.5°	387.8
35°	308.8
37.5°	241.7
40°	185.5
42.5°	140.1
45°	103.6
47.5°	76.0
50°	55.3
52.5°	39.5
55°	27.6
57.5°	17.8
60°	6.9
62.5°	1.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P#

CATALOG NUMBER: LD2B15D010 EU2B15WFL559730 2LBD\*LI

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)