

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P223329

Luminaire Tested: **LD2B15D010 EU2B15NFL258035 2LBDL\*GPH**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P223329  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (155)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD2B15D010 EU2B15NFL258035 2LBDL\*GPH  
Description: 1500 Lumen, 2inch Portfolio LED Downlight  
NARROW FLOOD OPTIC  
LENSED SPUN ROUND TRIM WITH GRAPHITE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1302.0 lumens  
Efficiency: N/A  
Efficacy: 91.0 lumens/watt  
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.35  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 14.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P223329

CATALOG NUMBER: LD2B15D010 EU2B15NFL258035 2LBDL\*GPH

### Luminous Intensity Polar Plot

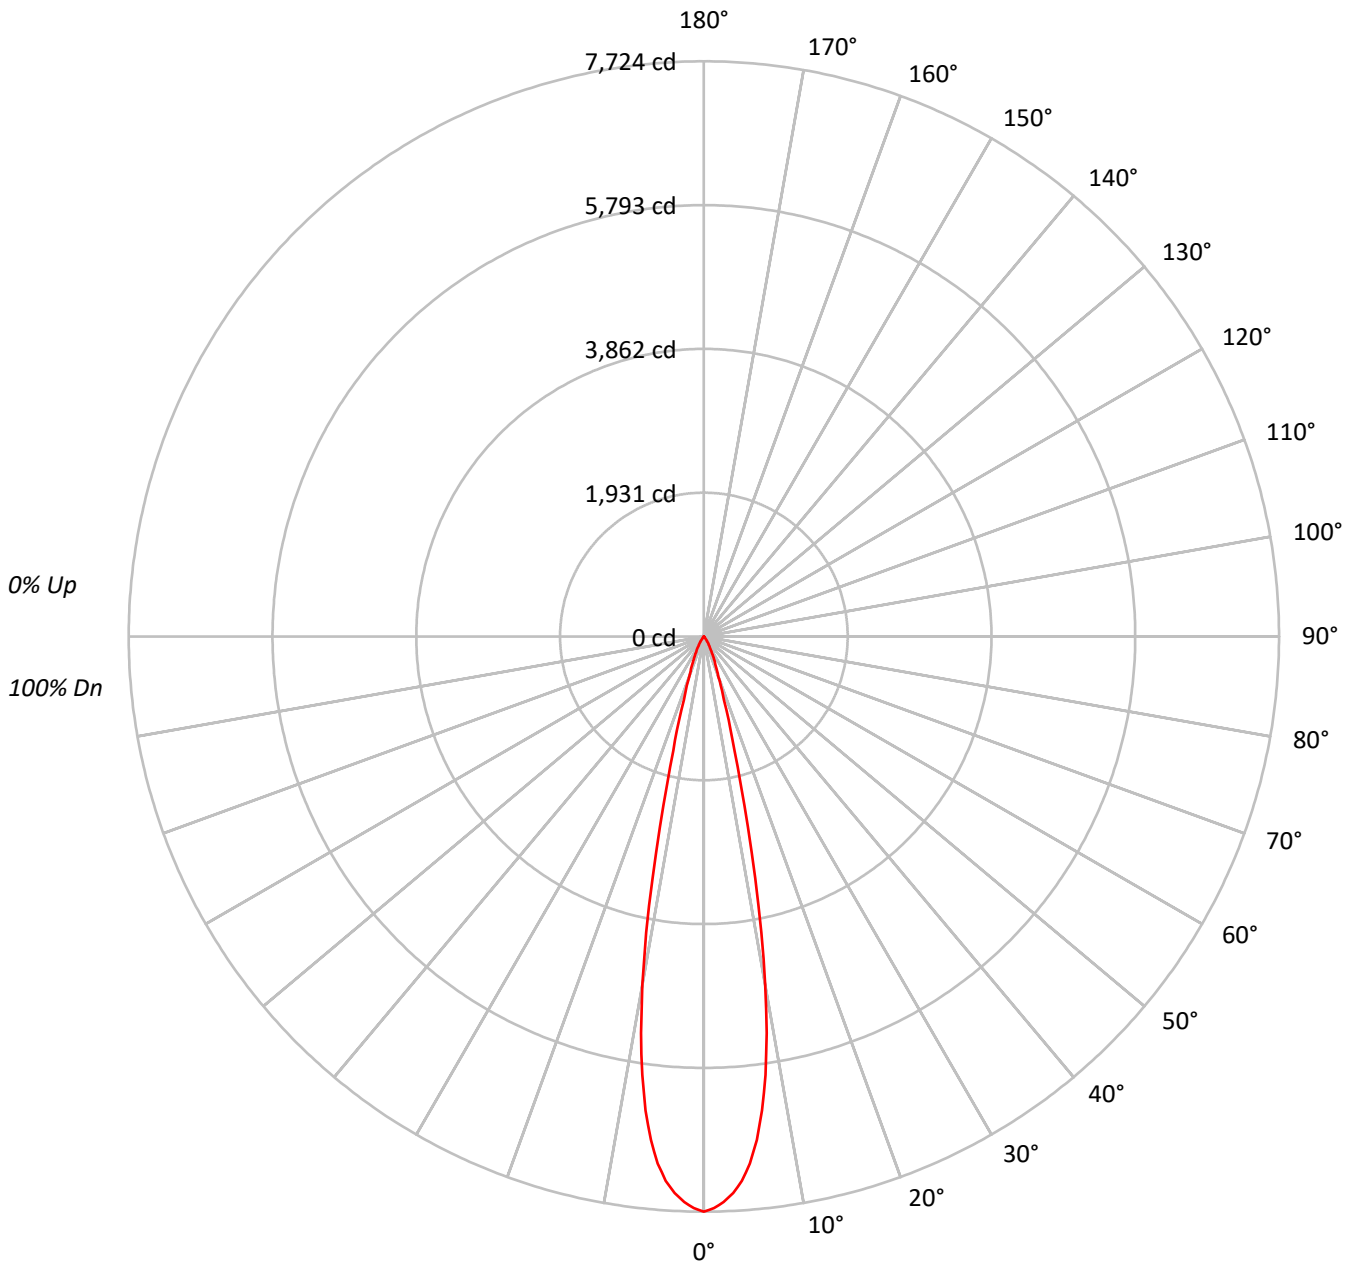



TEST NUMBER: P223329

CATALOG NUMBER: LD2B15D010 EU2B15NFL258035 2LBDL\*GPH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97
2	112	109	106	104	110	107	104	102	104	102	100	101	99	98	98	97	96	95
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	96	95	93	92
4	106	101	97	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90
5	103	98	94	91	102	97	94	91	95	92	90	94	91	89	93	90	89	88
6	101	95	91	89	99	94	91	88	93	90	88	92	89	87	91	88	87	86
7	98	92	89	86	97	92	88	86	91	88	85	90	87	85	89	86	85	84
8	96	90	86	84	95	90	86	84	89	86	83	88	85	83	87	85	83	82
9	94	88	84	82	93	88	84	82	87	84	82	86	83	81	85	83	81	80
10	92	86	82	80	91	86	82	80	85	82	80	84	82	80	84	81	79	79

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2991977
5°	2762528
10°	1869889
15°	636162
20°	233638
25°	123857
30°	63691
35°	29696
40°	9708
45°	4930
50°	2290
55°	878
60°	1007
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P223329

CATALOG NUMBER: LD2B15D010 EU2B15NFL258035 2LBDL\*GPH

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	604.4	46.4
10°-20°	508.1	39.0
20°-30°	139.5	10.7
30°-40°	40.6	3.1
40°-50°	7.5	0.6
50°-60°	1.7	0.1
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1252.0	96.2
0°-40°	1292.6	99.3
0°-60°	1301.8	100.0
0°-90°	1302.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1302.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	7724	
5°	7105	604
15°	1586	508
25°	290	139
35°	63	41
45°	9	8
55°	1	2
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P223329

CATALOG NUMBER: LD2B15D010 EU2B15NFL258035 2LBDL\*GPH

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	7724.3
1°	7679.4
2°	7599.9
3°	7485.7
4°	7329.3
5°	7104.8
6°	6798.3
7°	6414.9
8°	5946.8
9°	5394.0
10°	4754.1
11°	4052.6
12°	3322.9
13°	2626.5
14°	2032.7
15°	1586.4
17.5°	895.2
20°	566.8
22.5°	404.0
25°	289.8
27.5°	205.2
30°	142.4
32.5°	100.0
35°	62.8
37.5°	25.6
40°	19.2
42.5°	14.1
45°	9.0
47.5°	5.1
50°	3.8
52.5°	2.6
55°	1.3
57.5°	1.3
60°	1.3
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P223329

CATALOG NUMBER: LD2B15D010 EU2B15NFL258035 2LBDL\*GPH

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)