

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P222677

Luminaire Tested: **LD2B15D010 EU2B15NFL259035 2LBDC*MMS**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P222677
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (155)
Test Lab: INNOVATION CENTER-P2
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B15D010 EU2B15NFL259035 2LBDC*MMS
Description: 1500 Lumen, 2inch Portfolio LED Downlight
NARROW FLOOD OPTIC
CAST ROUND TRIM WITH MATTE METALLIC SILVER
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1140.4 lumens
Efficiency: N/A
Efficacy: 79.7 lumens/watt
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.35
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 14.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P222677

CATALOG NUMBER: LD2B15D010 EU2B15NFL259035 2LBDC*MMS

Luminous Intensity Polar Plot

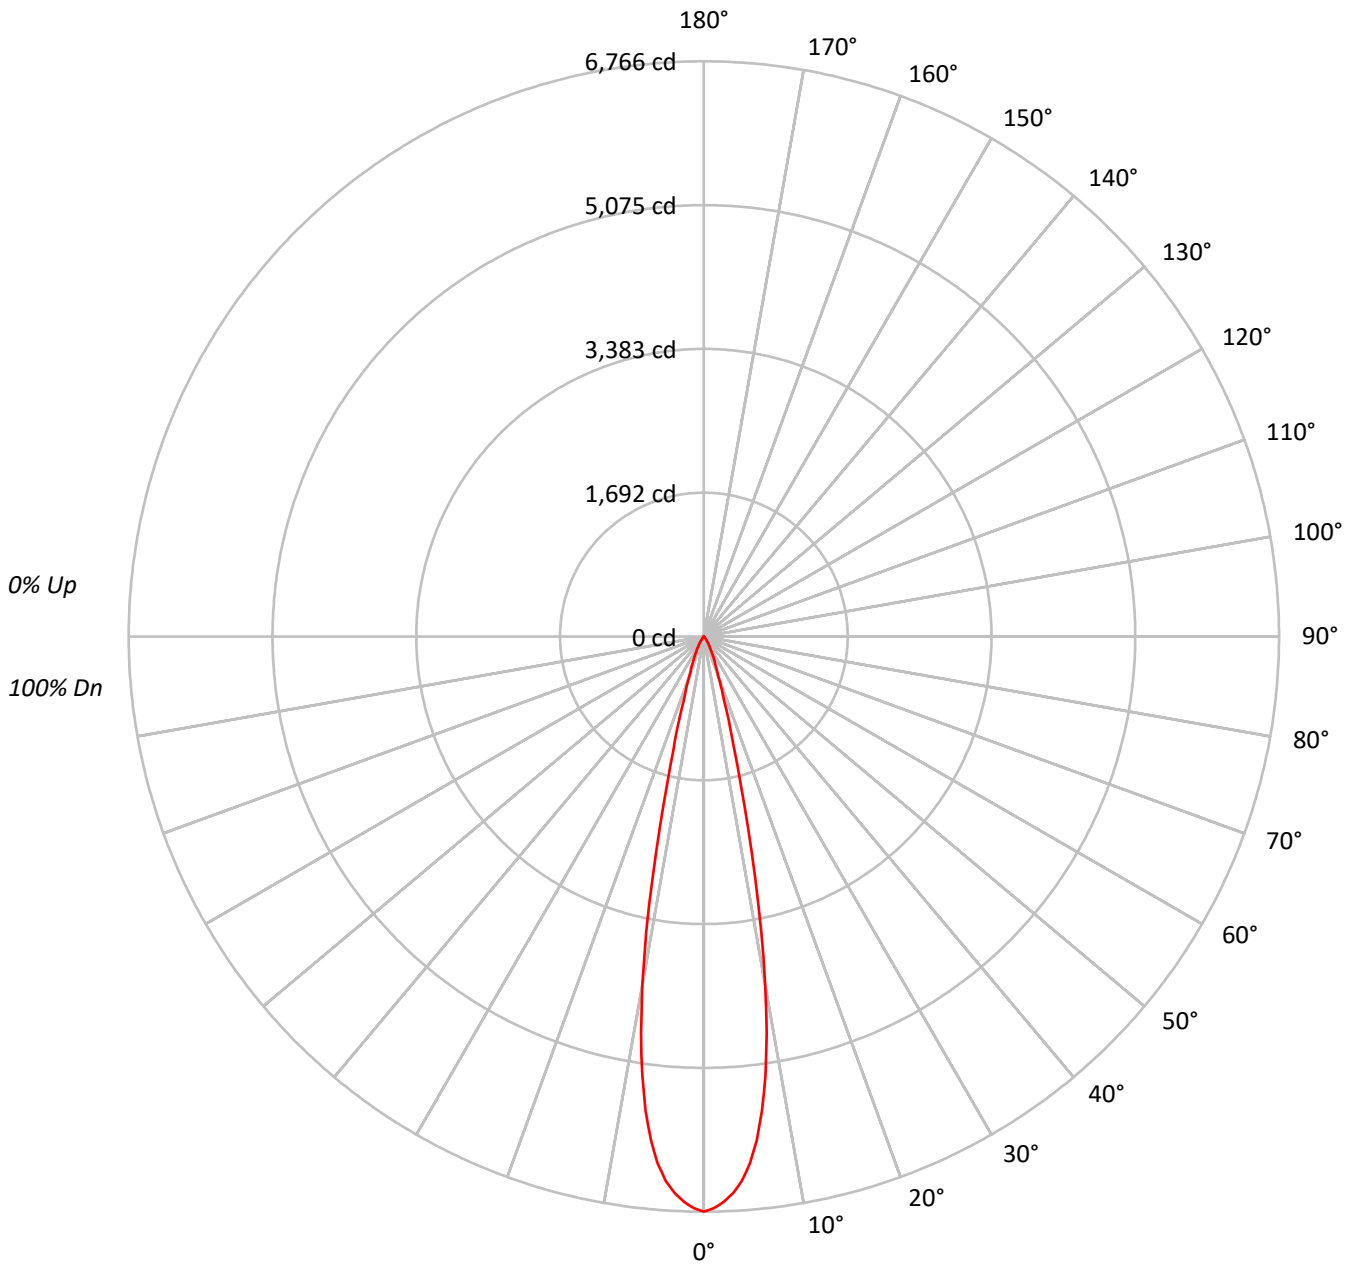



TEST NUMBER: P222677

CATALOG NUMBER: LD2B15D010 EU2B15NFL259035 2LBDC*MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	99	97
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97	97	96	95
2	112	109	106	104	110	107	104	102	104	102	100	101	99	98	98	97	96	95	95	93	92
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	96	95	93	92	92	91	90
4	106	101	97	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90	89	88	88
5	103	98	94	91	102	97	94	91	95	92	90	94	91	89	93	90	89	88	87	86	86
6	101	95	91	89	99	94	91	88	93	90	88	92	89	87	91	88	87	86	85	84	84
7	98	92	89	86	97	92	88	86	91	88	85	90	87	85	89	87	85	84	83	82	82
8	96	90	86	84	95	90	86	84	89	86	83	88	85	83	87	85	83	82	81	80	80
9	94	88	84	82	93	88	84	82	87	84	82	86	83	81	85	83	81	80	79	79	79
10	92	86	82	80	91	86	82	80	85	82	80	84	82	80	84	81	79	79	79	79	79

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2620628
5°	2419662
10°	1637790
15°	557203
20°	204660
25°	108514
30°	55774
35°	26007
40°	8495
45°	4328
50°	2049
55°	743
60°	852
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P222677

CATALOG NUMBER: LD2B15D010 EU2B15NFL259035 2LBDC*MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	529.3	46.4
10°-20°	445.1	39.0
20°-30°	122.1	10.7
30°-40°	35.6	3.1
40°-50°	6.6	0.6
50°-60°	1.5	0.1
60°-70°	0.1	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1096.6	96.2
0°-40°	1132.2	99.3
0°-60°	1140.3	100.0
0°-90°	1140.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1140.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6766	
5°	6223	529
15°	1390	445
25°	254	122
35°	55	36
45°	8	7
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P222677

CATALOG NUMBER: LD2B15D010 EU2B15NFL259035 2LBDC*MMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	6765.6
1°	6726.2
2°	6656.6
3°	6556.6
4°	6419.6
5°	6223.0
6°	5954.5
7°	5618.7
8°	5208.7
9°	4724.5
10°	4164.0
11°	3549.6
12°	2910.4
13°	2300.5
14°	1780.4
15°	1389.5
17.5°	784.1
20°	496.5
22.5°	353.8
25°	253.9
27.5°	179.7
30°	124.7
32.5°	87.6
35°	55.0
37.5°	22.5
40°	16.8
42.5°	12.4
45°	7.9
47.5°	4.5
50°	3.4
52.5°	2.2
55°	1.1
57.5°	1.1
60°	1.1
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P222677

CATALOG NUMBER: LD2B15D010 EU2B15NFL259035 2LBDC*MMS

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)