

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P264327

Luminaire Tested: **LD2B20D010 EU2B2010SP159030 2LBSQC*MMS**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P264327
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B20D010 EU2B2010SP159030 2LBSQC*MMS
Description: 2000 Lumen, 2inch Portfolio LED Downlight
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1471.0 lumens
Efficiency: N/A
Efficacy: 70.4 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 20.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P264327

CATALOG NUMBER: LD2B20D010 EU2B2010SP159030 2LBSQC*MMS

Luminous Intensity Polar Plot

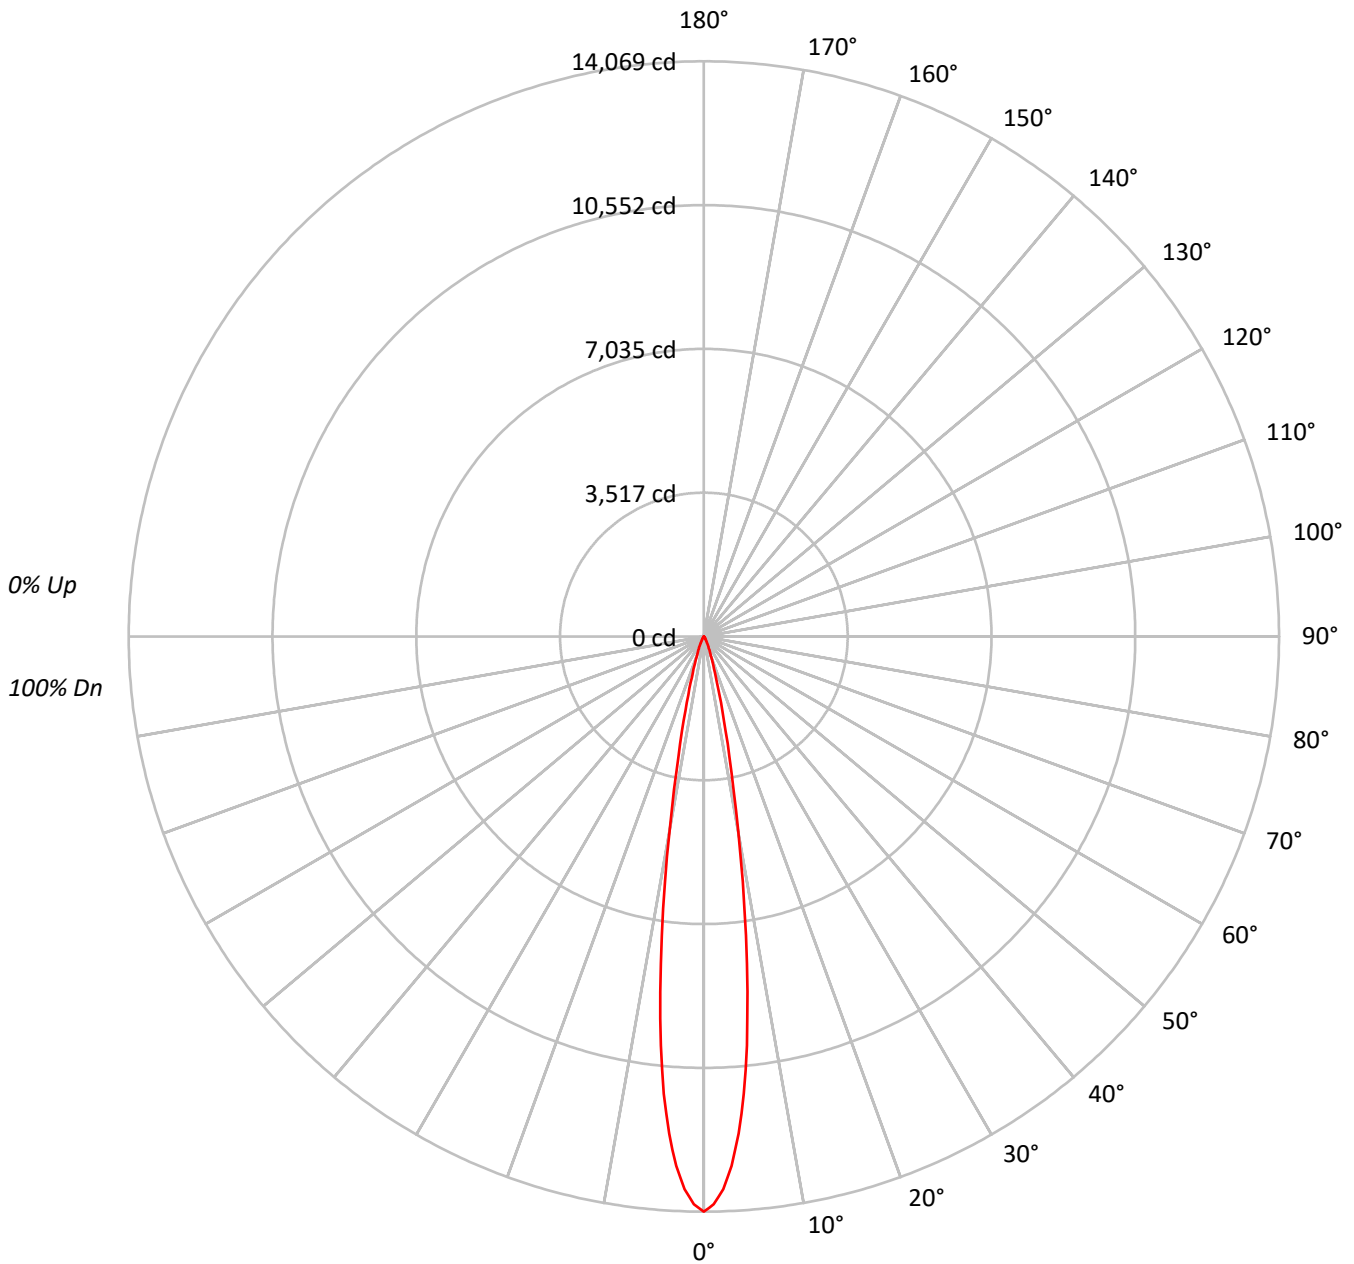



TEST NUMBER: P264327

CATALOG NUMBER: LD2B20D010 EU2B2010SP159030 2LBSQC*MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98			98
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96			96
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94			94
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92			92
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90			90
6	103	98	94	92	102	97	94	91	96	93	91	95	92	90	93	91	90	89			89
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87			87
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86			86
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85			85
10	95	90	87	85	95	90	87	85	89	86	85	89	86	84	88	86	84	83			83

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	6941058
5°	5563597
10°	2428265
15°	752511
20°	262355
25°	115841
30°	52468
35°	27283
40°	15586
45°	7396
50°	4605
55°	2580
60°	1480
65°	1751
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P264327

CATALOG NUMBER: LD2B20D010 EU2B2010SP159030 2LBSQC*MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	853.1	58.0
10°-20°	467.2	31.8
20°-30°	106.5	7.2
30°-40°	30.6	2.1
40°-50°	9.4	0.6
50°-60°	2.8	0.2
60°-70°	1.3	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1426.8	97.0
0°-40°	1457.4	99.1
0°-60°	1469.7	99.9
0°-90°	1471.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1471.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	14069	
5°	11234	853
15°	1473	467
25°	213	106
35°	45	31
45°	11	9
55°	3	3
65°	2	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P264327

CATALOG NUMBER: LD2B20D010 EU2B2010SP159030 2LBSQC*MMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	14068.9
1°	13893.8
2°	13530.0
3°	12965.5
4°	12189.6
5°	11234.0
6°	10062.6
7°	8753.8
8°	7387.7
9°	6065.3
10°	4847.1
11°	3816.1
12°	3004.0
13°	2363.9
14°	1867.3
15°	1473.3
16°	1162.3
17°	925.3
18°	744.2
19°	605.3
20°	499.7
22.5°	323.0
25°	212.8
26°	179.6
27°	152.5
28°	128.3
29°	107.2
30°	92.1
32.5°	63.4
35°	45.3
37.5°	33.2
40°	24.2
42.5°	16.6
45°	10.6
47.5°	7.5
50°	6.0
52.5°	4.5
55°	3.0
57.5°	1.5
60°	1.5
62.5°	1.5
65°	1.5
67.5°	1.5



TEST NUMBER: P264327

CATALOG NUMBER: LD2B20D010 EU2B2010SP159030 2LBSQC*MMS

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)