

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P224331

Luminaire Tested: **LD2B20D010 EU2B20FL409040 2LBDSQLC*MW**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P224331
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14835)
Test Lab: INNOVATION CENTER (G1)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B20D010 EU2B20FL409040 2LBDSQLC*MW
Description: 2000 Lumen, 2inch Portfolio LED Downlight
FLOOD OPTIC
LENSED SQUARE CAST TRIM WITH MATTE WHITE FINISH
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1405.0 lumens
Efficiency: N/A
Efficacy: 67.2 lumens/watt
Spacing Criteria (0/90/45): 0.61 / 0.61 / 0.59
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 20.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P224331

CATALOG NUMBER: LD2B20D010 EU2B20FL409040 2LBDSQLC*MW

Luminous Intensity Polar Plot

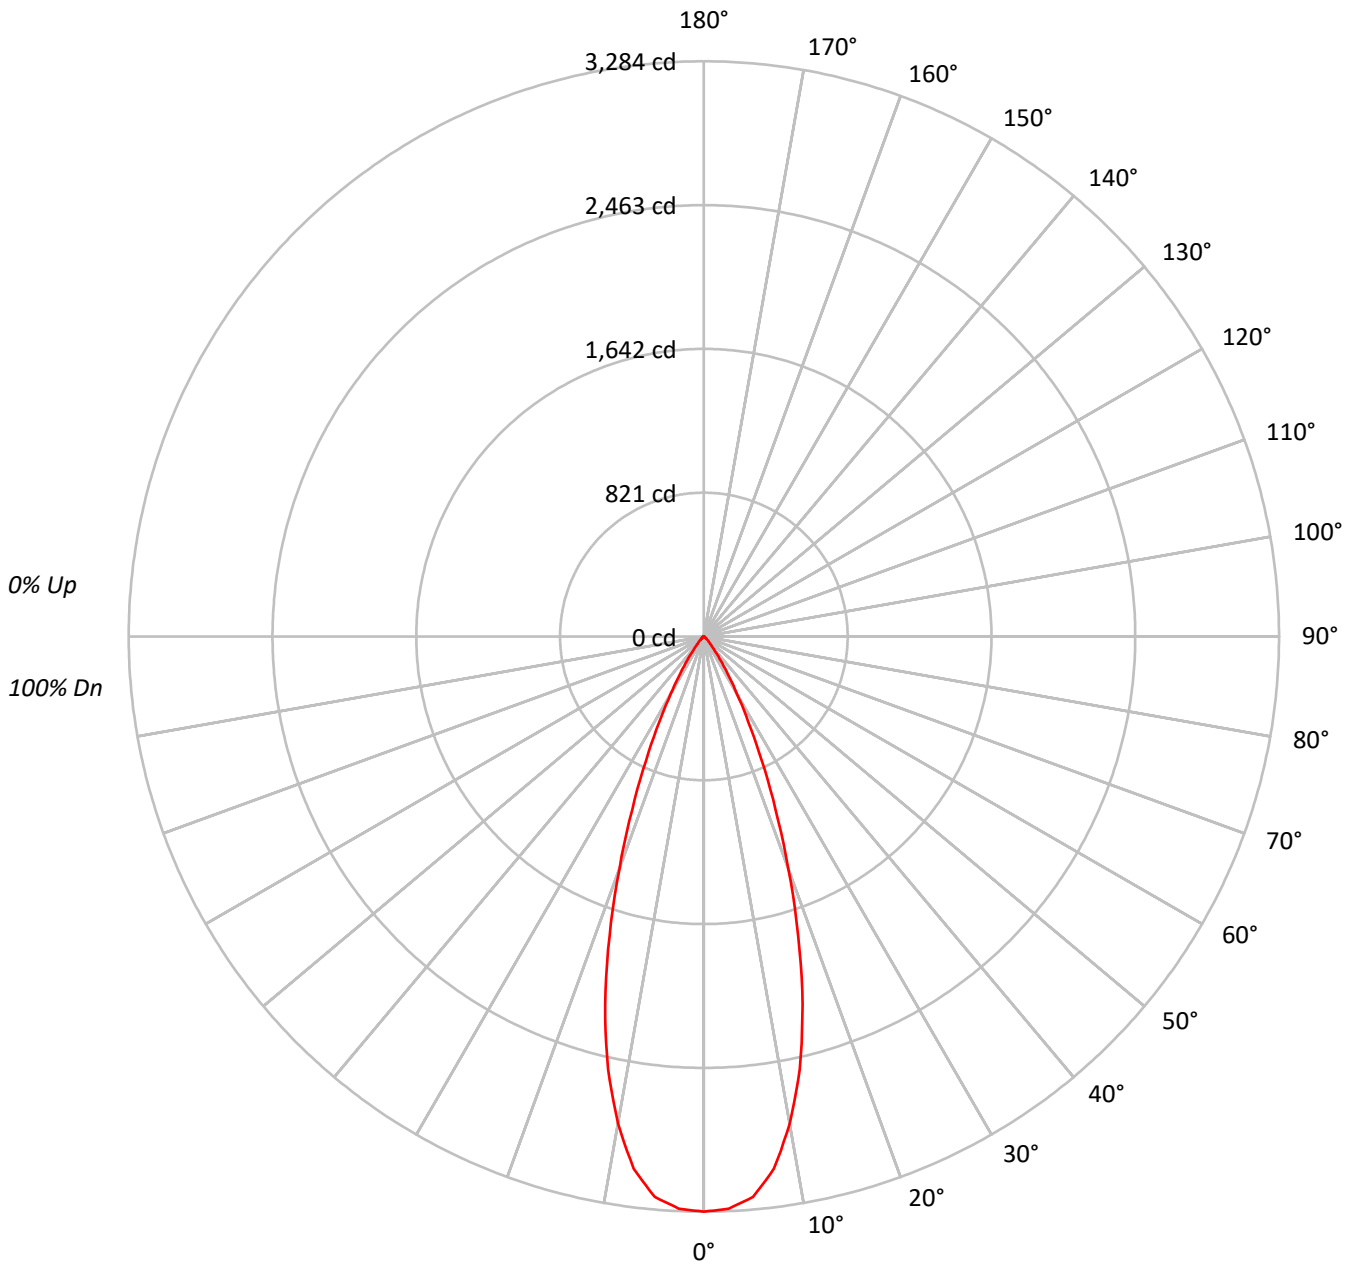



TEST NUMBER: P224331

CATALOG NUMBER: LD2B20D010 EU2B20FL409040 2LBDSQLC*MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95																			
2	110	106	102	99	108	104	101	98	101	98	96	98	96	94	95	94	92	91																			
3	105	100	96	93	104	99	95	92	96	93	90	94	91	89	92	90	88	86																			
4	101	95	90	87	100	94	90	86	92	88	85	90	87	85	88	86	84	82																			
5	98	91	86	82	96	90	85	82	88	84	81	86	83	80	85	82	80	79																			
6	94	87	82	78	93	86	81	78	84	80	77	83	80	77	82	79	76	75																			
7	90	83	78	74	89	82	77	74	81	77	74	80	76	73	79	76	73	72																			
8	87	79	74	71	86	79	74	71	78	74	71	77	73	70	76	73	70	69																			
9	84	76	71	68	83	76	71	68	75	71	68	74	70	67	73	70	67	66																			
10	81	73	68	65	80	73	68	65	72	68	65	71	68	65	71	67	65	64																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1272044
5°	1248869
10°	1110189
15°	873119
20°	581003
25°	333577
30°	168486
35°	79252
40°	31906
45°	15776
50°	8677
55°	6078
60°	5578
65°	3300
70°	4077
75°	2694
80°	4015
85°	0



TEST NUMBER: P224331

CATALOG NUMBER: LD2B20D010 EU2B20FL409040 2LBDSQLC*MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	294.2	20.9
10°-20°	589.8	42.0
20°-30°	366.9	26.1
30°-40°	112.8	8.0
40°-50°	24.8	1.8
50°-60°	8.8	0.6
60°-70°	4.4	0.3
70°-80°	2.6	0.2
80°-90°	0.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1250.9	89.0
0°-40°	1363.7	97.1
0°-60°	1397.3	99.4
0°-90°	1405.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1405.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3284	
5°	3212	294
15°	2177	590
25°	780	367
35°	168	113
45°	29	25
55°	9	9
65°	4	4
75°	2	3
85°	0	1
90°	0	



TEST NUMBER: P224331

CATALOG NUMBER: LD2B20D010 EU2B20FL409040 2LBDSQLC*MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3284.0
2.5°	3269.6
5°	3211.9
7.5°	3065.9
10°	2822.6
12.5°	2530.6
15°	2177.3
17.5°	1791.6
20°	1409.5
22.5°	1068.8
25°	780.5
27.5°	549.7
30°	376.7
32.5°	254.1
35°	167.6
37.5°	100.9
40°	63.1
42.5°	43.3
45°	28.8
47.5°	19.8
50°	14.4
52.5°	12.6
55°	9.0
57.5°	7.2
60°	7.2
62.5°	5.4
65°	3.6
67.5°	3.6
70°	3.6
72.5°	3.6
75°	1.8
77.5°	1.8
80°	1.8
82.5°	1.8
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)