

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P264168

Luminaire Tested: **LD2B20D010 EU2B2010SP158050 2LBDC*MMS**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P264168
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B20D010 EU2B2010SP158050 2LBDC*MMS
Description: 2000 Lumen, 2inch Portfolio LED Downlight
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1747.0 lumens
Efficiency: N/A
Efficacy: 83.6 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 20.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P264168

CATALOG NUMBER: LD2B20D010 EU2B2010SP158050 2LBDC*MMS

Luminous Intensity Polar Plot

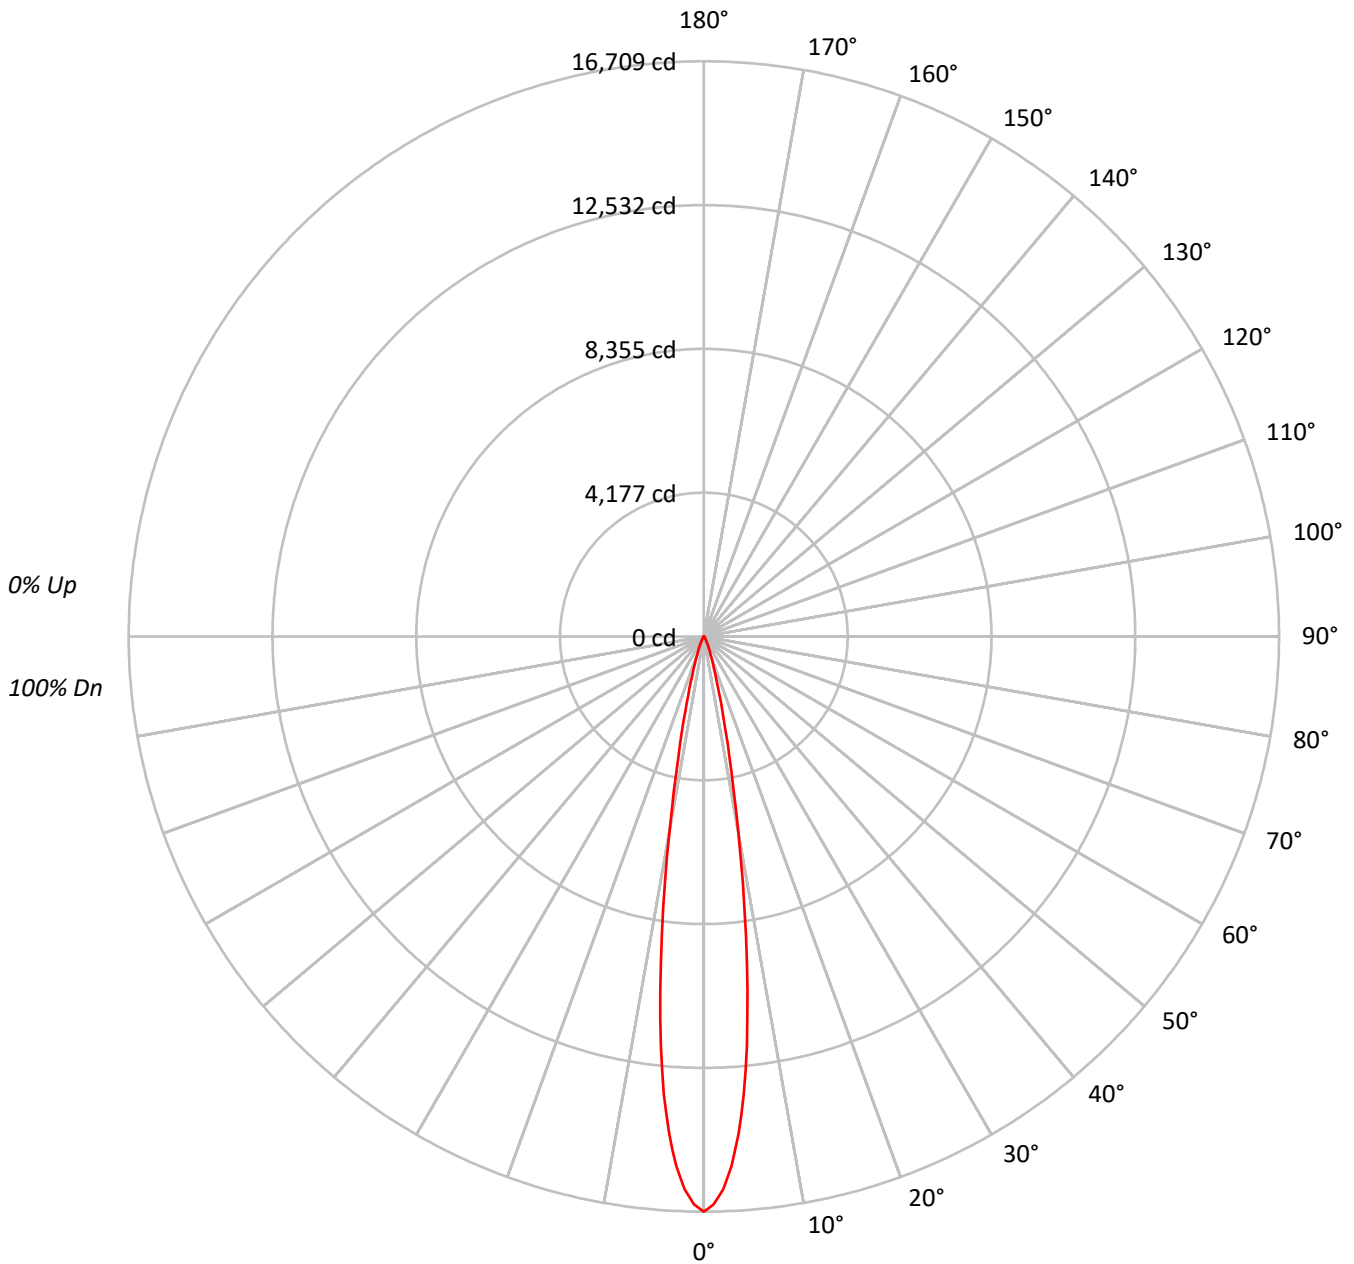



TEST NUMBER: P264168

CATALOG NUMBER: LD2B20D010 EU2B2010SP158050 2LBDC*MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98			
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96			
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94			
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92			
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90			
6	103	98	94	92	102	97	94	91	96	93	91	95	92	90	93	91	90	89			
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87			
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86			
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85			
10	95	90	87	85	95	90	87	85	89	86	85	89	86	84	88	86	84	83			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	8243434
5°	6607478
10°	2883899
15°	893687
20°	311550
25°	137615
30°	62324
35°	32403
40°	18484
45°	8721
50°	5526
55°	3097
60°	1776
65°	2101
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P264168

CATALOG NUMBER: LD2B20D010 EU2B2010SP158050 2LBDC*MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1013.2	58.0
10°-20°	554.9	31.8
20°-30°	126.5	7.2
30°-40°	36.4	2.1
40°-50°	11.2	0.6
50°-60°	3.4	0.2
60°-70°	1.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1694.5	97.0
0°-40°	1730.9	99.1
0°-60°	1745.5	99.9
0°-90°	1747.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1747.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	16709	
5°	13342	###
15°	1750	555
25°	253	126
35°	54	36
45°	12	11
55°	4	3
65°	2	2
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P264168

CATALOG NUMBER: LD2B20D010 EU2B2010SP158050 2LBDC*MMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	16708.7
1°	16500.7
2°	16068.6
3°	15398.1
4°	14476.7
5°	13341.8
6°	11950.6
7°	10396.3
8°	8773.8
9°	7203.4
10°	5756.6
11°	4532.1
12°	3567.6
13°	2807.5
14°	2217.7
15°	1749.7
16°	1380.4
17°	1099.0
18°	883.8
19°	718.9
20°	593.4
22.5°	383.7
25°	252.8
26°	213.3
27°	181.1
28°	152.4
29°	127.3
30°	109.4
32.5°	75.3
35°	53.8
37.5°	39.4
40°	28.7
42.5°	19.7
45°	12.5
47.5°	9.0
50°	7.2
52.5°	5.4
55°	3.6
57.5°	1.8
60°	1.8
62.5°	1.8
65°	1.8
67.5°	1.8



TEST NUMBER: P264168

CATALOG NUMBER: LD2B20D010 EU2B2010SP158050 2LBDC*MMS

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)