

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P264482

Luminaire Tested: **LD2B20D010 EU2B2010SP159050 2LBSQC*MW**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P264482
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B20D010 EU2B2010SP159050 2LBSQC*MW
Description: 2000 Lumen, 2inch Portfolio LED Downlight
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1392.0 lumens
Efficiency: N/A
Efficacy: 66.6 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 20.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P264482

CATALOG NUMBER: LD2B20D010 EU2B2010SP159050 2LBSQC*MW

Luminous Intensity Polar Plot

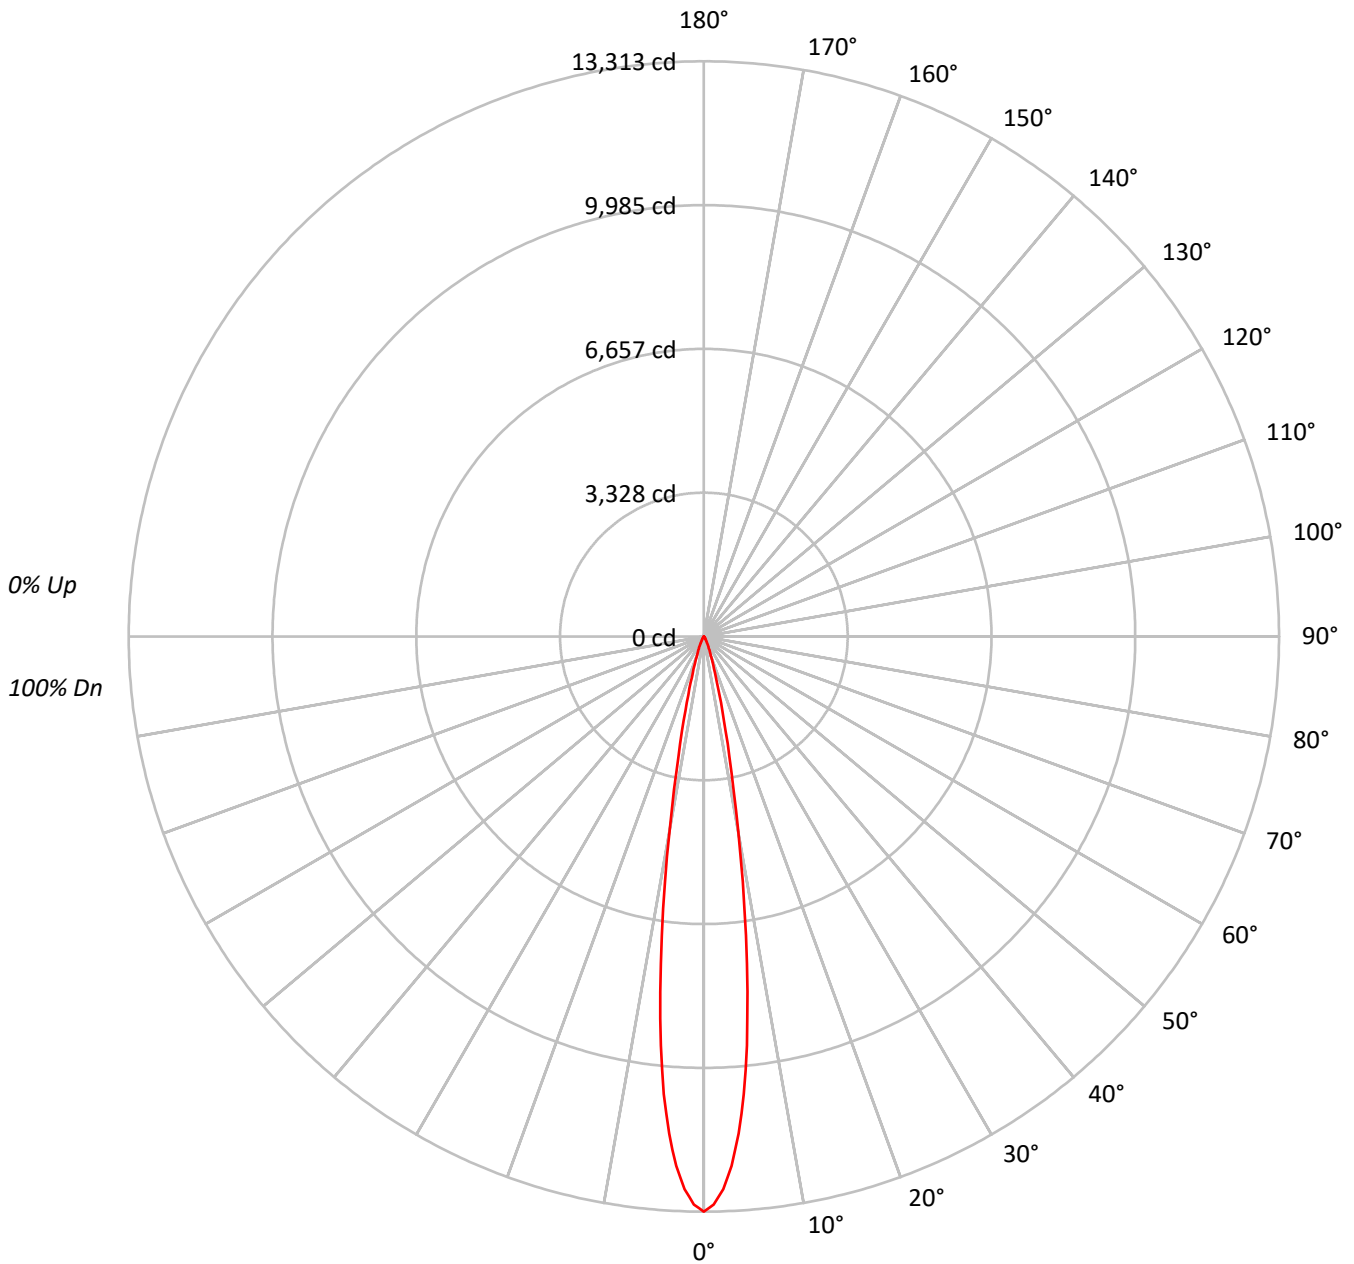



TEST NUMBER: P264482

CATALOG NUMBER: LD2B20D010 EU2B2010SP159050 2LBSQC*MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98			98
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96			96
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94			94
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92			92
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90			90
6	103	98	94	92	102	97	94	91	96	93	91	95	92	90	93	91	90	89			89
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87			87
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86			86
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85			85
10	95	90	87	85	95	90	87	85	89	86	85	89	86	84	88	86	84	83			83

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	6568323
5°	5264815
10°	2297862
15°	712110
20°	248232
25°	109635
30°	49620
35°	25838
40°	14748
45°	6977
50°	4375
55°	2494
60°	1381
65°	1634
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P264482

CATALOG NUMBER: LD2B20D010 EU2B2010SP159050 2LBSQC*MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	807.3	58.0
10°-20°	442.1	31.8
20°-30°	100.8	7.2
30°-40°	29.0	2.1
40°-50°	8.9	0.6
50°-60°	2.7	0.2
60°-70°	1.2	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1350.2	97.0
0°-40°	1379.1	99.1
0°-60°	1390.8	99.9
0°-90°	1392.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1392.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	13313	
5°	10631	807
15°	1394	442
25°	201	101
35°	43	29
45°	10	9
55°	3	3
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P264482

CATALOG NUMBER: LD2B20D010 EU2B2010SP159050 2LBSQC*MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	13313.4
1°	13147.7
2°	12803.4
3°	12269.2
4°	11534.9
5°	10630.7
6°	9522.2
7°	8283.7
8°	6990.9
9°	5739.6
10°	4586.8
11°	3611.2
12°	2842.7
13°	2237.0
14°	1767.0
15°	1394.2
16°	1099.9
17°	875.7
18°	704.2
19°	572.8
20°	472.8
22.5°	305.7
25°	201.4
26°	170.0
27°	144.3
28°	121.4
29°	101.4
30°	87.1
32.5°	60.0
35°	42.9
37.5°	31.4
40°	22.9
42.5°	15.7
45°	10.0
47.5°	7.1
50°	5.7
52.5°	4.3
55°	2.9
57.5°	1.4
60°	1.4
62.5°	1.4
65°	1.4
67.5°	1.4



TEST NUMBER: P264482

CATALOG NUMBER: LD2B20D010 EU2B2010SP159050 2LBSQC*MW

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)