

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P264182

Luminaire Tested: **LD2B05D010 EU2B0510SP159024 2LBSQC\*MB**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P264182  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)  
Test Lab: INNOVATION CENTER(G2)  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD2B05D010 EU2B0510SP159024 2LBSQC\*MB  
Description: 500 Lumen, 2inch Portfolio LED Downlight  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 512.0 lumens  
Efficiency: N/A  
Efficacy: 70.1 lumens/watt  
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28  
Luminous Opening: Circular (Dia: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 7.3  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P264182

CATALOG NUMBER: LD2B05D010 EU2B0510SP159024 2LBSQC\*MB

### Luminous Intensity Polar Plot

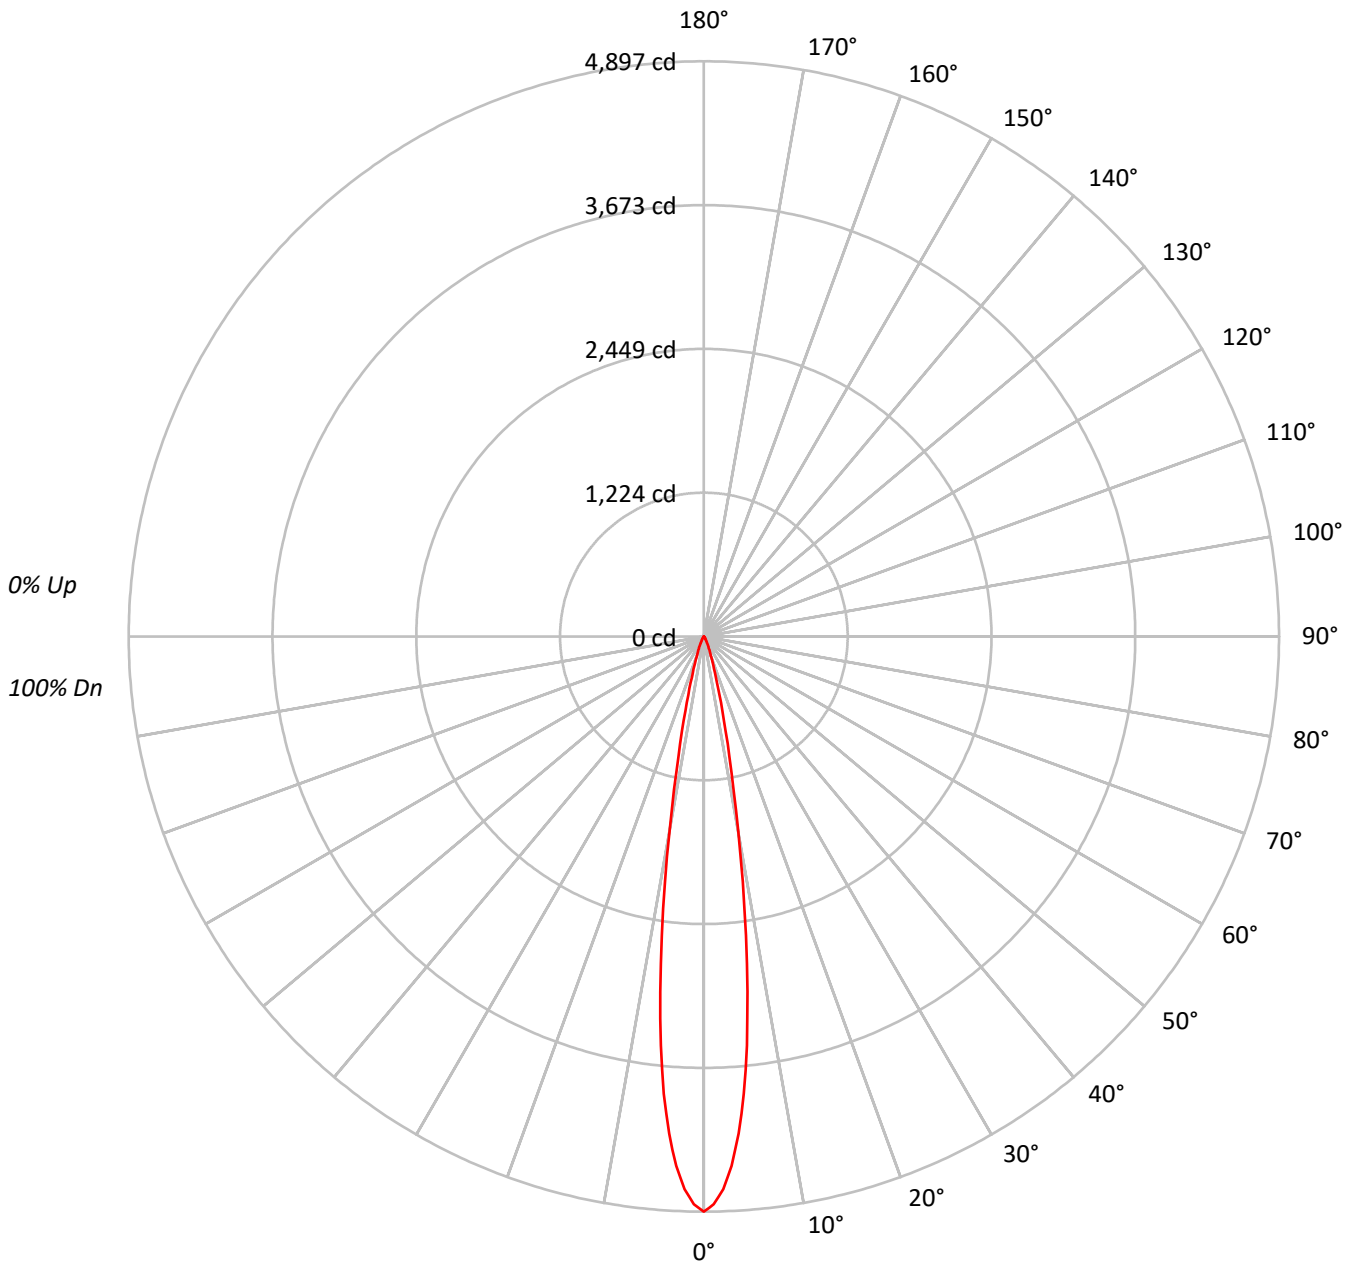



TEST NUMBER: P264182

CATALOG NUMBER: LD2B05D010 EU2B0510SP159024 2LBSQC\*MB

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98			98
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96			96
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94			94
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92			92
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90			90
6	103	98	94	92	102	97	94	91	96	93	91	95	92	90	93	91	90	89			89
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87			87
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86			86
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85			85
10	95	90	87	85	95	90	87	85	89	86	85	89	86	84	88	86	84	83			83

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2415943
5°	1936463
10°	845191
15°	261921
20°	91302
25°	40337
30°	18287
35°	9516
40°	5410
45°	2582
50°	1612
55°	946
60°	493
65°	584
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P264182

CATALOG NUMBER: LD2B05D010 EU2B0510SP159024 2LBSQC\*MB

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	296.9	58.0
10°-20°	162.6	31.8
20°-30°	37.1	7.2
30°-40°	10.7	2.1
40°-50°	3.3	0.6
50°-60°	1.0	0.2
60°-70°	0.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	496.6	97.0
0°-40°	507.3	99.1
0°-60°	511.6	99.9
0°-90°	512.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	512.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4897	
5°	3910	297
15°	513	163
25°	74	37
35°	16	11
45°	4	3
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P264182

CATALOG NUMBER: LD2B05D010 EU2B0510SP159024 2LBSQC\*MB

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	4896.9
1°	4835.9
2°	4709.3
3°	4512.8
4°	4242.7
5°	3910.1
6°	3502.4
7°	3046.9
8°	2571.4
9°	2111.1
10°	1687.1
11°	1328.2
12°	1045.6
13°	822.8
14°	649.9
15°	512.8
16°	404.6
17°	322.1
18°	259.0
19°	210.7
20°	173.9
22.5°	112.4
25°	74.1
26°	62.5
27°	53.1
28°	44.7
29°	37.3
30°	32.1
32.5°	22.1
35°	15.8
37.5°	11.6
40°	8.4
42.5°	5.8
45°	3.7
47.5°	2.6
50°	2.1
52.5°	1.6
55°	1.1
57.5°	0.5
60°	0.5
62.5°	0.5
65°	0.5
67.5°	0.5



TEST NUMBER: P264182

CATALOG NUMBER: LD2B05D010 EU2B0510SP159024 2LBSQC\*MB

**CANDELA DISTRIBUTION (continued):**

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)