

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P222988

Luminaire Tested: **LD2B05D010 EU2B05NFL259024 2LBDSQLC\*MW**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P222988  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (155)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD2B05D010 EU2B05NFL259024 2LBDSQLC\*MW  
Description: 500 Lumen, 2inch Portfolio LED Downlight  
NARROW FLOOD OPTIC  
LENSED SQUARE CAST TRIM WITH MATTE WHITE FINISH  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 485.0 lumens  
Efficiency: N/A  
Efficacy: 66.4 lumens/watt  
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.35  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 7.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P222988

CATALOG NUMBER: LD2B05D010 EU2B05NFL259024 2LBDSQLC\*MW

### Luminous Intensity Polar Plot

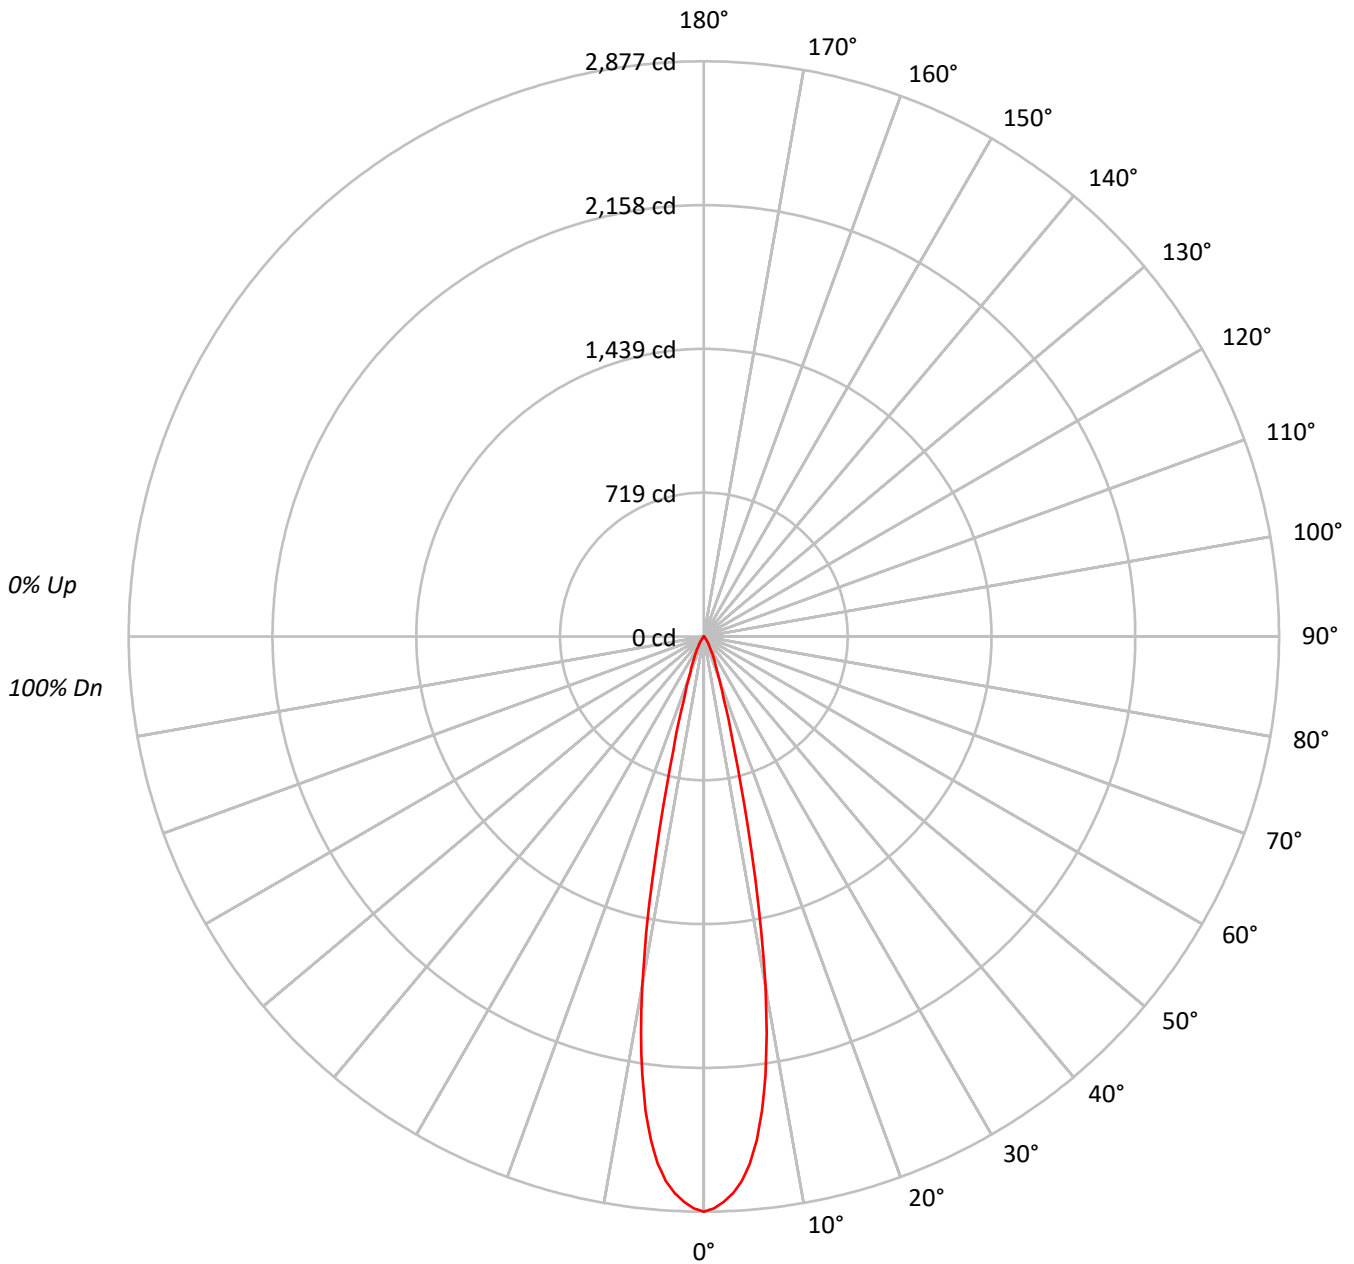



TEST NUMBER: P222988

CATALOG NUMBER: LD2B05D010 EU2B05NFL259024 2LBDSQLC\*MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97
2	112	109	106	104	110	107	104	102	104	102	100	101	99	98	98	97	96	95
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	96	95	93	92
4	106	101	97	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90
5	103	98	94	91	102	97	94	91	95	92	90	94	91	89	93	90	89	88
6	101	95	91	89	99	94	91	88	93	90	88	92	89	87	91	88	87	86
7	98	92	89	86	97	92	88	86	91	88	85	90	87	85	89	86	85	84
8	96	90	86	84	95	90	86	84	89	86	83	88	85	83	87	85	83	82
9	94	88	84	82	93	88	84	82	87	84	82	86	83	81	85	83	81	80
10	92	86	82	80	91	86	82	80	85	82	80	84	82	80	84	81	79	79

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1114511
5°	1029066
10°	696533
15°	236957
20°	87058
25°	46158
30°	23705
35°	11065
40°	3641
45°	1808
50°	844
55°	338
60°	387
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P222988

CATALOG NUMBER: LD2B05D010 EU2B05NFL259024 2LBDSQLC\*MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	225.1	46.4
10°-20°	189.3	39.0
20°-30°	51.9	10.7
30°-40°	15.2	3.1
40°-50°	2.8	0.6
50°-60°	0.7	0.1
60°-70°	0.1	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	466.4	96.2
0°-40°	481.5	99.3
0°-60°	485.0	100.0
0°-90°	485.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	485.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2877	
5°	2647	225
15°	591	189
25°	108	52
35°	23	15
45°	3	3
55°	0	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P222988

CATALOG NUMBER: LD2B05D010 EU2B05NFL259024 2LBDSQLC\*MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2877.3
1°	2860.6
2°	2831.0
3°	2788.5
4°	2730.2
5°	2646.6
6°	2532.4
7°	2389.6
8°	2215.2
9°	2009.3
10°	1770.9
11°	1509.6
12°	1237.8
13°	978.4
14°	757.2
15°	590.9
17.5°	333.5
20°	211.2
22.5°	150.5
25°	108.0
27.5°	76.4
30°	53.0
32.5°	37.3
35°	23.4
37.5°	9.6
40°	7.2
42.5°	5.3
45°	3.3
47.5°	1.9
50°	1.4
52.5°	1.0
55°	0.5
57.5°	0.5
60°	0.5
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P222988

CATALOG NUMBER: LD2B05D010 EU2B05NFL259024 2LBDSQLC\*MW

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)