

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P223519

Luminaire Tested: **LD2B05D010 EU2B05NFL258027 2LBDSQLC\*MMS**

Issue Date: 3/3/2020

**Test Information**

Test Method: LM-41-14  
Report Number: P223519  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (155)  
Test Lab: INNOVATION CENTER-P2  
Issue Date: 3/3/2020  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: io LED  
Catalog Number: LD2B05D010 EU2B05NFL258027 2LBDSQLC\*MMS  
Description: 500 Lumen, 2inch Portfolio LED Downlight  
NARROW FLOOD OPTIC  
LENSED SQUARE CAST TRIM WITH MATTE METALLIC SILVER  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 661.1 lumens  
Efficiency: N/A  
Efficacy: 90.6 lumens/watt  
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.35  
Luminous Opening: Rectangular (W 0.17' x L: 0.17' x H: 0')  
CIE Type: Direct


Input Watts (W): 7.3  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT



TEST NUMBER: P223519

CATALOG NUMBER: LD2B05D010 EU2B05NFL258027 2LBDSQLC\*MMS

### Luminous Intensity Polar Plot

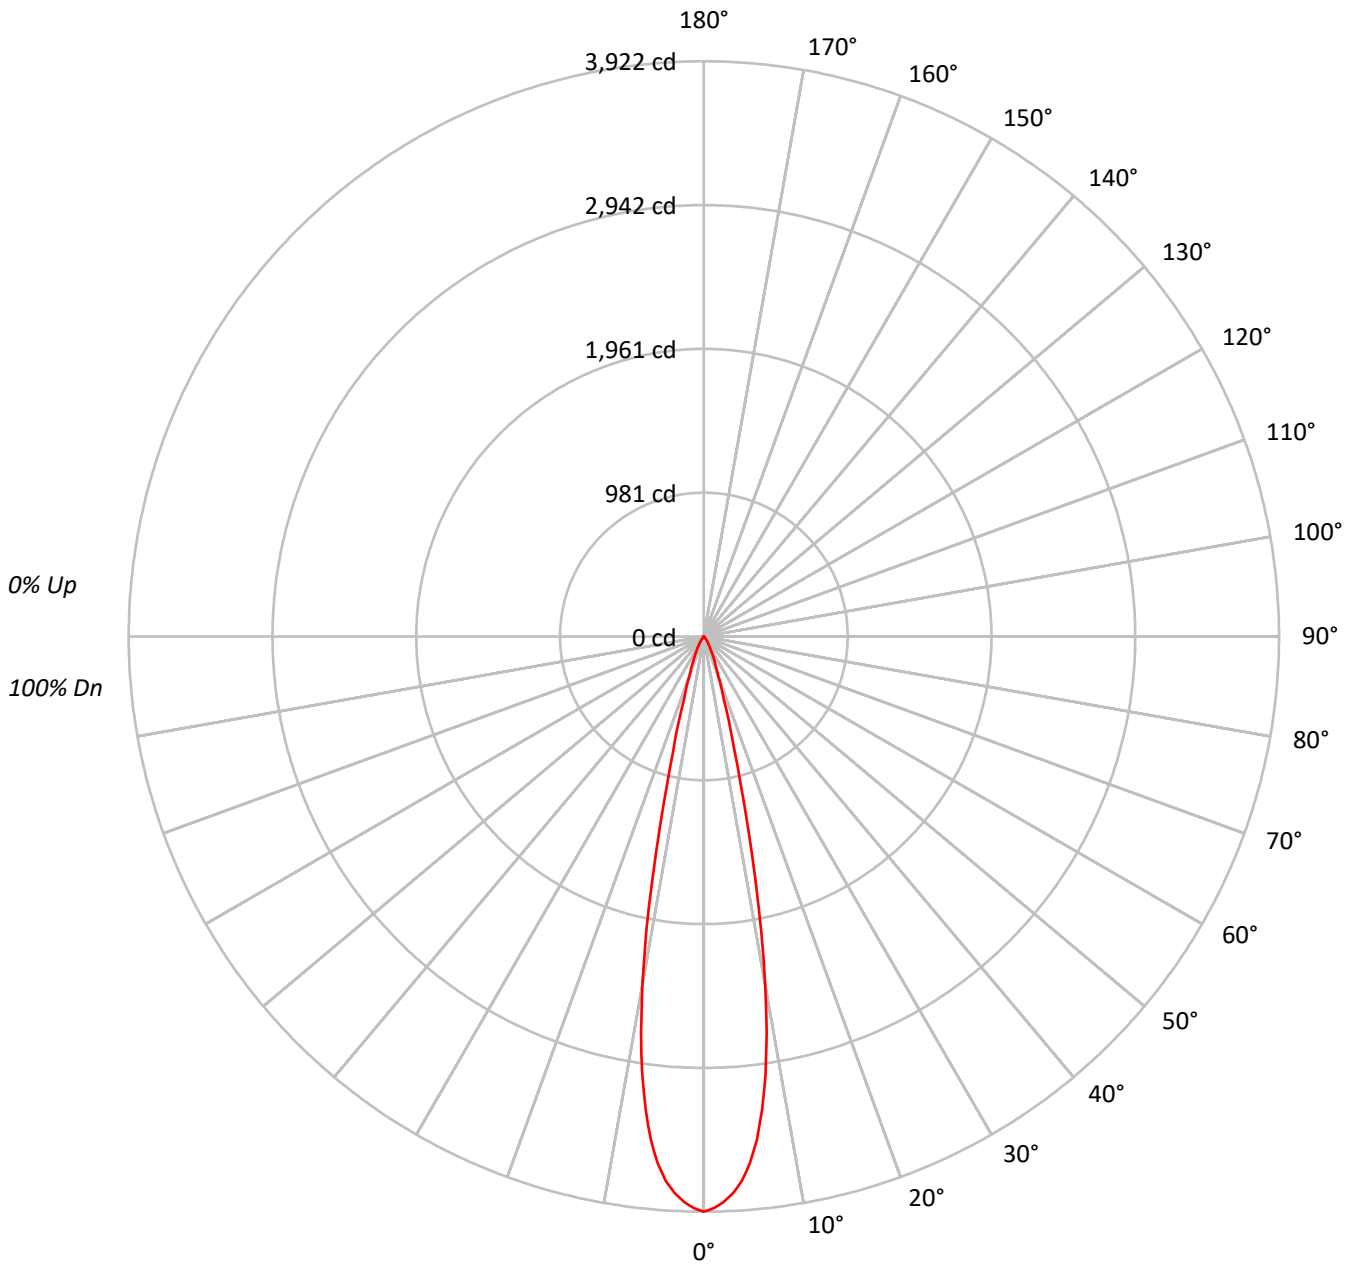



TEST NUMBER: P223519

CATALOG NUMBER: LD2B05D010 EU2B05NFL258027 2LBDSQLC\*MMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97
2	112	109	106	104	110	107	104	102	104	102	100	101	99	98	98	97	96	95
3	109	105	101	99	107	103	100	98	101	98	96	99	97	95	96	95	93	92
4	106	101	97	95	104	100	97	94	98	95	93	96	94	92	95	93	91	90
5	103	98	94	91	102	97	94	91	95	92	90	94	91	89	93	90	89	88
6	101	95	91	89	99	94	91	88	93	90	88	92	89	87	91	88	87	86
7	98	92	89	86	97	92	88	86	91	88	85	90	87	85	89	86	85	84
8	96	90	86	84	95	90	86	84	89	86	83	88	85	83	87	85	83	82
9	94	88	84	82	93	88	84	82	87	84	82	86	83	81	85	83	81	80
10	92	86	82	80	91	86	82	80	85	82	80	84	82	80	84	81	79	79

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1518977
5°	1402494
10°	949321
15°	322974
20°	118633
25°	62869
30°	32338
35°	15084
40°	4955
45°	2520
50°	1205
55°	473
60°	542
65°	0
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P223519

CATALOG NUMBER: LD2B05D010 EU2B05NFL258027 2LBDSQLC\*MMS

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	306.8	46.4
10°-20°	258.0	39.0
20°-30°	70.8	10.7
30°-40°	20.6	3.1
40°-50°	3.8	0.6
50°-60°	0.9	0.1
60°-70°	0.1	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	635.6	96.1
0°-40°	656.3	99.3
0°-60°	661.0	100.0
0°-90°	661.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	661.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3922	
5°	3607	307
15°	805	258
25°	147	71
35°	32	21
45°	5	4
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P223519

CATALOG NUMBER: LD2B05D010 EU2B05NFL258027 2LBDSQLC\*MMS

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3921.5
1°	3898.7
2°	3858.3
3°	3800.4
4°	3720.9
5°	3607.0
6°	3451.4
7°	3256.7
8°	3019.1
9°	2738.4
10°	2413.6
11°	2057.4
12°	1687.0
13°	1333.4
14°	1032.0
15°	805.4
17.5°	454.5
20°	287.8
22.5°	205.1
25°	147.1
27.5°	104.2
30°	72.3
32.5°	50.8
35°	31.9
37.5°	13.0
40°	9.8
42.5°	7.2
45°	4.6
47.5°	2.6
50°	2.0
52.5°	1.3
55°	0.7
57.5°	0.7
60°	0.7
62.5°	0.0
65°	0.0
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0



TEST NUMBER: P223519

CATALOG NUMBER: LD2B05D010 EU2B05NFL258027 2LBDSQLC\*MMS

**CANDELA DISTRIBUTION (continued):**

0°  
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093







— 0°-180°







85°		0.0
87.5°		0.0



(END OF REPORT)