

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P265061

Luminaire Tested: **LD2B05D010 EU2B0510SP159040 2LBDL*WMH**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P265061
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1711-432-2)
Test Lab: INNOVATION CENTER(G3)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B05D010 EU2B0510SP159040 2LBDL*WMH
Description: 500 Lumen, 2inch Portfolio LED Downlight
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 585.0 lumens
Efficiency: N/A
Efficacy: 80.1 lumens/watt
Spacing Criteria (0/90/45): 0.31 / 0.31 / 0.32
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 7.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P265061

CATALOG NUMBER: LD2B05D010 EU2B0510SP159040 2LBDL*WMH

Luminous Intensity Polar Plot

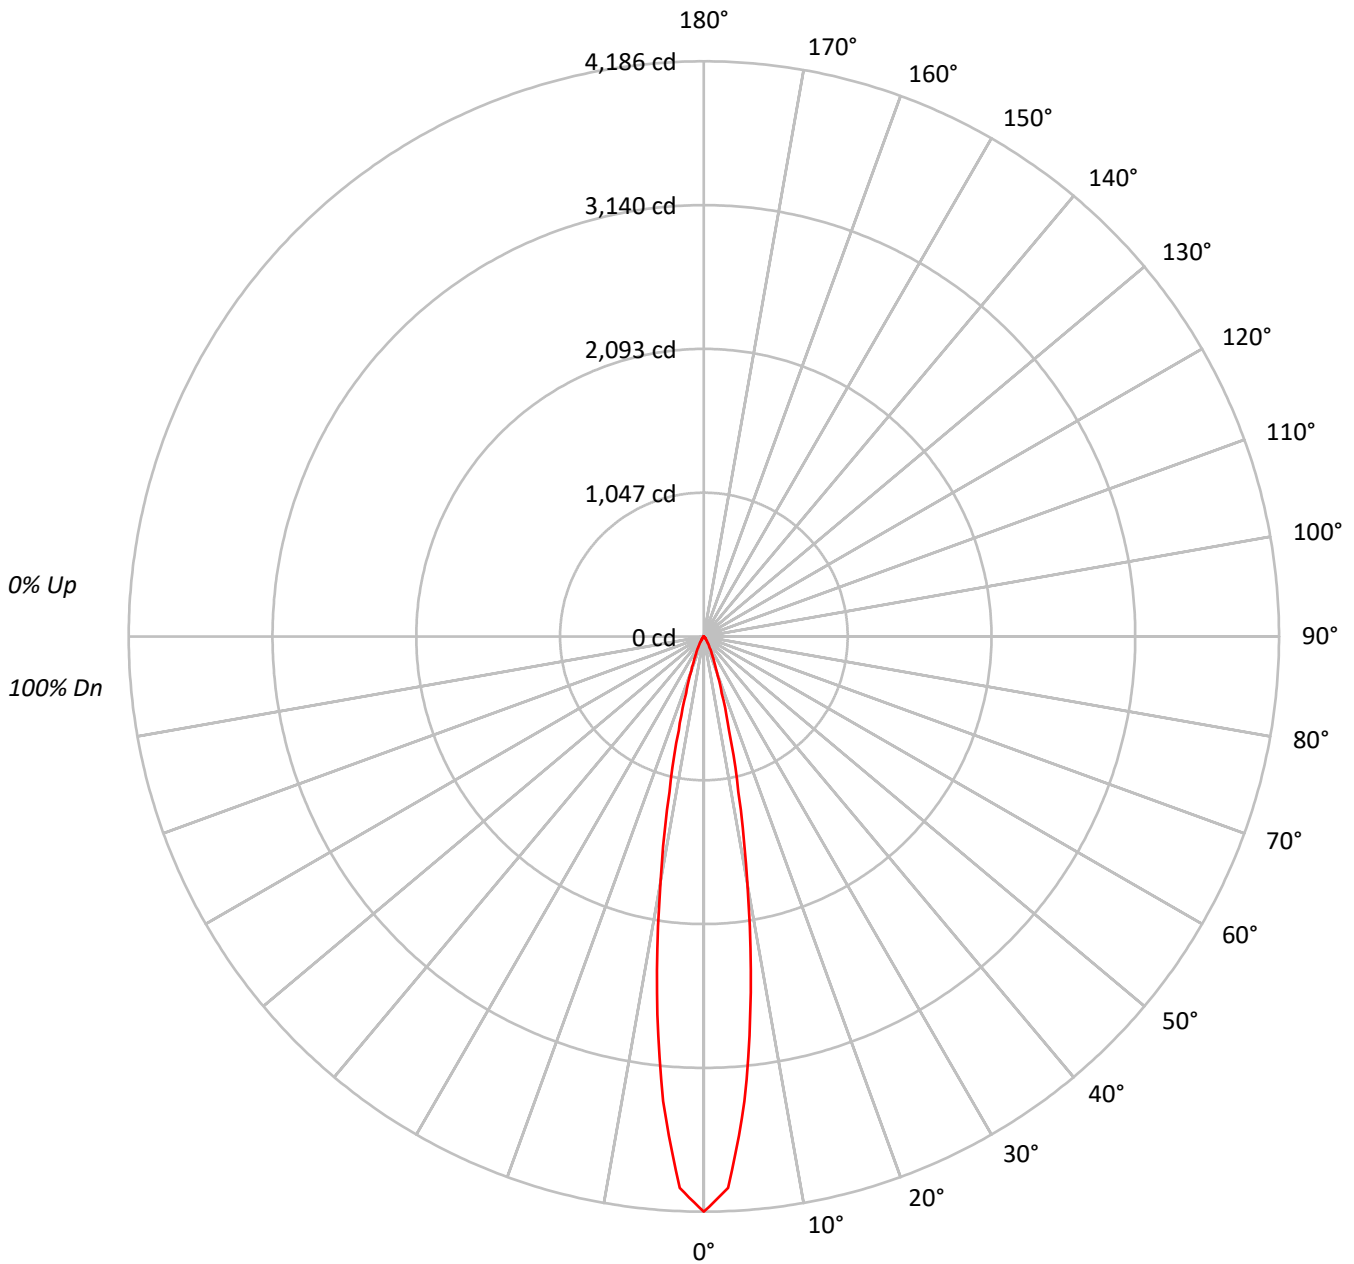



TEST NUMBER: P265061

CATALOG NUMBER: LD2B05D010 EU2B0510SP159040 2LBDL*WMH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|----|----|----|----|----|----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|--|--|--|--|--|--|--|--|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | | | | | | | | | |
| RC | 80 | | | | | | | | | 70 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 | | | | | | | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1 | 115 | 113 | 111 | 110 | 113 | 111 | 110 | 108 | 107 | 106 | 105 | 104 | 103 | 102 | 100 | 99 | 99 | 97 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | 112 | 108 | 106 | 103 | 110 | 107 | 104 | 102 | 104 | 102 | 100 | 101 | 99 | 98 | 98 | 97 | 96 | 94 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | 109 | 104 | 101 | 98 | 107 | 103 | 100 | 97 | 100 | 98 | 96 | 98 | 96 | 94 | 96 | 94 | 93 | 92 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 | 105 | 100 | 97 | 94 | 104 | 99 | 96 | 93 | 97 | 95 | 92 | 96 | 93 | 91 | 94 | 92 | 90 | 89 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 | 103 | 97 | 93 | 91 | 101 | 96 | 93 | 90 | 95 | 92 | 89 | 93 | 91 | 89 | 92 | 90 | 88 | 87 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 | 100 | 94 | 90 | 88 | 99 | 94 | 90 | 87 | 92 | 89 | 87 | 91 | 88 | 86 | 90 | 88 | 86 | 85 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 7 | 98 | 92 | 88 | 85 | 97 | 91 | 88 | 85 | 90 | 87 | 85 | 89 | 86 | 84 | 88 | 86 | 84 | 83 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8 | 95 | 89 | 86 | 83 | 94 | 89 | 85 | 83 | 88 | 85 | 82 | 87 | 84 | 82 | 86 | 84 | 82 | 81 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 9 | 93 | 87 | 83 | 81 | 92 | 87 | 83 | 81 | 86 | 83 | 81 | 85 | 82 | 80 | 85 | 82 | 80 | 79 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 | 91 | 85 | 82 | 79 | 91 | 85 | 81 | 79 | 84 | 81 | 79 | 84 | 81 | 79 | 83 | 80 | 78 | 78 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|---------|
| | 0° |
| 0° | 2065163 |
| 5° | 1680866 |
| 10° | 907963 |
| 15° | 362031 |
| 20° | 145169 |
| 25° | 69515 |
| 30° | 36061 |
| 35° | 19032 |
| 40° | 10562 |
| 45° | 6559 |
| 50° | 4528 |
| 55° | 3011 |
| 60° | 2269 |
| 65° | 0 |
| 70° | 0 |
| 75° | 0 |
| 80° | 0 |
| 85° | 0 |



TEST NUMBER: P265061

CATALOG NUMBER: LD2B05D010 EU2B0510SP159040 2LBDL*WMH

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 272.9 | 46.7 |
| 10°-20° | 215.4 | 36.8 |
| 20°-30° | 63.5 | 10.9 |
| 30°-40° | 21.1 | 3.6 |
| 40°-50° | 8.0 | 1.4 |
| 50°-60° | 3.5 | 0.6 |
| 60°-70° | 0.6 | 0.1 |
| 70°-80° | 0.0 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 551.8 | 94.3 |
| 0°-40° | 573.0 | 97.9 |
| 0°-60° | 584.4 | 99.9 |
| 0°-90° | 585.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 585.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 4186 | |
| 5° | 3394 | 273 |
| 15° | 709 | 215 |
| 25° | 128 | 64 |
| 35° | 32 | 21 |
| 45° | 9 | 8 |
| 55° | 4 | 4 |
| 65° | 0 | 1 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P265061

CATALOG NUMBER: LD2B05D010 EU2B0510SP159040 2LBDL*WMH

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 4185.9 |
| 2.5° | 4017.2 |
| 5° | 3394.0 |
| 7.5° | 2614.9 |
| 10° | 1812.4 |
| 12.5° | 1159.8 |
| 15° | 708.8 |
| 17.5° | 432.3 |
| 20° | 276.5 |
| 22.5° | 185.1 |
| 25° | 127.7 |
| 27.5° | 90.2 |
| 30° | 63.3 |
| 32.5° | 44.5 |
| 35° | 31.6 |
| 37.5° | 22.3 |
| 40° | 16.4 |
| 42.5° | 12.9 |
| 45° | 9.4 |
| 47.5° | 8.2 |
| 50° | 5.9 |
| 52.5° | 4.7 |
| 55° | 3.5 |
| 57.5° | 3.5 |
| 60° | 2.3 |
| 62.5° | 1.2 |
| 65° | 0.0 |
| 67.5° | 0.0 |
| 70° | 0.0 |
| 72.5° | 0.0 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







(END OF REPORT)