

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P264495

Luminaire Tested: **LD2B05D010 EU2B0510SP159727 2LBSQC*MW**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P264495
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B05D010 EU2B0510SP159727 2LBSQC*MW
Description: 500 Lumen, 2inch Portfolio LED Downlight
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 455.0 lumens
Efficiency: N/A
Efficacy: 62.3 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 7.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P264495

CATALOG NUMBER: LD2B05D010 EU2B0510SP159727 2LBSQC*MW

Luminous Intensity Polar Plot

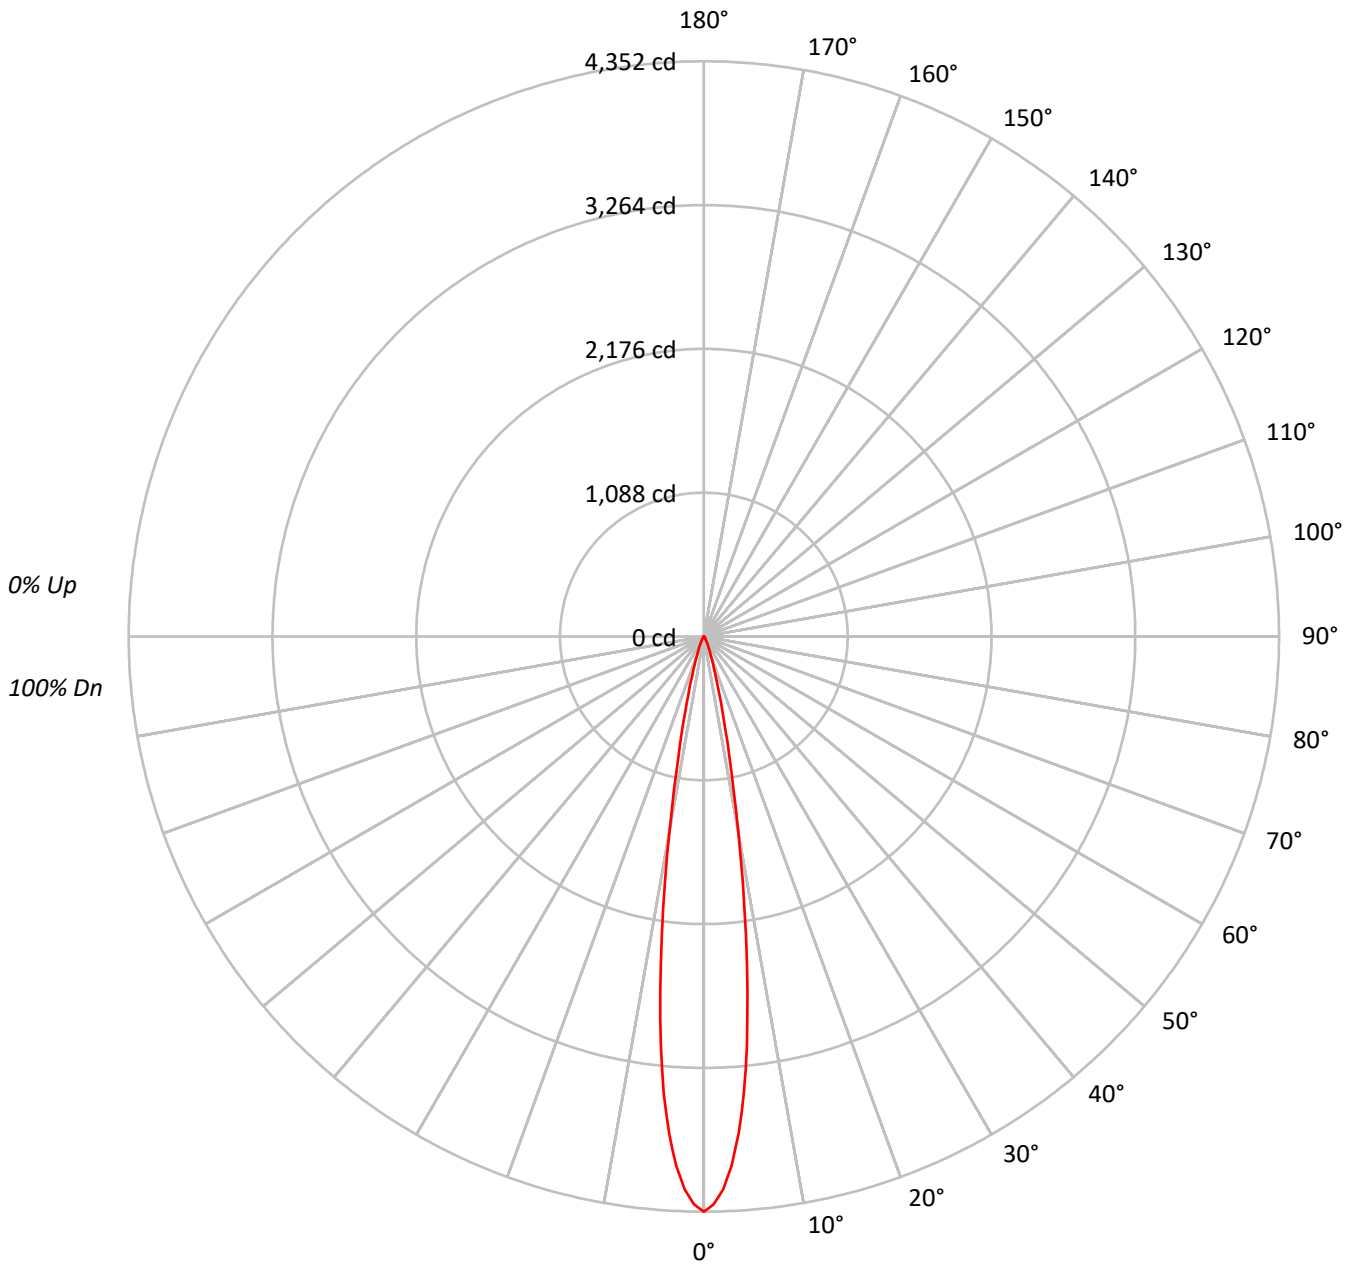



TEST NUMBER: P264495

CATALOG NUMBER: LD2B05D010 EU2B0510SP159727 2LBSQC*MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98	98	98	98
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96	96	96	96
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94	94	94	94
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92	92	92	92
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90	90	90	90
6	103	98	94	92	102	97	94	91	96	93	91	94	92	90	93	91	90	89	89	89	89
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87	87	87	87
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86	86	86	86
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85	85	85	85
10	95	90	87	85	95	90	87	85	89	86	84	89	86	84	88	86	84	83	83	83	83

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2146962
5°	1720882
10°	751108
15°	232756
20°	81169
25°	35819
30°	16236
35°	8432
40°	4830
45°	2302
50°	1458
55°	774
60°	493
65°	584
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P264495

CATALOG NUMBER: LD2B05D010 EU2B0510SP159727 2LBSQC*MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	263.9	58.0
10°-20°	144.5	31.8
20°-30°	32.9	7.2
30°-40°	9.5	2.1
40°-50°	2.9	0.6
50°-60°	0.9	0.2
60°-70°	0.4	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	441.3	97.0
0°-40°	450.8	99.1
0°-60°	454.6	99.9
0°-90°	455.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	455.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4352	
5°	3475	264
15°	456	145
25°	66	33
35°	14	9
45°	3	3
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P264495

CATALOG NUMBER: LD2B05D010 EU2B0510SP159727 2LBSQC*MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	4351.7
1°	4297.5
2°	4185.0
3°	4010.4
4°	3770.4
5°	3474.8
6°	3112.5
7°	2707.7
8°	2285.1
9°	1876.1
10°	1499.3
11°	1180.4
12°	929.2
13°	731.2
14°	577.6
15°	455.7
16°	359.5
17°	286.2
18°	230.2
19°	187.2
20°	154.6
22.5°	99.9
25°	65.8
26°	55.6
27°	47.2
28°	39.7
29°	33.2
30°	28.5
32.5°	19.6
35°	14.0
37.5°	10.3
40°	7.5
42.5°	5.1
45°	3.3
47.5°	2.3
50°	1.9
52.5°	1.4
55°	0.9
57.5°	0.5
60°	0.5
62.5°	0.5
65°	0.5
67.5°	0.5



TEST NUMBER: P264495

CATALOG NUMBER: LD2B05D010 EU2B0510SP159727 2LBSQC*MW

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)