

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P263970

Luminaire Tested: **LD2B05D010 EU2B0510SP158030 2LBD*B**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P263970
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B05D010 EU2B0510SP158030 2LBD*B
Description: 500 Lumen, 2inch Portfolio LED Downlight
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 723.0 lumens
Efficiency: N/A
Efficacy: 99.0 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 7.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P263970

CATALOG NUMBER: LD2B05D010 EU2B0510SP158030 2LBD*B

Luminous Intensity Polar Plot

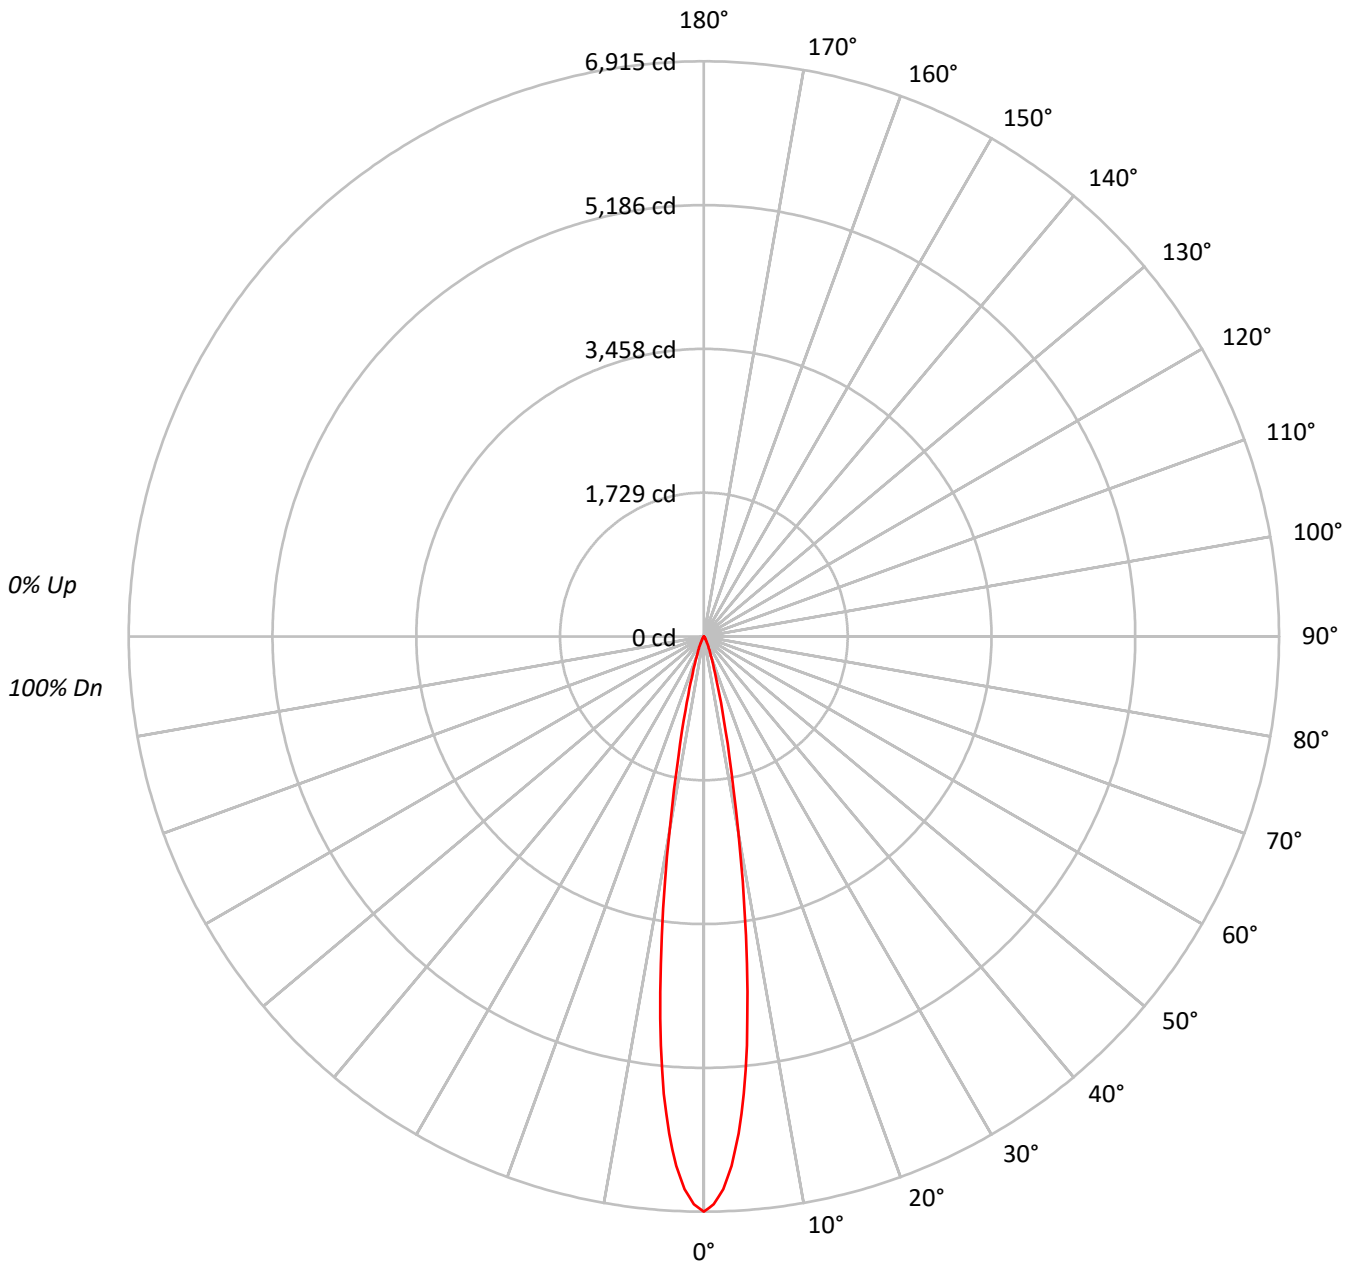



TEST NUMBER: P263970

CATALOG NUMBER: LD2B05D010 EU2B0510SP158030 2LBD*B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98	98	98	98
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96	96	96	96
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94	94	94	94
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92	92	92	92
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90	90	90	90
6	103	98	94	92	102	97	94	91	96	93	91	95	92	90	93	91	90	89	89	89	89
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87	87	87	87
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86	86	86	86
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85	85	85	85
10	95	90	87	85	95	90	87	85	89	86	85	89	86	84	88	86	84	83	83	83	83

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3411547
5°	2734503
10°	1193517
15°	369845
20°	128946
25°	56941
30°	25807
35°	13431
40°	7664
45°	3628
50°	2303
55°	1290
60°	691
65°	817
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P263970

CATALOG NUMBER: LD2B05D010 EU2B0510SP158030 2LBD*B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	419.3	58.0
10°-20°	229.6	31.8
20°-30°	52.3	7.2
30°-40°	15.1	2.1
40°-50°	4.7	0.6
50°-60°	1.4	0.2
60°-70°	0.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	701.3	97.0
0°-40°	716.3	99.1
0°-60°	722.4	99.9
0°-90°	723.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	723.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6915	
5°	5522	419
15°	724	230
25°	105	52
35°	22	15
45°	5	5
55°	2	1
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P263970

CATALOG NUMBER: LD2B05D010 EU2B0510SP158030 2LBD*B

CANDELA DISTRIBUTION (FULL):

	0°
0°	6914.9
1°	6828.8
2°	6650.0
3°	6372.6
4°	5991.2
5°	5521.5
6°	4945.8
7°	4302.5
8°	3631.1
9°	2981.1
10°	2382.4
11°	1875.6
12°	1476.5
13°	1161.9
14°	917.8
15°	724.1
16°	571.3
17°	454.8
18°	365.8
19°	297.5
20°	245.6
22.5°	158.8
25°	104.6
26°	88.3
27°	74.9
28°	63.1
29°	52.7
30°	45.3
32.5°	31.2
35°	22.3
37.5°	16.3
40°	11.9
42.5°	8.2
45°	5.2
47.5°	3.7
50°	3.0
52.5°	2.2
55°	1.5
57.5°	0.7
60°	0.7
62.5°	0.7
65°	0.7
67.5°	0.7



TEST NUMBER: P263970

CATALOG NUMBER: LD2B05D010 EU2B0510SP158030 2LBD*B

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)