

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P264079

Luminaire Tested: **LD2B05D010 EU2B0510SP158040 2LBSQC*MW**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P264079
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1805-787-1)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LD2B05D010 EU2B0510SP158040 2LBSQC*MW
Description: 500 Lumen, 2inch Portfolio LED Downlight
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 688.0 lumens
Efficiency: N/A
Efficacy: 94.2 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.28 / 0.28
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 7.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P264079

CATALOG NUMBER: LD2B05D010 EU2B0510SP158040 2LBSQC*MW

Luminous Intensity Polar Plot

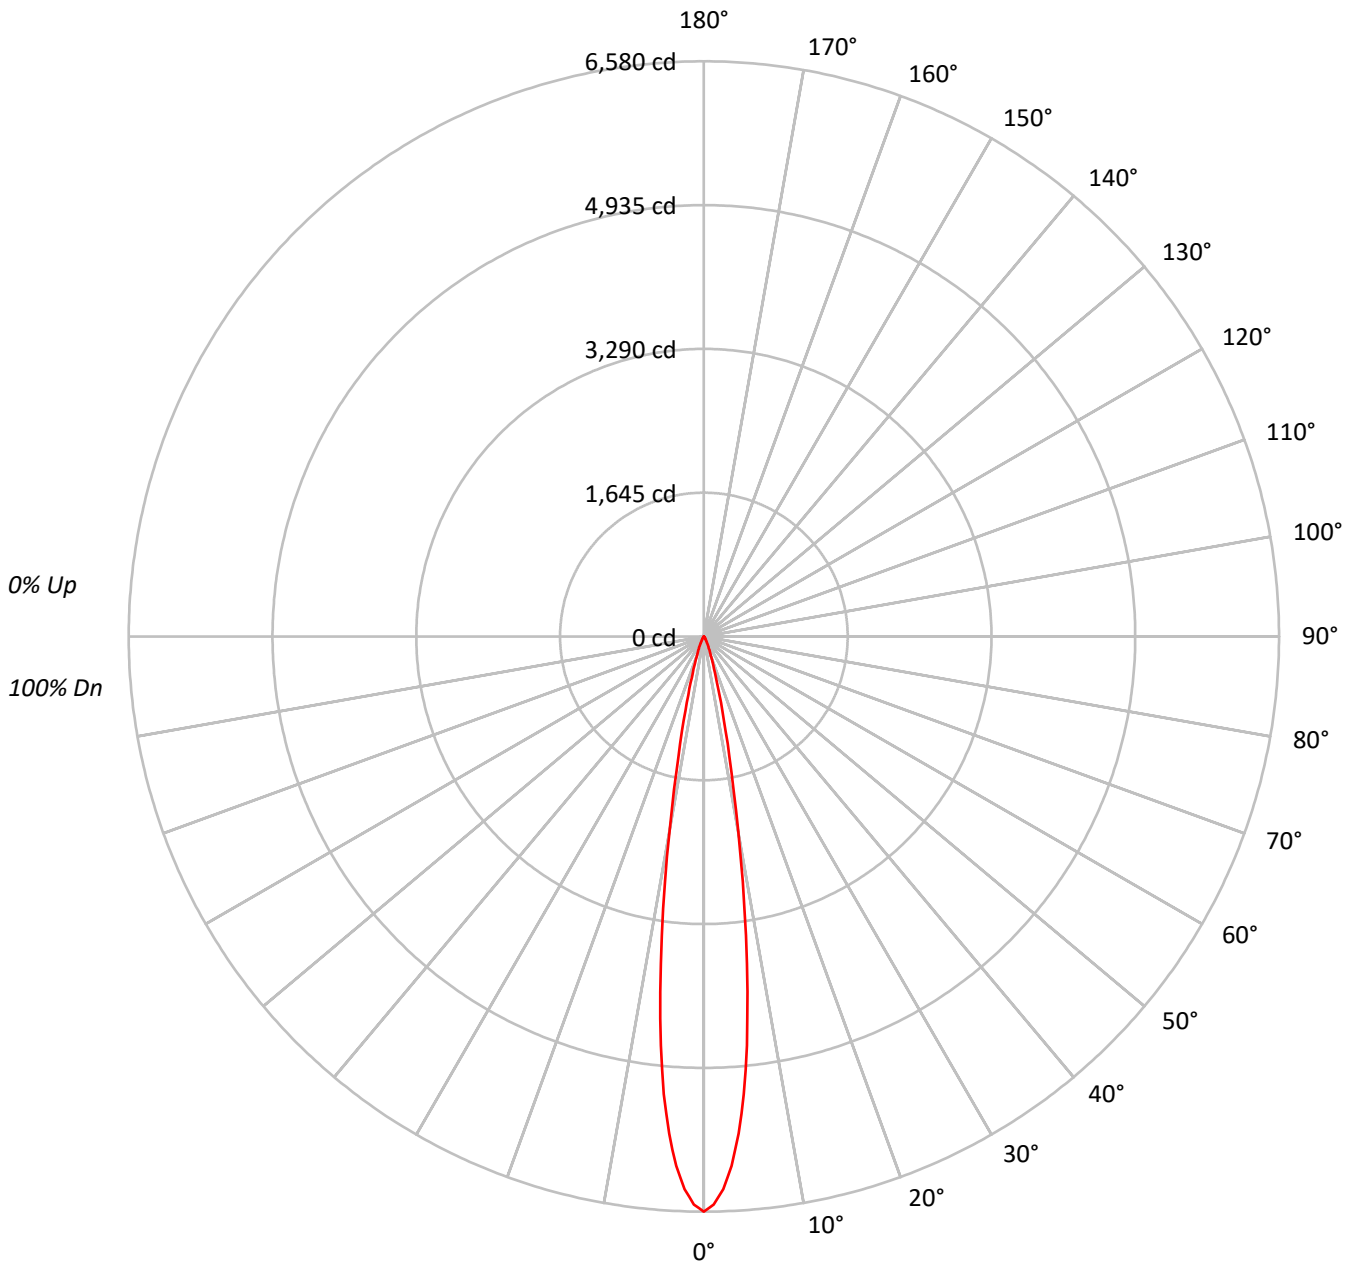



TEST NUMBER: P264079

CATALOG NUMBER: LD2B05D010 EU2B0510SP158040 2LBSQC*MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	116	114	112	111	113	112	110	109	108	107	106	104	103	102	101	100	100	98	98	98	98
2	113	109	107	105	111	108	106	104	105	103	101	102	101	99	99	98	97	96	96	96	96
3	110	106	103	100	108	105	102	100	102	100	98	100	98	97	98	96	95	94	94	94	94
4	107	103	99	97	106	102	99	96	100	97	95	98	96	94	96	95	93	92	92	92	92
5	105	100	97	94	104	99	96	94	98	95	93	96	94	92	95	93	91	90	90	90	90
6	103	98	94	92	102	97	94	91	96	93	91	95	92	90	93	91	90	89	89	89	89
7	101	95	92	90	100	95	92	89	94	91	89	93	90	89	92	90	88	87	87	87	87
8	99	93	90	88	98	93	90	88	92	89	87	91	89	87	91	88	87	86	86	86	86
9	97	92	88	86	96	91	88	86	91	88	86	90	87	86	89	87	85	85	85	85	85
10	95	90	87	85	95	90	87	85	89	86	85	89	86	84	88	86	84	83	83	83	83

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3246419
5°	2602173
10°	1135755
15°	351969
20°	122698
25°	54164
30°	24553
35°	12768
40°	7278
45°	3419
50°	2149
55°	1204
60°	691
65°	817
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P264079

CATALOG NUMBER: LD2B05D010 EU2B0510SP158040 2LBSQC*MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	399.0	58.0
10°-20°	218.5	31.8
20°-30°	49.8	7.2
30°-40°	14.3	2.1
40°-50°	4.4	0.6
50°-60°	1.3	0.2
60°-70°	0.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	667.3	97.0
0°-40°	681.6	99.1
0°-60°	687.4	99.9
0°-90°	688.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	688.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	6580	
5°	5254	399
15°	689	219
25°	100	50
35°	21	14
45°	5	4
55°	1	1
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P264079

CATALOG NUMBER: LD2B05D010 EU2B0510SP158040 2LBSQC*MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	6580.2
1°	6498.3
2°	6328.1
3°	6064.1
4°	5701.2
5°	5254.3
6°	4706.4
7°	4094.2
8°	3455.3
9°	2836.8
10°	2267.1
11°	1784.8
12°	1405.0
13°	1105.6
14°	873.4
15°	689.1
16°	543.6
17°	432.8
18°	348.1
19°	283.1
20°	233.7
22.5°	151.1
25°	99.5
26°	84.0
27°	71.3
28°	60.0
29°	50.1
30°	43.1
32.5°	29.7
35°	21.2
37.5°	15.5
40°	11.3
42.5°	7.8
45°	4.9
47.5°	3.5
50°	2.8
52.5°	2.1
55°	1.4
57.5°	0.7
60°	0.7
62.5°	0.7
65°	0.7
67.5°	0.7



TEST NUMBER: P264079

CATALOG NUMBER: LD2B05D010 EU2B0510SP158040 2LBSQC*MW

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







70°		0.0
72.5°		0.0



(END OF REPORT)