

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P494733

Luminaire Tested: **LDA2B108030R60D010 2LBD1GPH**

Issue Date: 3/8/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P494733
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2011-037-53)
Test Lab: INNOVATION CENTER
Issue Date: 3/8/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LDA2B108030R60D010 2LBD1GPH
Description: 1000 LUMEN 2IN ADJUSTABLE LED LUMINAIRE WITH 80 CRI LEDS AND 3000K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1042.6 lumens
Efficiency: N/A
Efficacy: 104.3 lumens/watt
Spacing Criteria (0/90/45): 0.92 / 0.92 / 0.87
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 10
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P494733
CATALOG NUMBER: LDA2B108030R60D010 2LBD1GPH

Luminous Intensity Polar Plot

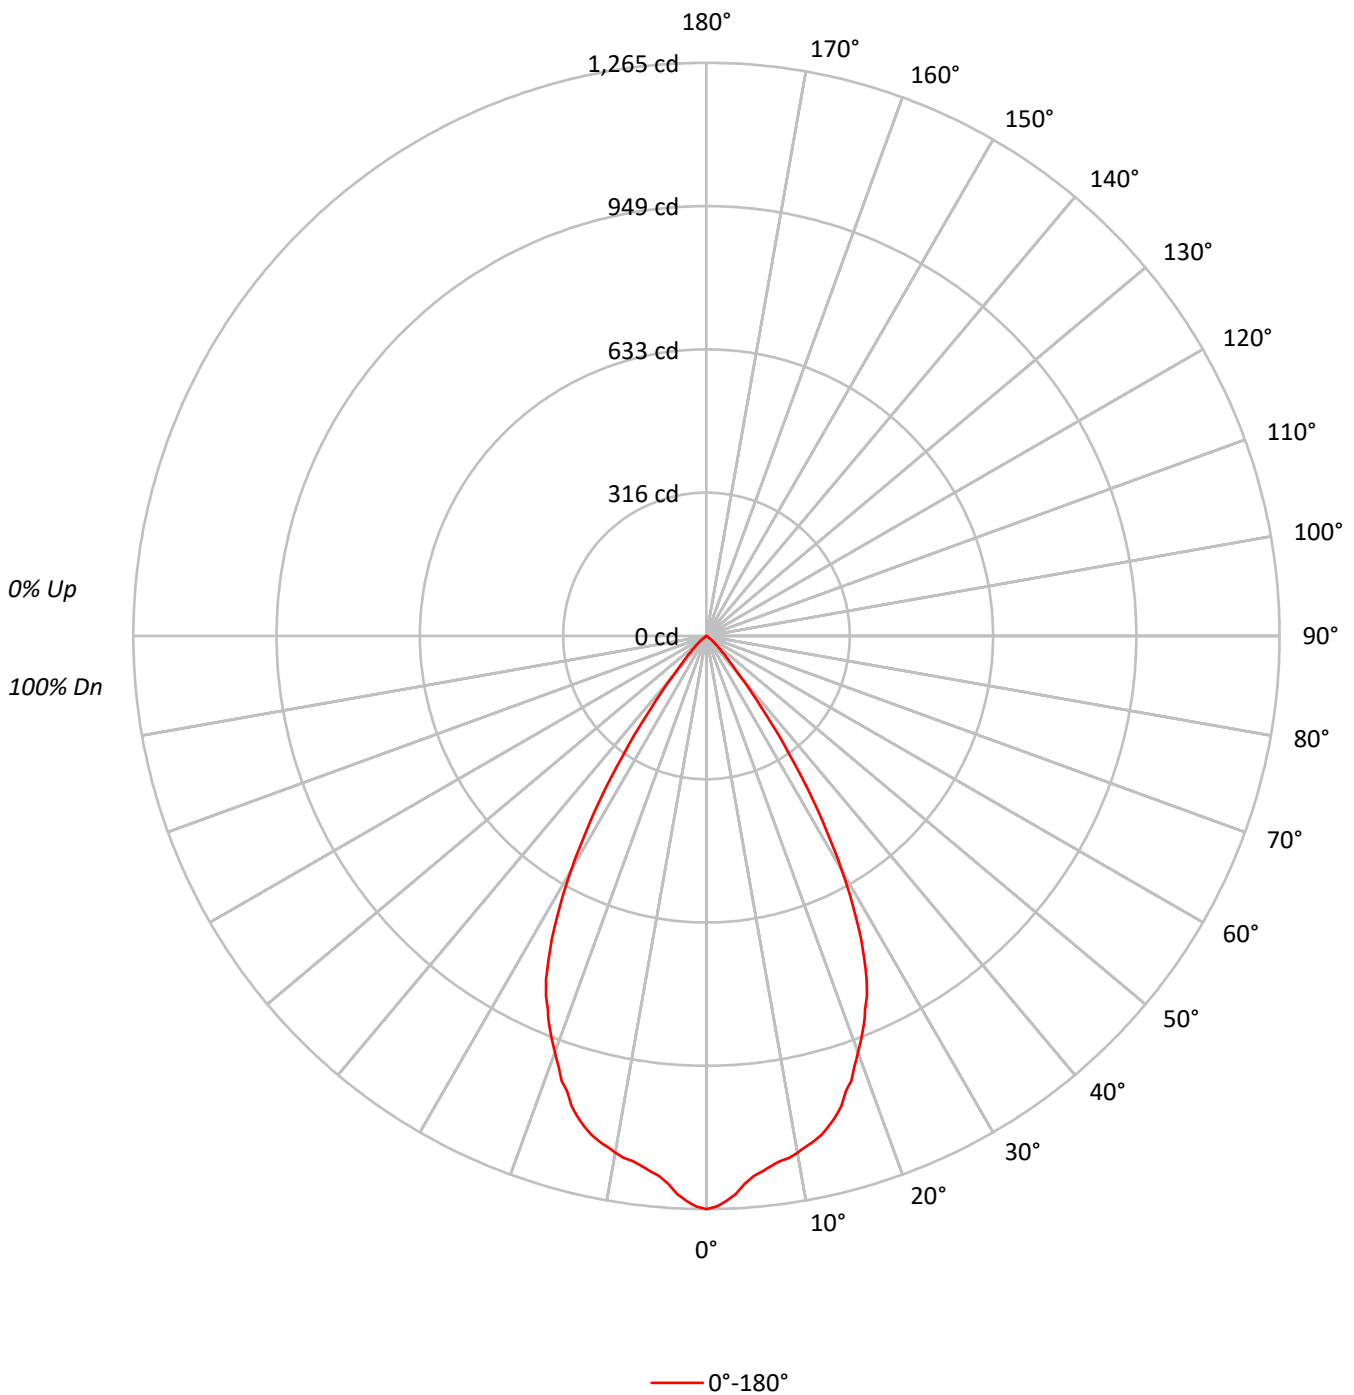



TEST NUMBER: P494733

CATALOG NUMBER: LDA2B108030R60D010 2LBD1GPH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	114	111	109	106	111	109	107	105	105	103	102		101	100	99		98	97	96	94
2	108	104	100	96	106	102	98	95	99	96	93		96	93	91		93	91	89	88
3	103	97	92	88	101	96	91	88	93	89	86		91	87	85		88	86	84	82
4	98	91	86	81	96	90	85	81	88	83	80		86	82	79		84	81	78	77
5	93	85	80	75	92	84	79	75	83	78	74		81	77	74		79	76	73	72
6	89	80	74	70	87	79	74	70	78	73	70		77	72	69		75	72	69	67
7	85	76	70	66	83	75	69	66	74	69	65		73	68	65		71	67	64	63
8	81	71	66	62	79	71	65	61	70	65	61		69	64	61		68	64	61	59
9	77	68	62	58	76	67	62	58	66	61	58		65	61	57		64	60	57	56
10	73	64	58	55	72	64	58	54	63	58	54		62	57	54		61	57	54	53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	624201
5°	592612
10°	580126
15°	561536
20°	513422
25°	455796
30°	340957
35°	192490
40°	72454
45°	32444
50°	15811
55°	3183
60°	1085
65°	584
70°	721
75°	0
80°	0
85°	0



TEST NUMBER: P494733

CATALOG NUMBER: LDA2B108030R60D010 2LBD1GPH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	113.3	10.9
10°-20°	305.3	29.3
20°-30°	373.1	35.8
30°-40°	203.5	19.5
40°-50°	40.7	3.9
50°-60°	5.8	0.6
60°-70°	0.7	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	791.7	75.9
0°-40°	995.2	95.4
0°-60°	1041.7	99.9
0°-90°	1042.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1042.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1265	
5°	1197	113
15°	1099	305
25°	837	373
35°	320	203
45°	46	41
55°	4	6
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P494733

CATALOG NUMBER: LDA2B108030R60D010 2LBD1GPH

CANDELA DISTRIBUTION (FULL):

0°	
0°	1265.2
1°	1259.4
2°	1248.3
3°	1233.5
4°	1212.4
5°	1196.6
6°	1188.1
7°	1178.1
8°	1170.1
9°	1166.5
10°	1158.0
11°	1148.5
12°	1140.0
13°	1130.0
14°	1115.2
15°	1099.4
16°	1079.3
17°	1051.3
18°	1033.3
19°	1004.3
20°	977.9
21°	953.6
22.5°	912.9
23°	896.0
24°	870.1
25°	837.3
26°	795.6
27°	751.7
28°	701.6
29°	654.0
30°	598.5
32.5°	459.1
35°	319.6
37.5°	200.2
40°	112.5
42.5°	70.3
45°	46.5
47.5°	31.7
50°	20.6
52.5°	10.6
55°	3.7
57.5°	1.6
60°	1.1
62.5°	1.1
65°	0.5



TEST NUMBER: P494733

CATALOG NUMBER: LDA2B108030R60D010 2LBD1GPH

CANDELA DISTRIBUTION (continued):

	0°
67.5°	0.5
70°	0.5
72.5°	0.5
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)