

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P494753

Luminaire Tested: **LDA2B108030R60D010 2LBDLC1MMS**

Issue Date: 3/9/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P494753
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2011-037-55)
Test Lab: INNOVATION CENTER
Issue Date: 3/9/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LDA2B108030R60D010 2LBDLC1MMS
Description: 1000 LUMEN 2IN ADJUSTABLE LED LUMINAIRE WITH 80 CRI LEDS AND 3000K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1042.6 lumens
Efficiency: N/A
Efficacy: 104.3 lumens/watt
Spacing Criteria (0/90/45): 0.9 / 0.9 / 0.86
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 10
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P494753

CATALOG NUMBER: LDA2B108030R60D010 2LBDLC1MMS

Luminous Intensity Polar Plot

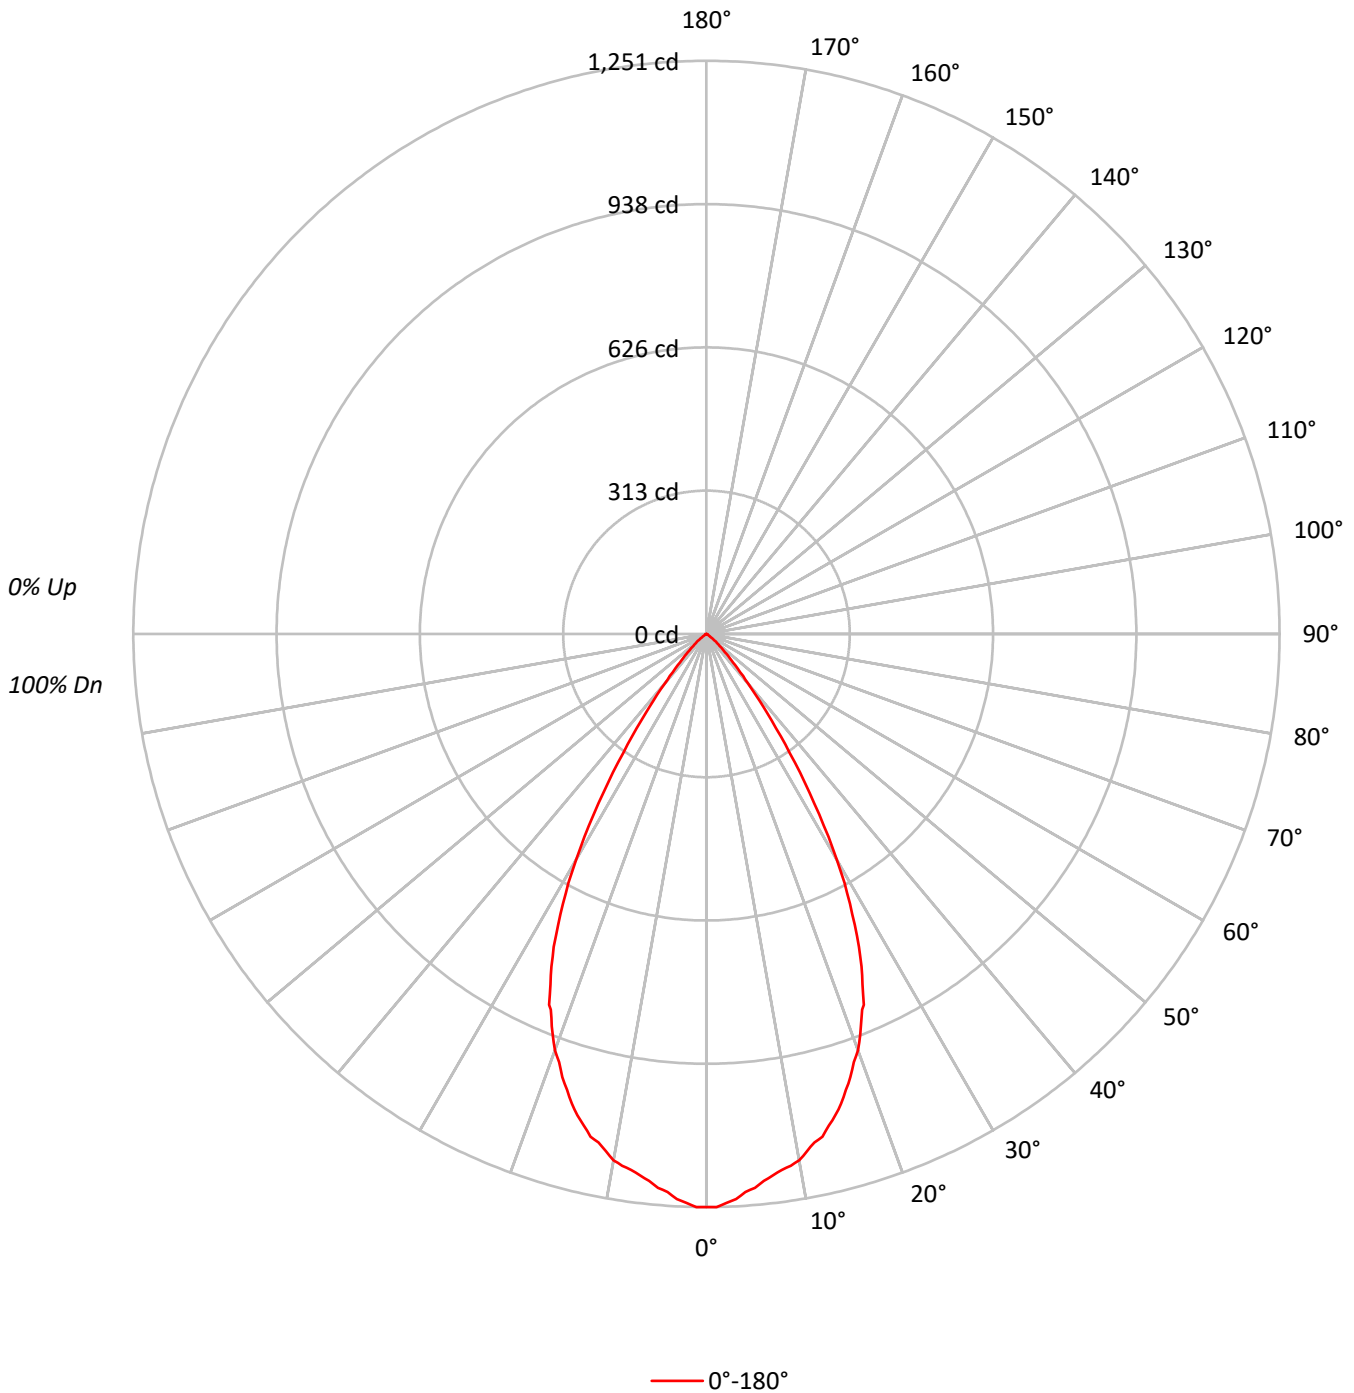



TEST NUMBER: P494753

CATALOG NUMBER: LDA2B108030R60D010 2LBDLC1MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82
4	98	90	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67
7	84	75	69	65	83	74	69	65	73	68	65	72	68	64	71	67	64	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59
9	76	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55
10	73	63	58	54	72	63	58	54	62	57	54	61	57	54	61	57	54	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	617097
5°	601031
10°	584435
15°	555509
20°	507541
25°	435818
30°	324322
35°	190382
40°	90745
45°	42352
50°	21107
55°	7397
60°	1677
65°	1284
70°	865
75°	1144
80°	0
85°	0



TEST NUMBER: P494753

CATALOG NUMBER: LDA2B108030R60D010 2LBDLC1MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	114.2	11.0
10°-20°	302.6	29.0
20°-30°	359.3	34.5
30°-40°	202.8	19.5
40°-50°	52.7	5.1
50°-60°	9.6	0.9
60°-70°	1.0	0.1
70°-80°	0.4	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	776.1	74.4
0°-40°	978.9	93.9
0°-60°	1041.2	99.9
0°-90°	1042.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1042.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1251	
5°	1214	114
15°	1088	303
25°	801	359
35°	316	203
45°	61	53
55°	9	10
65°	1	1
75°	1	0
85°	0	0
90°	0	



TEST NUMBER: P494753

CATALOG NUMBER: LDA2B108030R60D010 2LBDLC1MMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	1250.8
1°	1251.3
2°	1242.8
3°	1235.3
4°	1221.0
5°	1213.6
6°	1200.4
7°	1190.6
8°	1181.5
9°	1175.2
10°	1166.6
11°	1150.0
12°	1134.5
13°	1125.9
14°	1105.9
15°	1087.6
16°	1066.4
17°	1041.2
18°	1017.1
19°	988.5
20°	966.7
21°	936.9
22.5°	887.7
23°	879.1
24°	837.3
25°	800.6
26°	760.0
27°	713.0
28°	666.6
29°	621.4
30°	569.3
32.5°	438.1
35°	316.1
37.5°	215.9
40°	140.9
42.5°	92.2
45°	60.7
47.5°	41.2
50°	27.5
52.5°	17.2
55°	8.6
57.5°	3.4
60°	1.7
62.5°	1.1
65°	1.1



TEST NUMBER: P494753

CATALOG NUMBER: LDA2B108030R60D010 2LBDLC1MMS

CANDELA DISTRIBUTION (continued):

	0°
67.5°	0.6
70°	0.6
72.5°	0.6
75°	0.6
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)