

Scaled data based on original data using

LM-41-14 Approved Method for Photometric Testing Of Indoor Fluorescent Luminaires

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: io LED

Report Number: P314993

Luminaire Tested: **LDA2B10NFL9027D010 PIN1MMS**

Issue Date: 3/3/2020

Test Information

Test Method: LM-41-14
Report Number: P314993
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-1811-033-2)
Test Lab: INNOVATION CENTER(G2)
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: io LED
Catalog Number: LDA2B10NFL9027D010 PIN1MMS
Description: PORTFOLIO 2IN ADJ 1000 LUMEN LED LUMINAIRE WITH NARROW FLOOD OPTIC
AND 2in Adj PinHole, Black oculus, matte metallic silver finish
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 758.9 lumens
Efficiency: N/A
Efficacy: 75.9 lumens/watt
Spacing Criteria (0/90/45): 0.39 / 0.39 / 0.39
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct


Input Watts (W): 10
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P314993

CATALOG NUMBER: LDA2B10NFL9027D010 PIN1MMS

Luminous Intensity Polar Plot

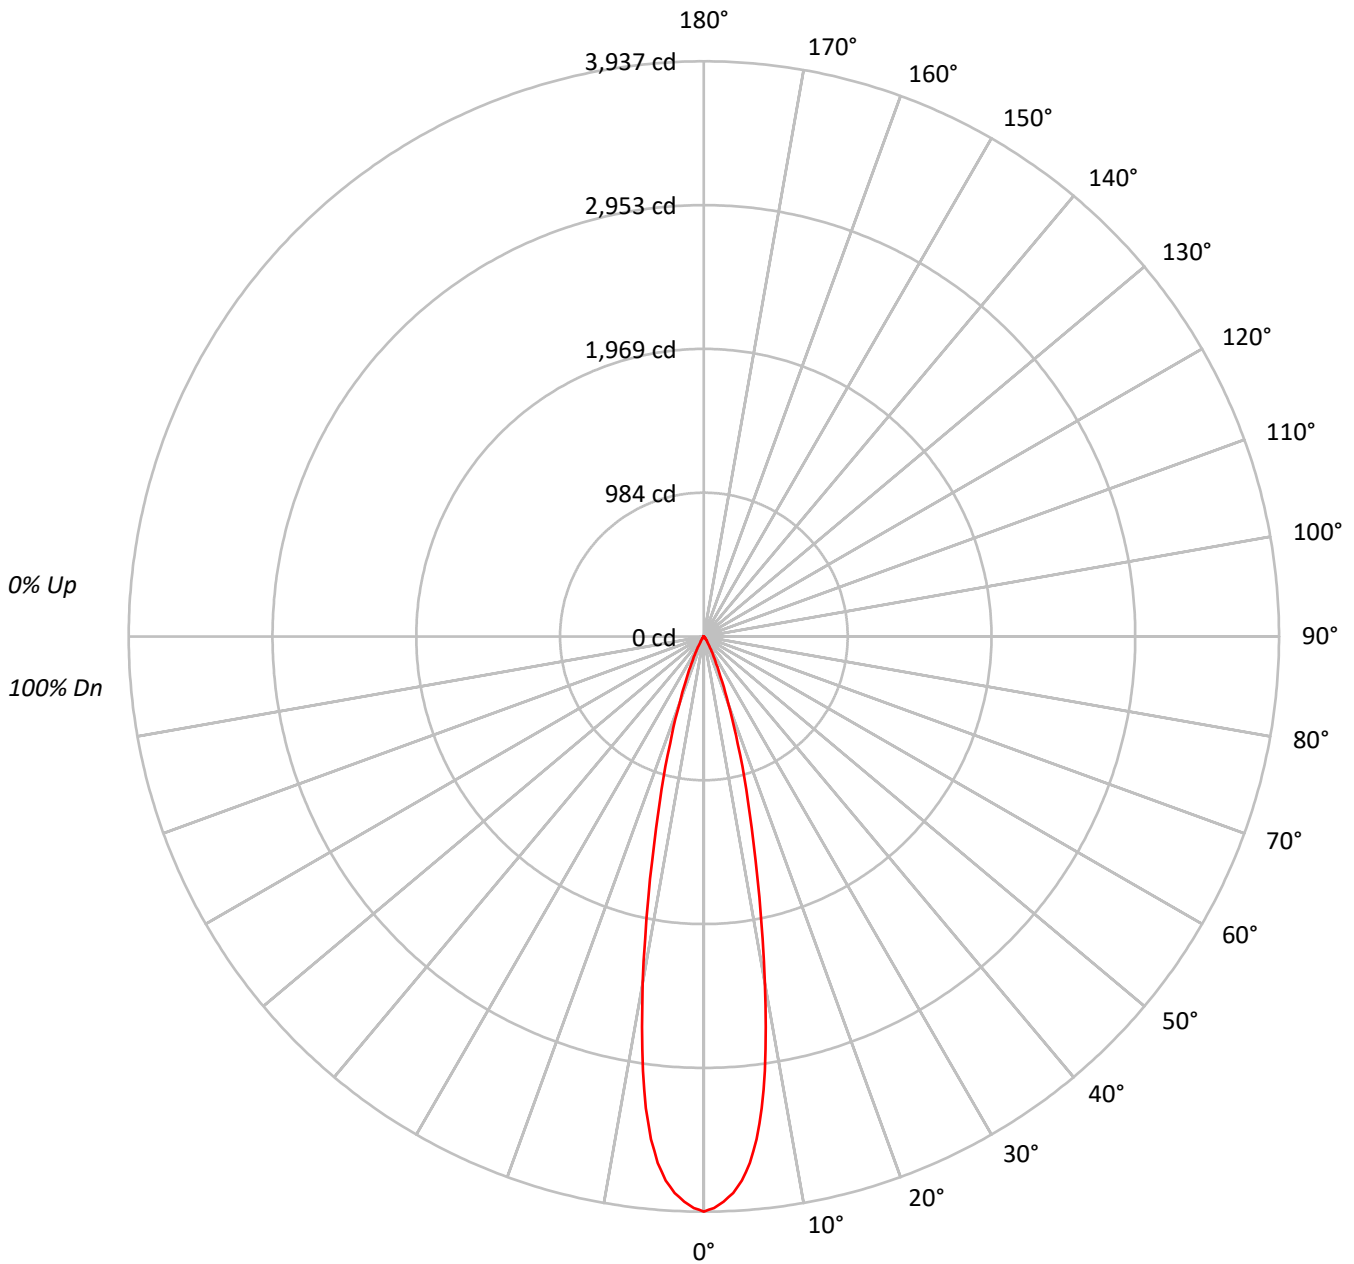



TEST NUMBER: P314993

CATALOG NUMBER: LDA2B10NFL9027D010 PIN1MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|-----|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | 100 | | | | | | | | | | | | | | | | |
| 1 | 115 | 113 | 111 | 110 | 113 | 111 | 109 | 108 | 107 | 106 | 105 | 103 | 102 | 102 | 100 | 99 | 99 | 97 | | | 97 | | | | | | | | | | | | | | | | |
| 2 | 112 | 108 | 105 | 103 | 110 | 107 | 104 | 102 | 103 | 101 | 100 | 101 | 99 | 98 | 98 | 97 | 96 | 94 | | | 94 | | | | | | | | | | | | | | | | |
| 3 | 108 | 104 | 100 | 98 | 107 | 103 | 99 | 97 | 100 | 98 | 95 | 98 | 96 | 94 | 96 | 94 | 93 | 91 | | | 91 | | | | | | | | | | | | | | | | |
| 4 | 105 | 100 | 96 | 94 | 104 | 99 | 96 | 93 | 97 | 94 | 92 | 95 | 93 | 91 | 94 | 92 | 90 | 89 | | | 89 | | | | | | | | | | | | | | | | |
| 5 | 102 | 97 | 93 | 90 | 101 | 96 | 92 | 90 | 94 | 91 | 89 | 93 | 90 | 88 | 92 | 89 | 87 | 86 | | | 86 | | | | | | | | | | | | | | | | |
| 6 | 100 | 94 | 90 | 87 | 98 | 93 | 89 | 87 | 92 | 89 | 86 | 91 | 88 | 86 | 89 | 87 | 85 | 84 | | | 84 | | | | | | | | | | | | | | | | |
| 7 | 97 | 91 | 87 | 84 | 96 | 90 | 87 | 84 | 89 | 86 | 84 | 88 | 85 | 83 | 87 | 85 | 83 | 82 | | | 82 | | | | | | | | | | | | | | | | |
| 8 | 95 | 88 | 85 | 82 | 94 | 88 | 84 | 82 | 87 | 84 | 81 | 86 | 83 | 81 | 85 | 83 | 81 | 80 | | | 80 | | | | | | | | | | | | | | | | |
| 9 | 92 | 86 | 82 | 80 | 92 | 86 | 82 | 80 | 85 | 82 | 79 | 84 | 81 | 79 | 84 | 81 | 79 | 78 | | | 78 | | | | | | | | | | | | | | | | |
| 10 | 90 | 84 | 80 | 78 | 90 | 84 | 80 | 78 | 83 | 80 | 77 | 82 | 79 | 77 | 82 | 79 | 77 | 76 | | | 76 | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|---------|
| | 0° |
| 0° | 1942415 |
| 5° | 1791356 |
| 10° | 1207144 |
| 15° | 595195 |
| 20° | 254217 |
| 25° | 99945 |
| 30° | 39365 |
| 35° | 17225 |
| 40° | 8308 |
| 45° | 3977 |
| 50° | 2226 |
| 55° | 1204 |
| 60° | 691 |
| 65° | 467 |
| 70° | 577 |
| 75° | 0 |
| 80° | 0 |
| 85° | 0 |



TEST NUMBER: P314993

CATALOG NUMBER: LDA2B10NFL9027D010 PIN1MMS

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 306.4 | 40.4 |
| 10°-20° | 330.0 | 43.5 |
| 20°-30° | 95.3 | 12.6 |
| 30°-40° | 20.1 | 2.7 |
| 40°-50° | 4.9 | 0.7 |
| 50°-60° | 1.4 | 0.2 |
| 60°-70° | 0.5 | 0.1 |
| 70°-80° | 0.3 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 731.7 | 96.4 |
| 0°-40° | 751.8 | 99.1 |
| 0°-60° | 758.2 | 99.9 |
| 0°-90° | 758.9 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 758.9 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 3937 | |
| 5° | 3617 | 306 |
| 15° | 1165 | 330 |
| 25° | 184 | 95 |
| 35° | 29 | 20 |
| 45° | 6 | 5 |
| 55° | 1 | 1 |
| 65° | 0 | 1 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P314993

CATALOG NUMBER: LDA2B10NFL9027D010 PIN1MMS

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 3937.1 |
| 1° | 3912.4 |
| 2° | 3870.5 |
| 3° | 3814.0 |
| 4° | 3733.8 |
| 5° | 3617.1 |
| 6° | 3459.7 |
| 7° | 3254.3 |
| 8° | 3001.6 |
| 9° | 2707.0 |
| 10° | 2409.6 |
| 11° | 2109.0 |
| 12° | 1825.2 |
| 13° | 1573.3 |
| 14° | 1351.7 |
| 15° | 1165.3 |
| 17.5° | 770.2 |
| 20° | 484.2 |
| 22.5° | 297.8 |
| 25° | 183.6 |
| 27.5° | 112.0 |
| 30° | 69.1 |
| 32.5° | 43.7 |
| 35° | 28.6 |
| 37.5° | 19.0 |
| 40° | 12.9 |
| 42.5° | 8.9 |
| 45° | 5.7 |
| 47.5° | 3.6 |
| 50° | 2.9 |
| 52.5° | 2.1 |
| 55° | 1.4 |
| 57.5° | 1.1 |
| 60° | 0.7 |
| 62.5° | 0.7 |
| 65° | 0.4 |
| 67.5° | 0.4 |
| 70° | 0.4 |
| 72.5° | 0.4 |
| 75° | 0.0 |
| 77.5° | 0.4 |
| 80° | 0.0 |
| 82.5° | 0.0 |



TEST NUMBER: P314993

CATALOG NUMBER: LDA2B10NFL9027D010 PIN1MMS

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0



Report Generated By E9808895 / USPTCWHP6082093





— 0°-180°







| | | |
|-------|--|-----|
| 85° | | 0.0 |
| 87.5° | | 0.0 |



(END OF REPORT)