

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P497025

Luminaire Tested: **LDA2B109730R30D010 2LBDC1MW**

Issue Date: 3/12/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P497025
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2011-037-14)
Test Lab: INNOVATION CENTER
Issue Date: 3/12/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LDA2B109730R30D010 2LBDC1MW
Description: 1000 LUMEN 2IN ADJUSTABLE LED LUMINAIRE WITH 97 CRI LEDS AND 3000K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 746.5 lumens
Efficiency: N/A
Efficacy: 74.7 lumens/watt
Spacing Criteria (0/90/45): 0.48 / 0.48 / 0.46
Luminous Opening: Circular (Dia: 0.17' x H: 0')
CIE Type: Direct

Input Watts (W): 10
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P497025

CATALOG NUMBER: LDA2B109730R30D010 2LBDC1MW

Luminous Intensity Polar Plot

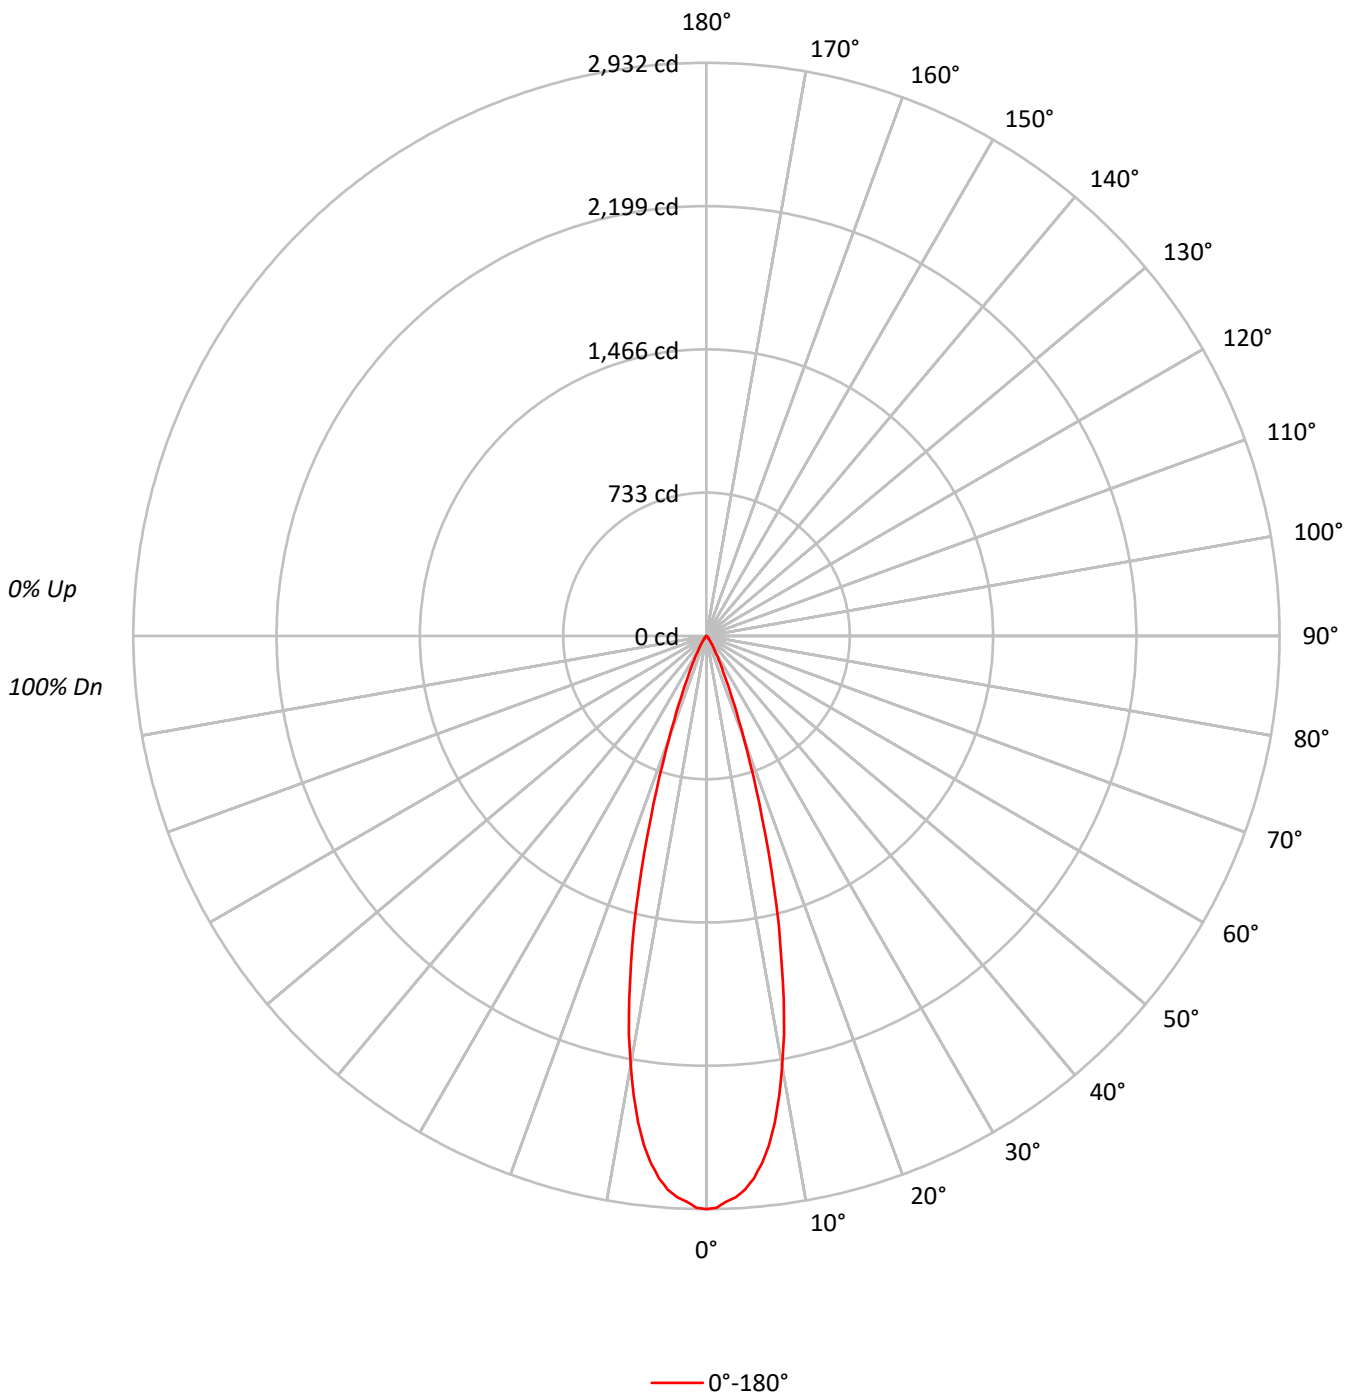



TEST NUMBER: P497025

CATALOG NUMBER: LDA2B109730R30D010 2LBDC1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	115	113	111	109	113	111	109	108	107	106	104		103	102	101		100	99	98	97
2	111	108	105	102	109	106	103	101	103	101	99		100	98	97		97	96	95	93
3	108	103	100	97	106	102	99	96	99	97	94		97	95	93		95	93	92	90
4	104	99	95	92	103	98	94	92	96	93	91		94	92	90		92	90	89	87
5	101	95	91	88	100	95	91	88	93	90	87		91	89	86		90	88	86	85
6	98	92	88	85	97	91	88	85	90	87	84		89	86	84		88	85	83	82
7	96	89	85	82	95	89	85	82	87	84	81		86	83	81		85	83	81	80
8	93	86	82	79	92	86	82	79	85	81	79		84	81	79		83	81	78	77
9	90	84	80	77	90	83	80	77	83	79	77		82	79	76		81	78	76	75
10	88	81	77	75	87	81	77	75	80	77	75		80	77	74		79	76	74	73

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1446685
5°	1379360
10°	1118622
15°	683813
20°	298792
25°	111758
30°	46372
35°	21682
40°	10047
45°	4884
50°	2686
55°	1032
60°	395
65°	467
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P497025

CATALOG NUMBER: LDA2B109730R30D010 2LBDC1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	248.5	33.3
10°-20°	358.7	48.1
20°-30°	107.1	14.3
30°-40°	24.6	3.3
40°-50°	6.0	0.8
50°-60°	1.4	0.2
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	714.2	95.7
0°-40°	738.8	99.0
0°-60°	746.3	100.0
0°-90°	746.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	746.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2932	
5°	2785	248
15°	1339	359
25°	205	107
35°	36	25
45°	7	6
55°	1	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P497025

CATALOG NUMBER: LDA2B109730R30D010 2LBDC1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	2932.3
1°	2925.6
2°	2895.9
3°	2876.0
4°	2838.8
5°	2785.2
6°	2712.1
7°	2624.9
8°	2513.8
9°	2378.4
10°	2232.9
11°	2077.3
12°	1900.5
13°	1710.4
14°	1529.7
15°	1338.8
16°	1154.2
17°	972.3
18°	825.7
19°	683.3
20°	569.1
21°	461.1
22.5°	341.8
23°	308.2
24°	252.3
25°	205.3
26°	168.6
27°	140.4
28°	115.8
29°	97.0
30°	81.4
32.5°	53.2
35°	36.0
37.5°	23.9
40°	15.6
42.5°	10.2
45°	7.0
47.5°	5.1
50°	3.5
52.5°	2.3
55°	1.2
57.5°	0.8
60°	0.4
62.5°	0.4
65°	0.4



TEST NUMBER: P497025

CATALOG NUMBER: LDA2B109730R30D010 2LBDC1MW

CANDELA DISTRIBUTION (continued):

	0°
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)